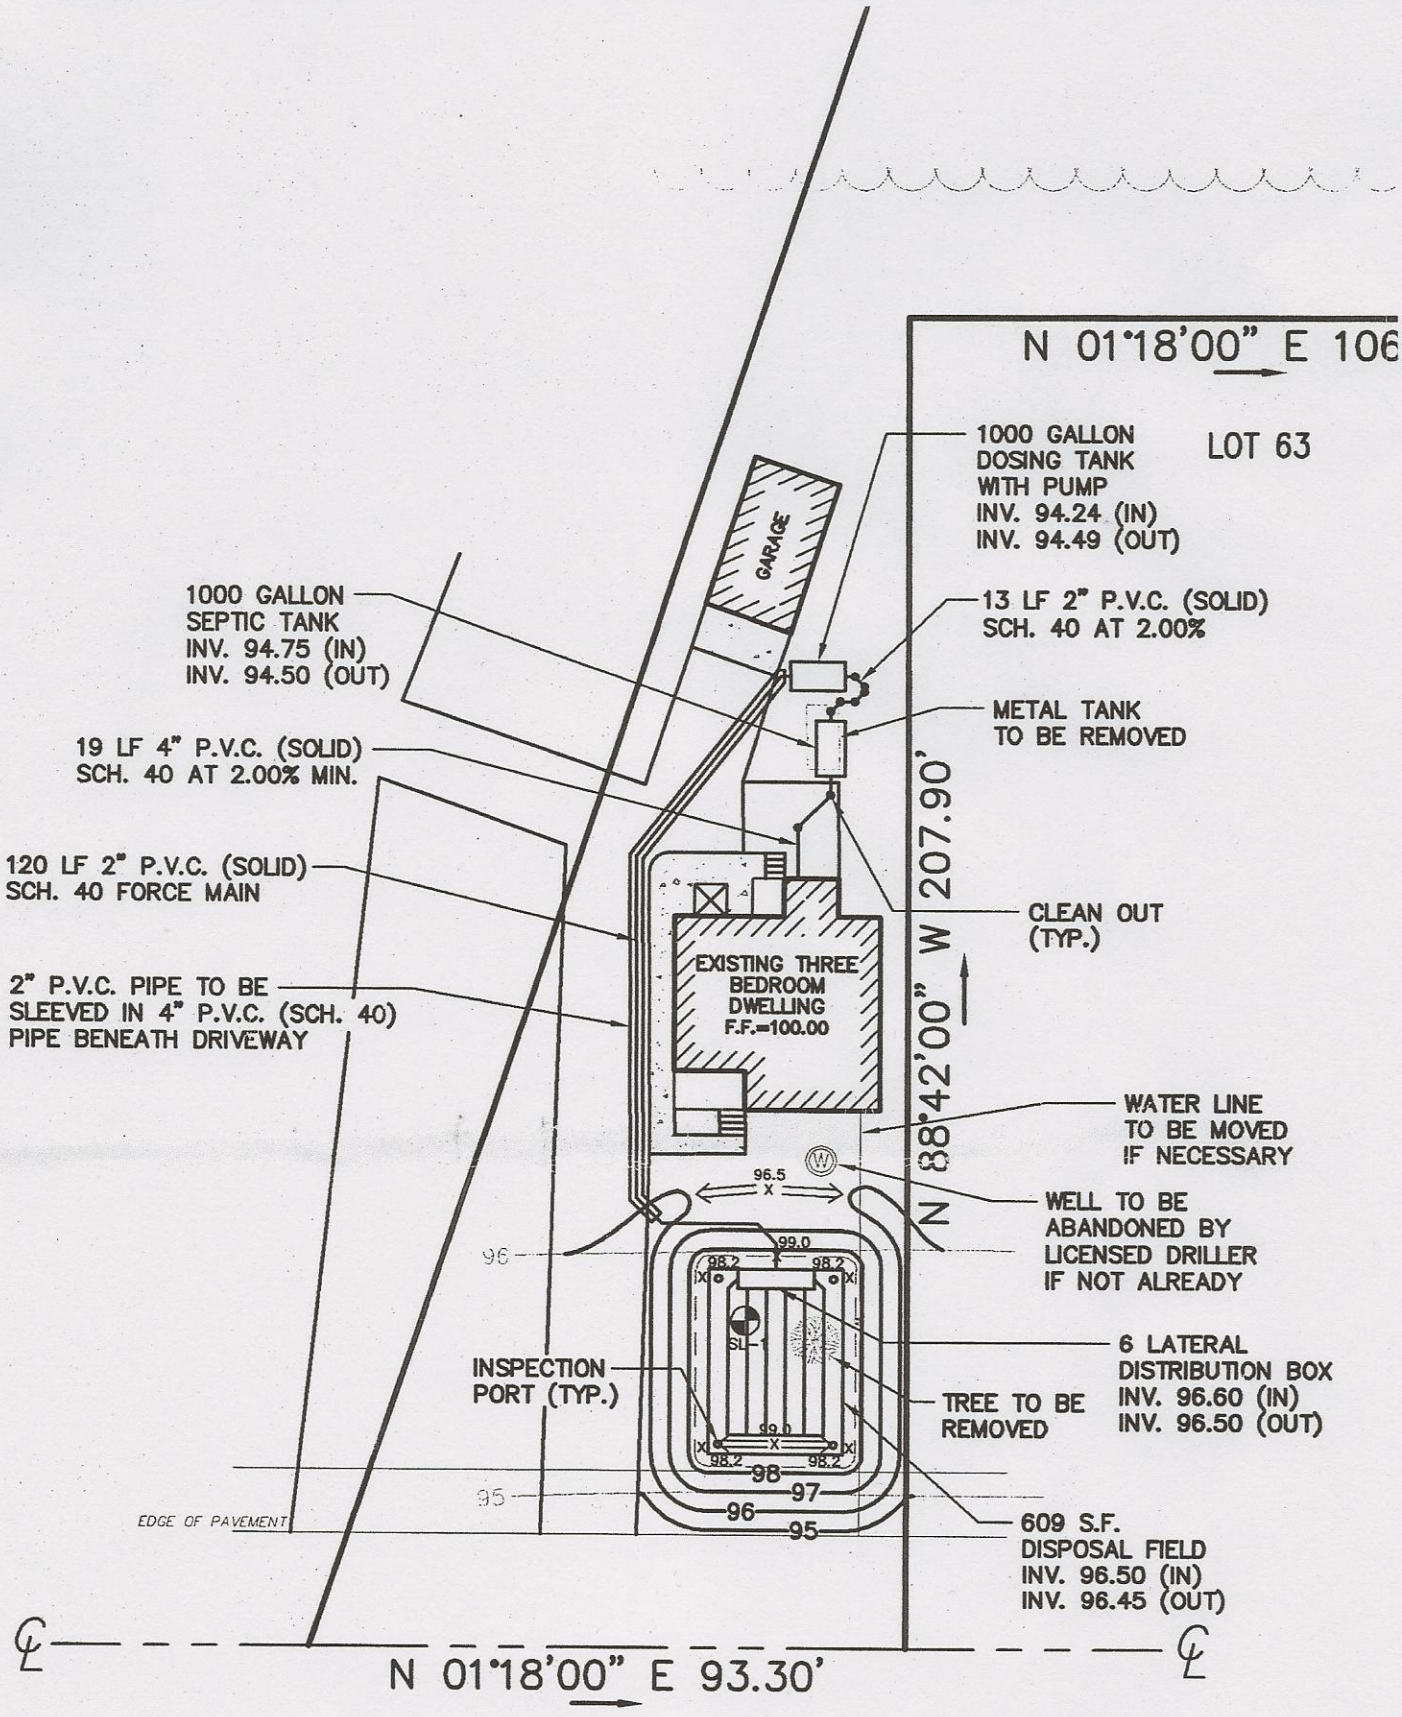
N 01°18'00" E 106
LOT 63
1000 GALLON DOSING TANK WITH PUMP INV. 94.24 (IN) INV. 94.49 (OUT)
GARAGE
1000 GALLON SEPTIC TANK INV. 94.75 (IN) INV. 94.50 (OUT)
13 LF 2" P.V.C. (SOLID) SCH. 40 AT 2.00%
METAL TANK TO BE REMOVED
19 LF 4" P.V.C. (SOLID) SCH. 40 AT 2.00% MIN.
120 LF 2" P.V.C. (SOLID) SCH. 40 FORCE MAIN
CLEAN OUT (TYP.)
N 88°42'00" W 207.90'
EXISTING THREE BEDROOM DWELLING F.F.=100.00
2" P.V.C. PIPE TO BE SLEEVED IN 4" P.V.C. (SCH. 40) PIPE BENEATH DRIVEWAY
WATER LINE TO BE MOVED IF NECESSARY
96.5
X
WELL TO BE ABANDONED BY LICENSED DRILLER IF NOT ALREADY
96
99.0
98.2
98.2
SL-1
6 LATERAL DISTRIBUTION BOX INV. 96.60 (IN) INV. 96.50 (OUT)
INSPECTION PORT (TYP.)
TREE TO BE REMOVED
99.0
98.2
98.2
98
97
95
EDGE OF PAVEMENT
96
609 S.F. DISPOSAL FIELD INV. 96.50 (IN) INV. 96.45 (OUT)
℄
N 01°18'00" E 93.30'
℄
OLD BRIDGE–ENGLISHTOWN ROAD
(WIDTH UNKNOWN)