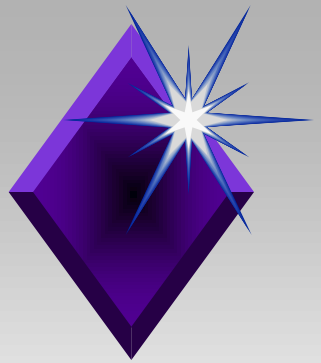

Production, Properties, and Applications of Packaged Phase-Change Materials

Joe Alderman and Dave Yarbrough

Prepared for Workshop IV
Envelopes XI, Clearwater Beach, Fl, December 5, 2010

Topics to Discuss

- Localized versus distributed PCM
- Reasons for Using PCM
- Preliminary Evaluation
- Production
- Application
- Demonstration of Effect

Localized versus Distributed

Distributed

1. Can be added to thermal insulation
2. Readily installed
3. Location affects efficiency

Localized

1. Customized for optimum efficiency
2. Independent of insulation type
3. Incorporate more than one phase-change temperature

PCM PANEL – can contain organic or inorganic phase-change compound

A Heat-Flow Meter Apparatus can Be Used to Show Phase-Change Effect (an example)

Test assembly is initially isothermal at a temperature below the phase change temperature.

One boundary is ramped quickly to a temperature above the phase change temperature.

The heat fluxes in and out of the test specimen are monitored with time.

A comparison of heat flux data for specimens with and without PCM demonstrates performance.

Example of a Test Sequence

Test assembly (R-PCM-R) is initially near-isothermal with
bottom plate 69.8 °F top plate 70 °F

Bottom plate temperature is changed rapidly to a temperature above the phase change temperature.
bottom plate 69.8 °F to 120.2 °F

Record positive flux (into specimen) on the hot side and negative flux (out of specimen) on the cold side. (CHARGING)

Bottom plate temperature is returned to initial temperature after steady state is achieved and boundary fluxes are recorded. (DISCHARGING)

This procedure can be carried out for specimens with and without PCM.

TEST ASSEMBLY

- Top Plate – cold (remains constant)
- Insulation above PCM R = 9 $ft^2 \cdot h \cdot °F/Btu$
- Layer of PCM
- Insulation below PCM R=5 $ft^2 \cdot h \cdot °F/Btu$
- Bottom Plate – cold ramps to hot (rapid)

  steady state

  hot ramps to cold (rapid)

A COMPARISON OF FLUX DATA FOR ASSEMBLIES WITH AND WITHOUT PCM DEMONSTRATES PERFORMANCE

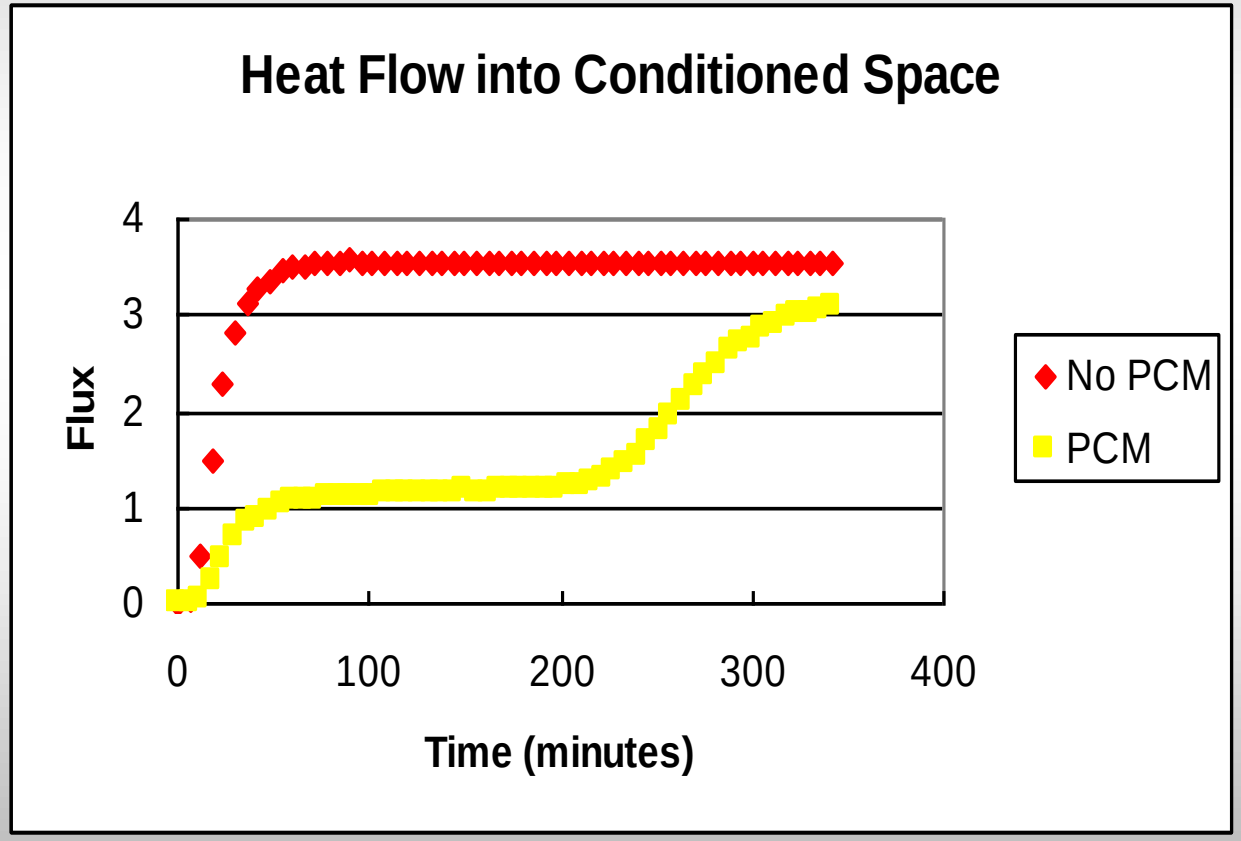

Heat Flux Data for Inorganic PCM

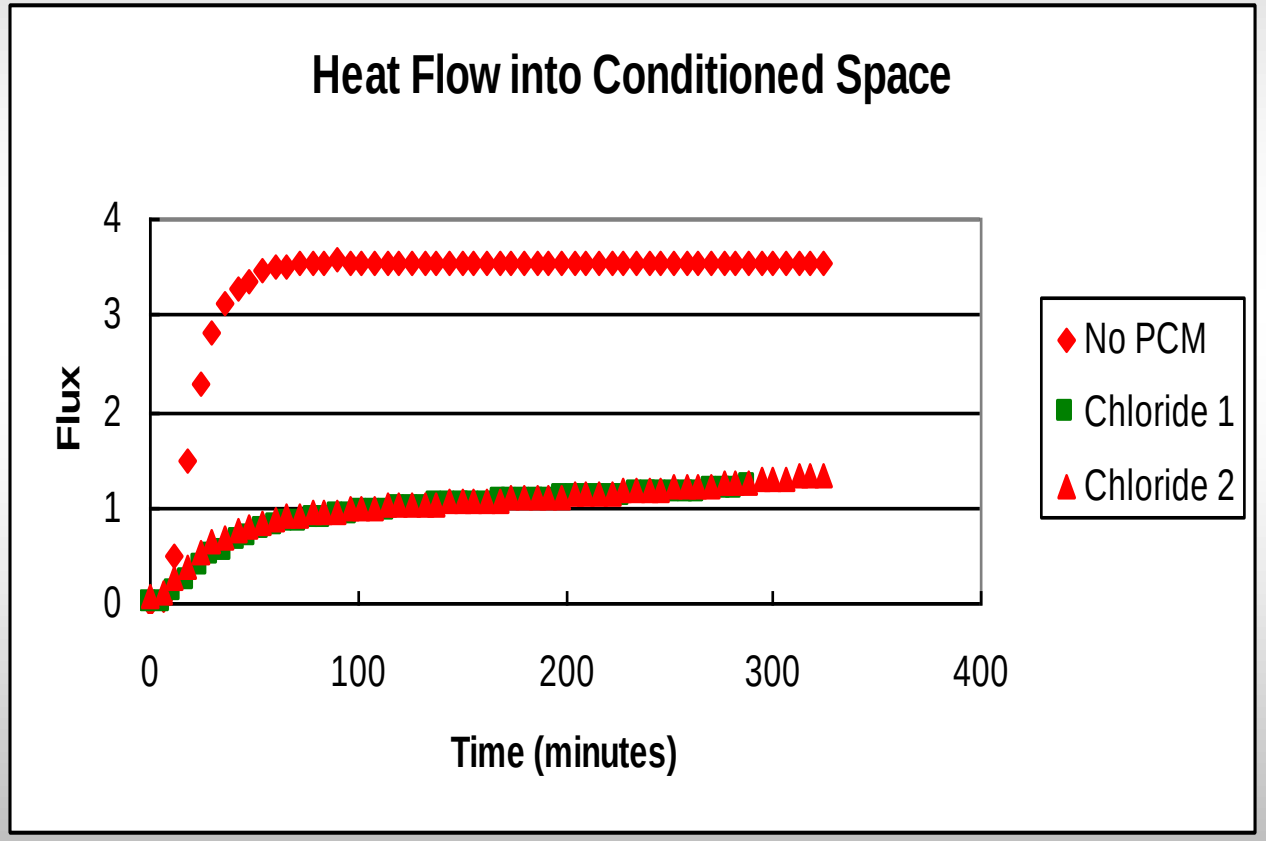

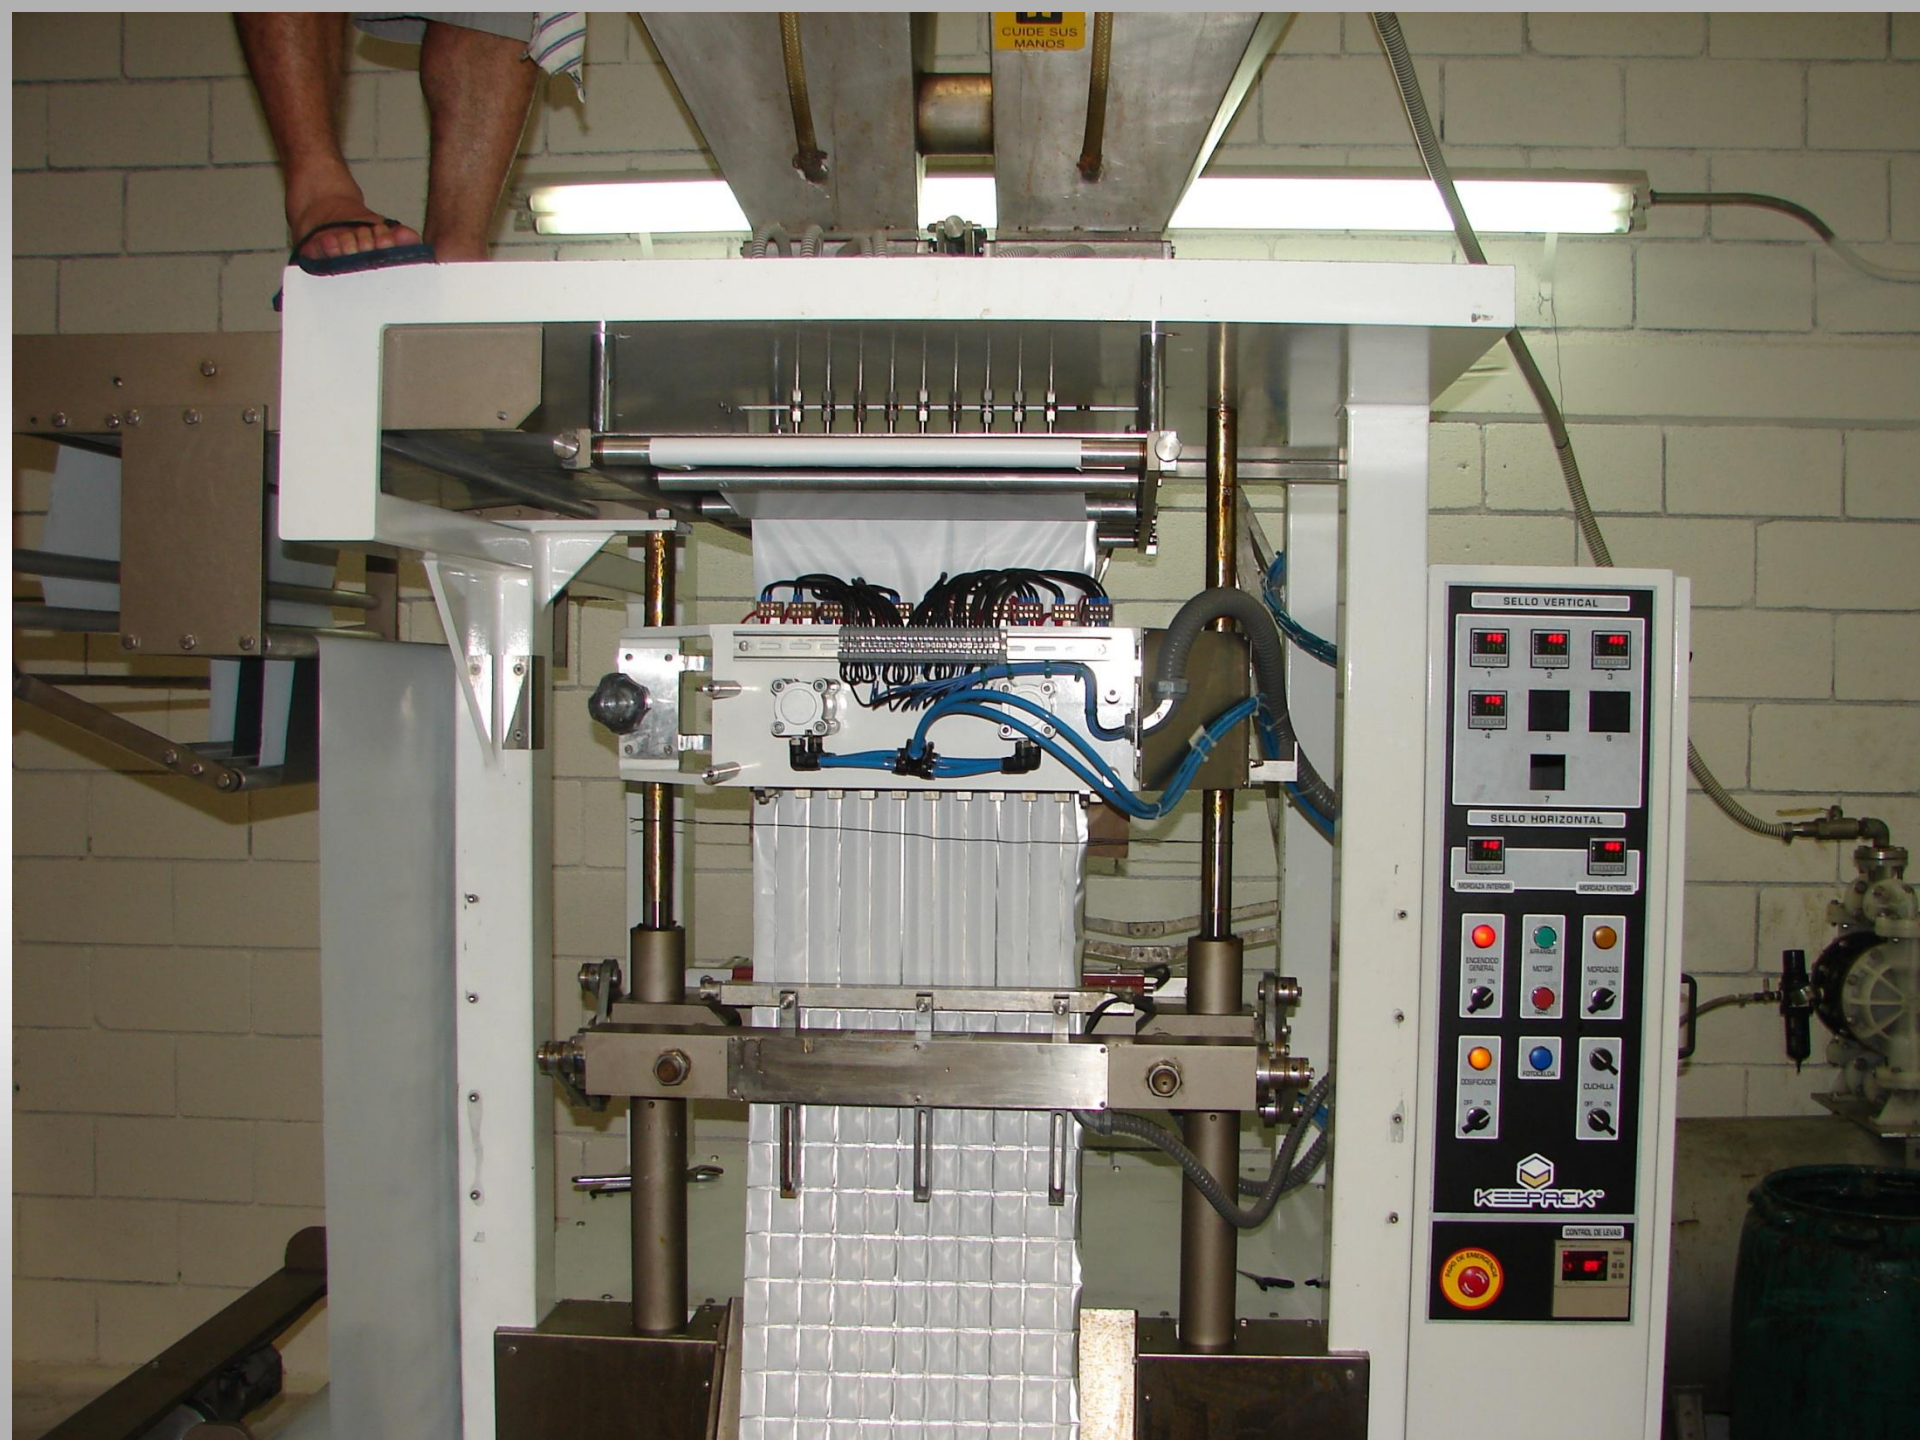
CUIDE SUS MANOS
SELLO VERTICAL
SELLO HORIZONTAL
KEEPACK

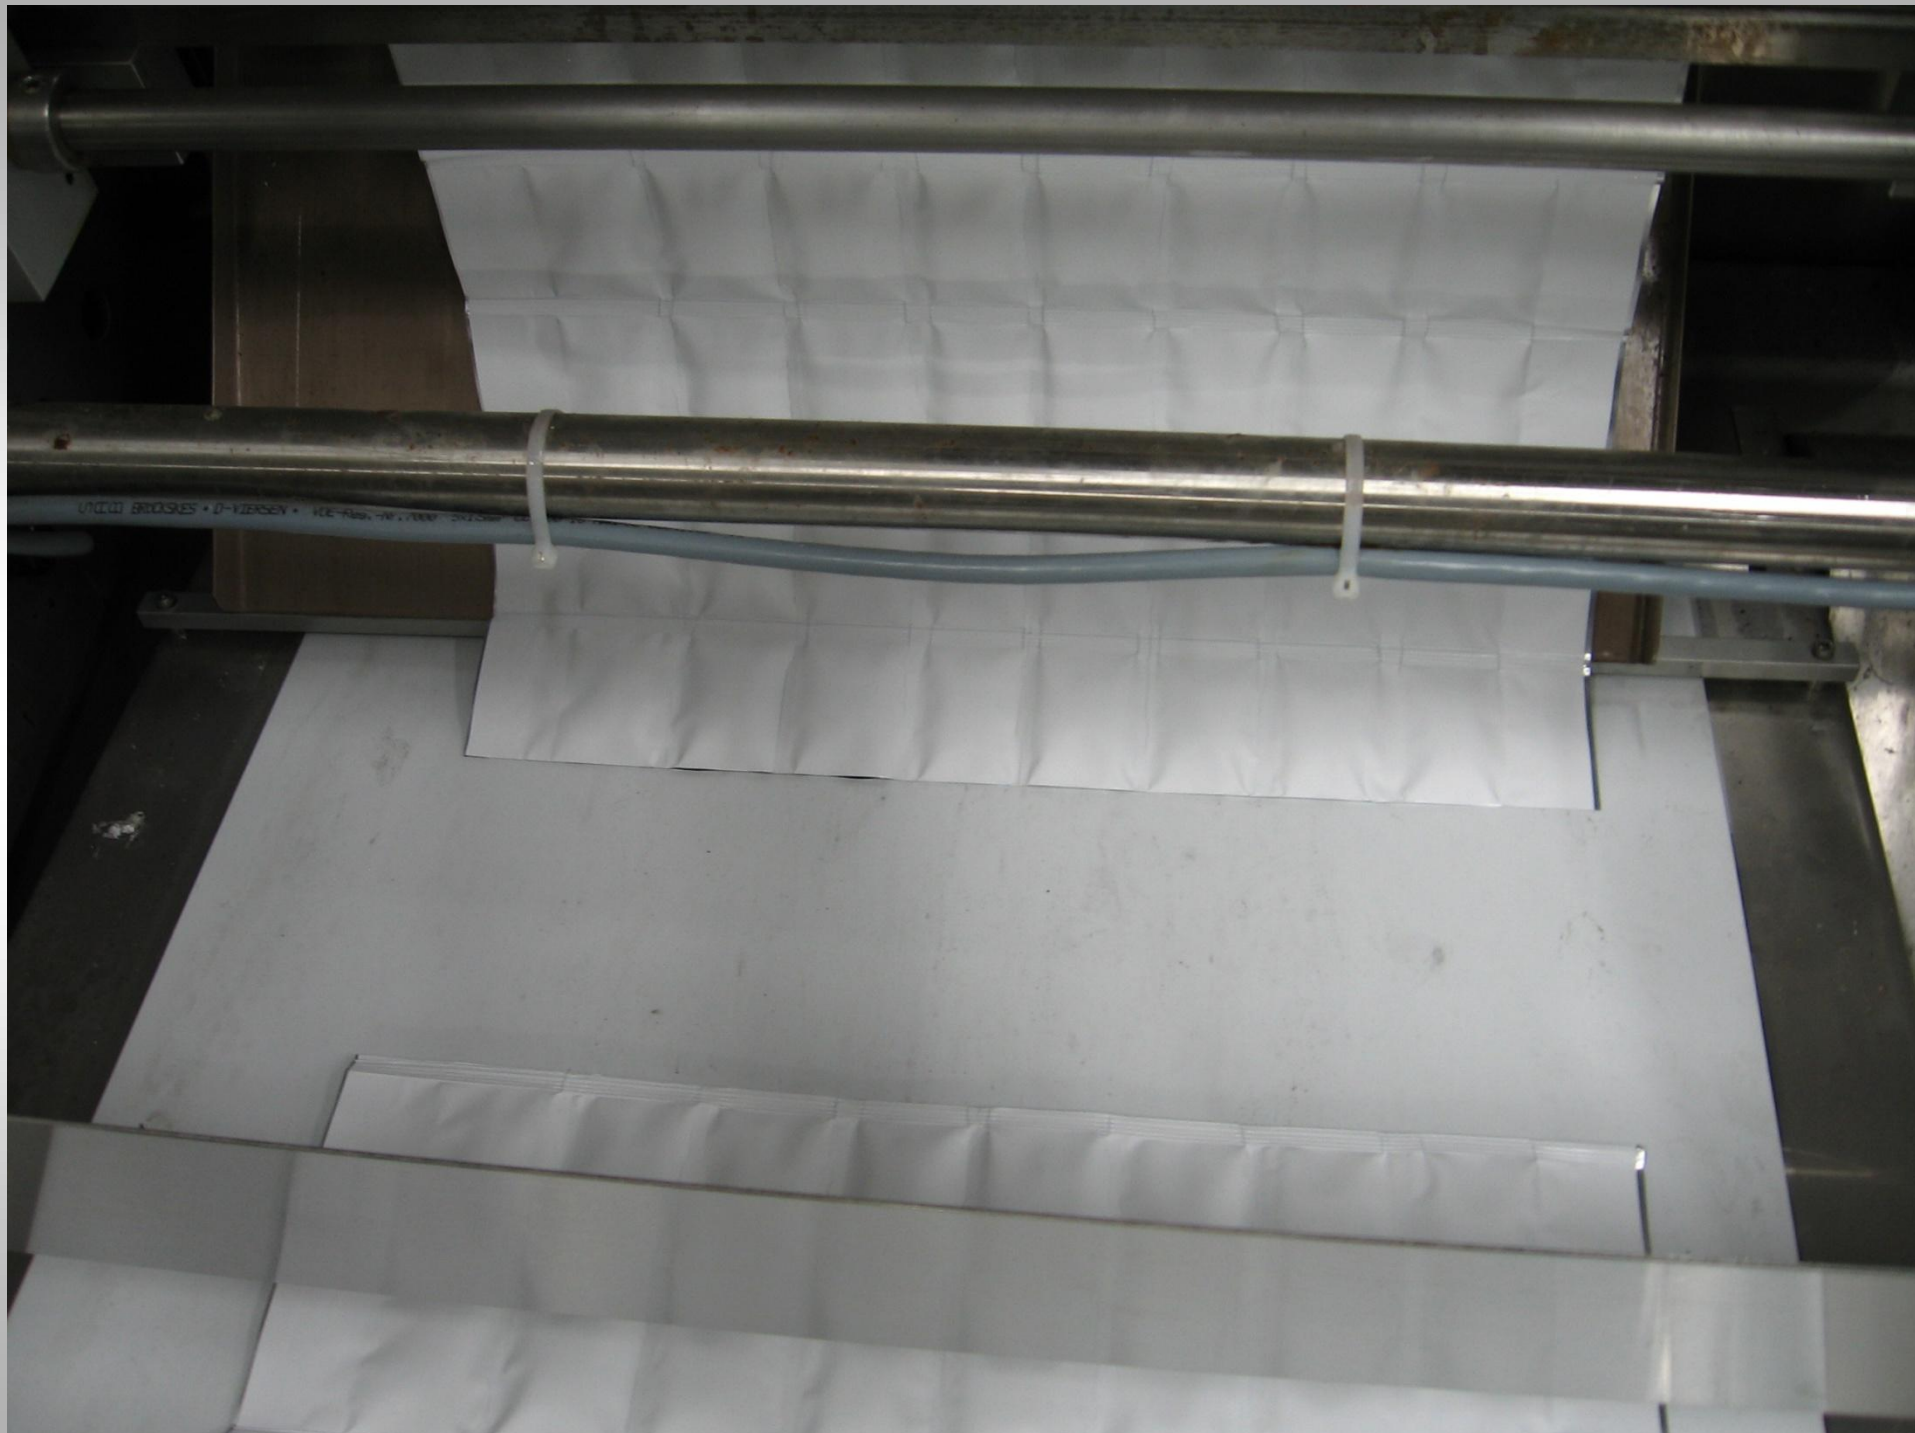

Application of PCM panel in wall when insulation is installed.

PCM in Attic Space can reduce heat flow to near zero during active period.

PCM temperature change near the conditioned space set temperature.

Saving during period that PCM is absorbing energy.

The discharge period must be analyzed to determine actual savings.

Demonstration Implemented with a Hot-Box Type Apparatus

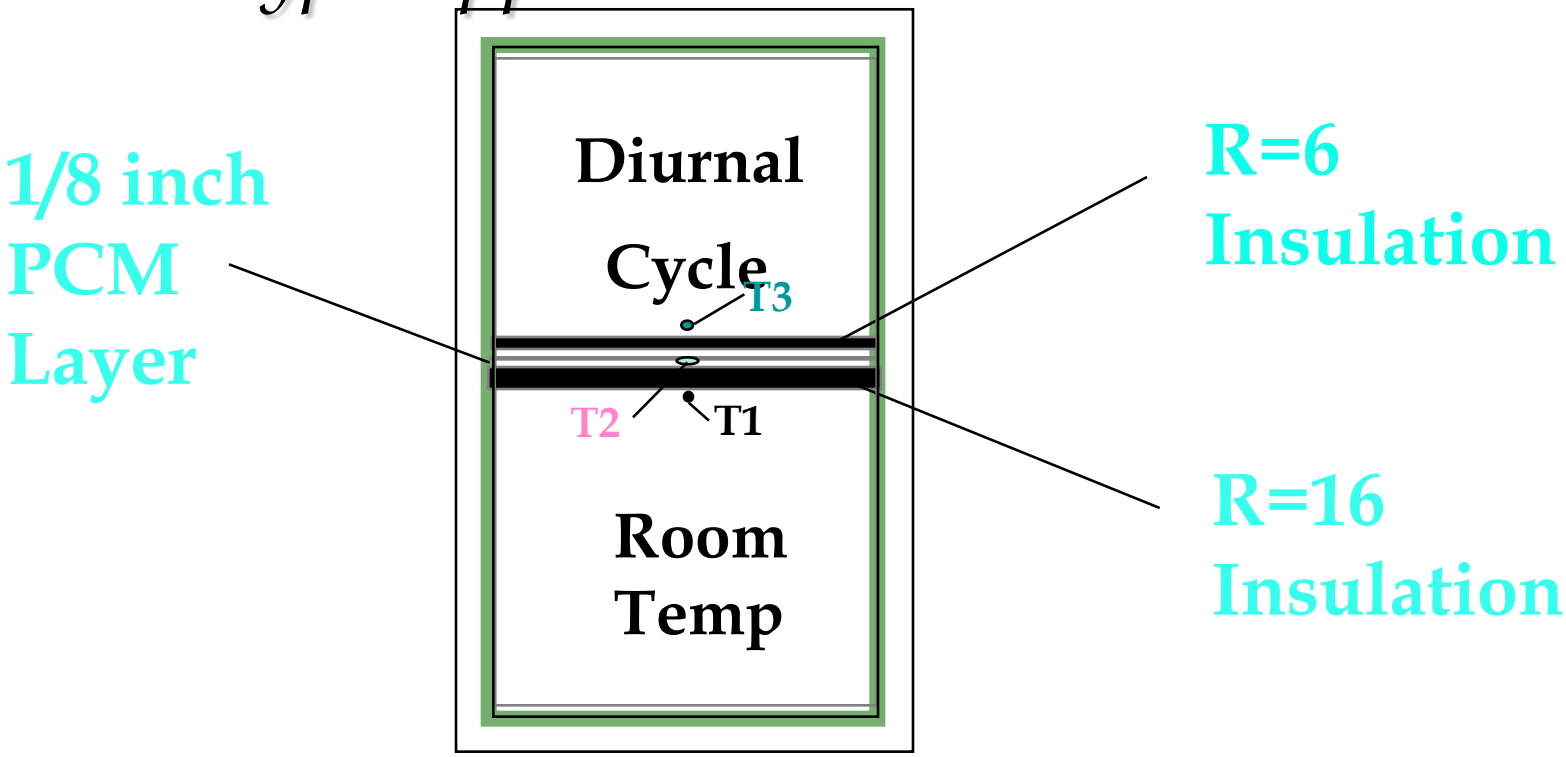

Temperatures show presence of PCM in finished wall

		Heating	161.8	Cooling=	57.5	Heat Saved	Cool Saved		59.46	(equiv R)	20	
		No PCM	No PCM	PCM	PCM	88.7%	66.4%		176.8	Upper R	5	1.681323
		Heat	Cool	Heat	Cool	btus in pcm	btus out	From HVAC Units		HF UP	2	2
		8.142	16.451	0.920	5.532	51.83	-37.44	0.92	-5.53	Lower R	15	3 inches
			Electricity used			Heat Saved	Cool Saved	Totals BTUs in and out				
		8.126	16.451	0.760	5.017	90.6%	69.5%	52.75	-42.97			
						Heat stpt.	Cool stpt.			BTUs NO PCM		BTUs w
Poteet			Adj to deduct heat flows			75	78		R=L2+L4	heat	cool	heat
		inner wall 1	PCM 8	outer wall 4	iner wal 12	middle 9	outer wall 5	14	WOPCM	122.135	-246.8	13.80667
TIME	"OF	"F"	"F"	"F"	"F"	"F"	"F"	"F"				
11/9/2010 0:59	0	79.2	79	65	79.2	68.55	65	1	68.55	0.71	0	0.013333

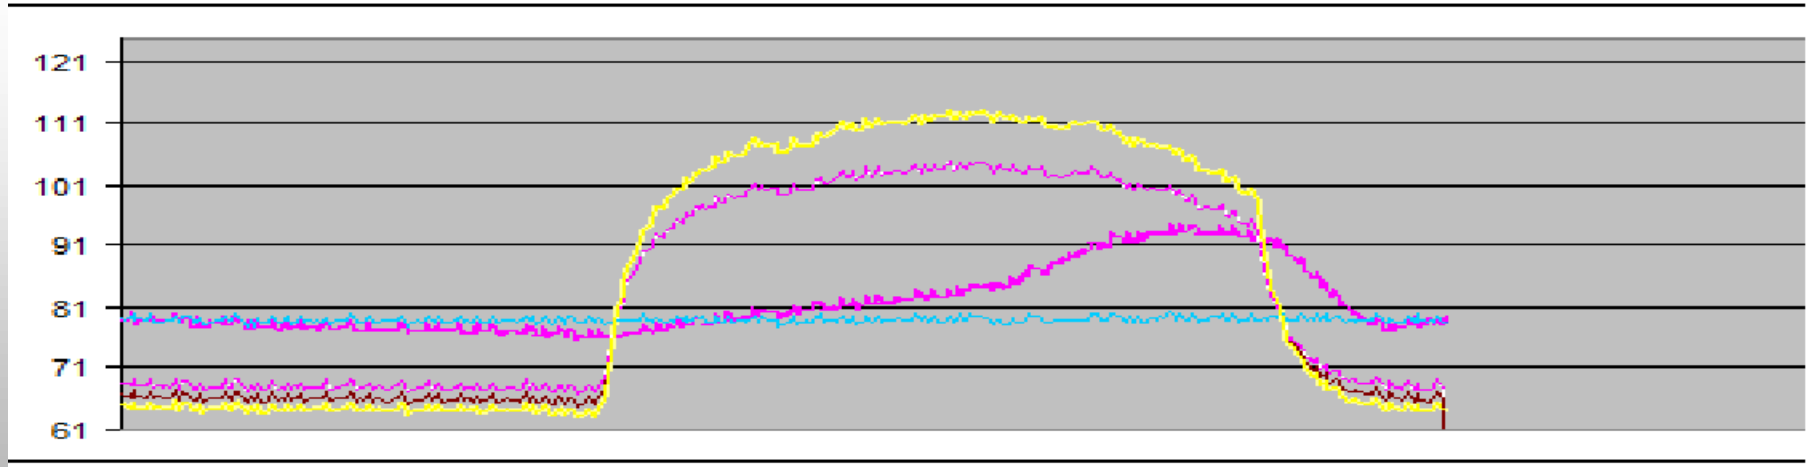

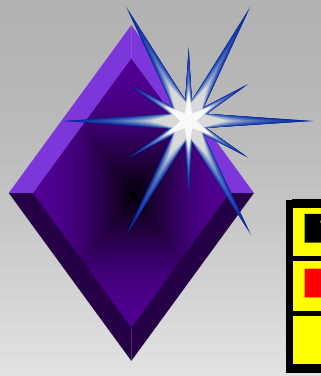

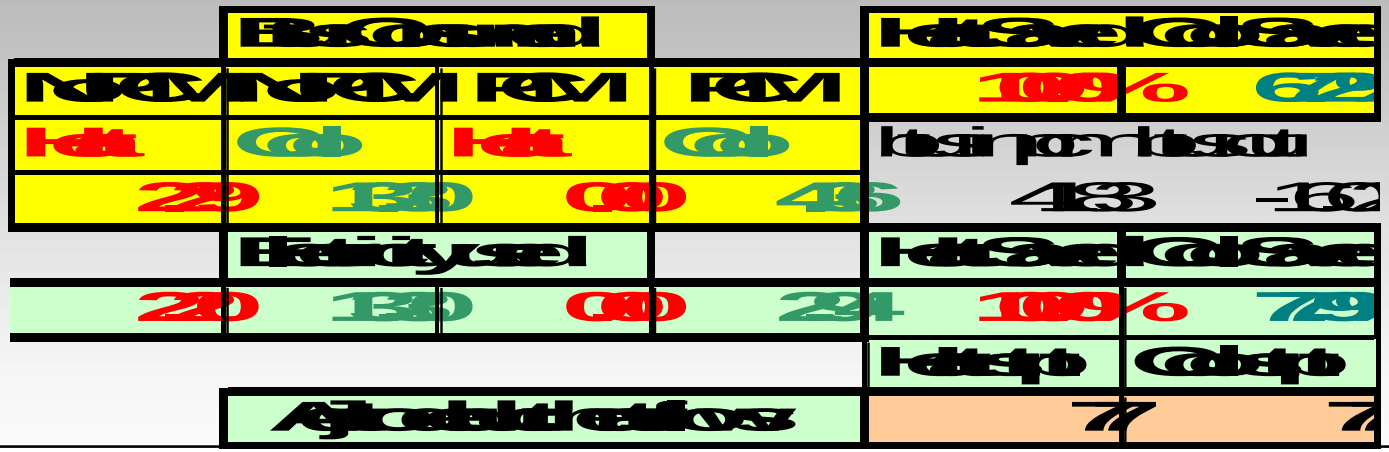

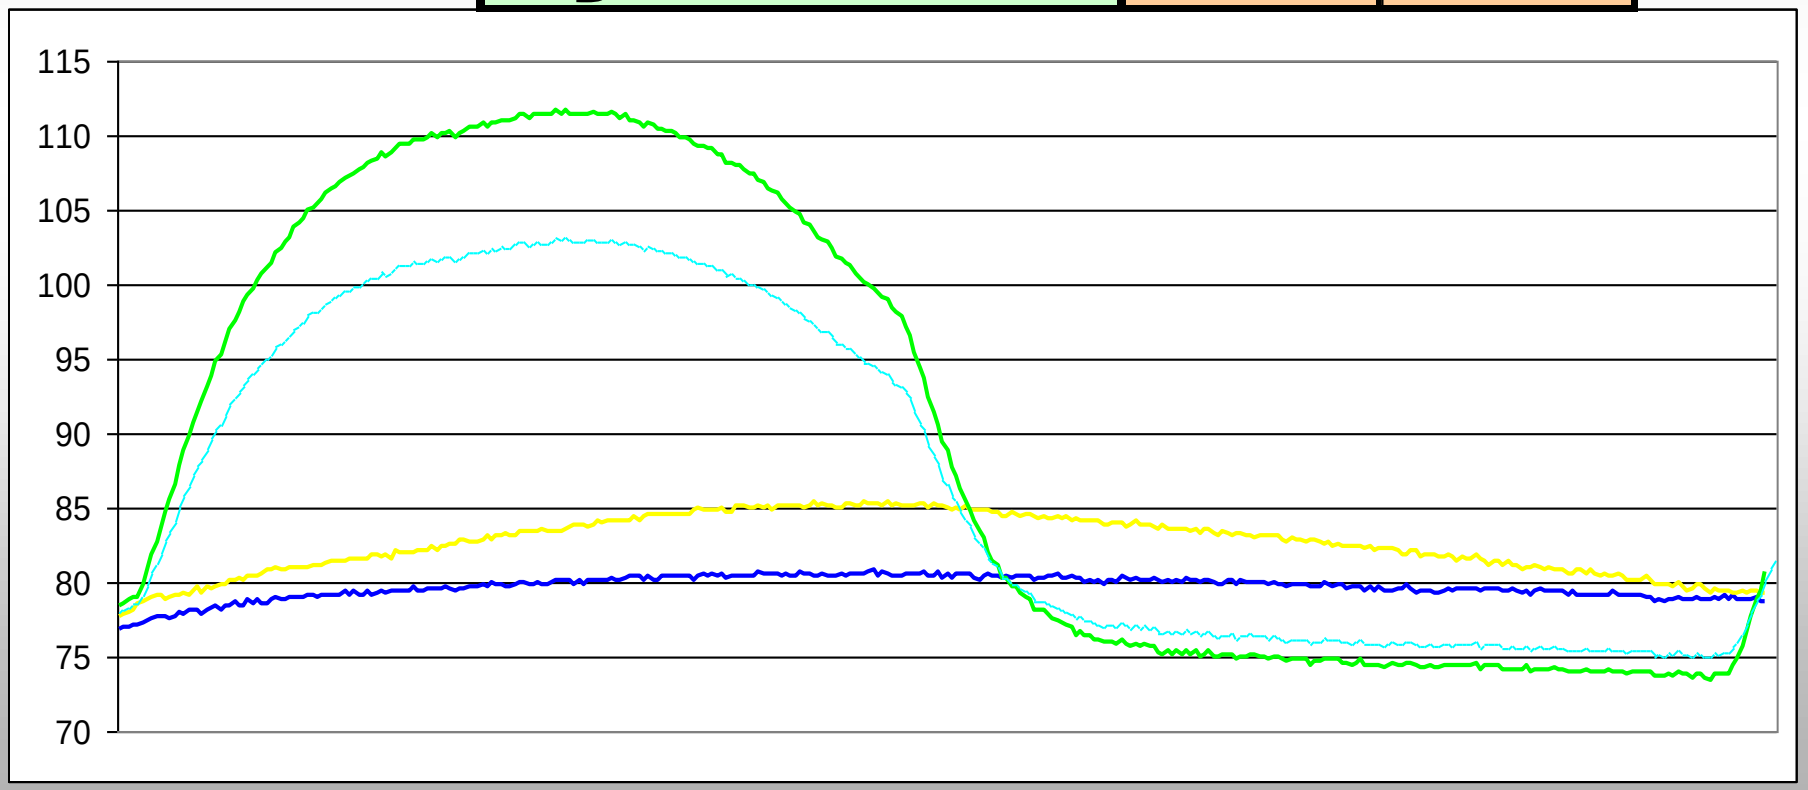
115
110
105
100
95
90
85
80
75
70

One Diurnal Cycle (24 Hrs)

0.25 lb/ft² of n-octadecane

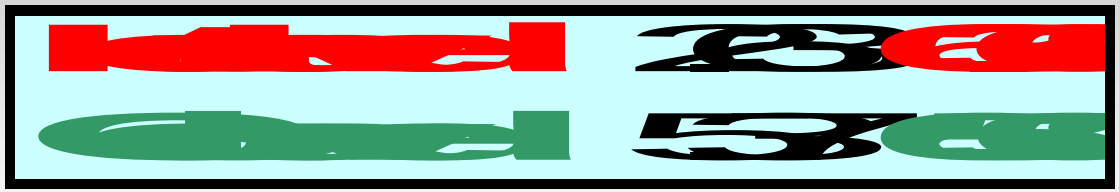

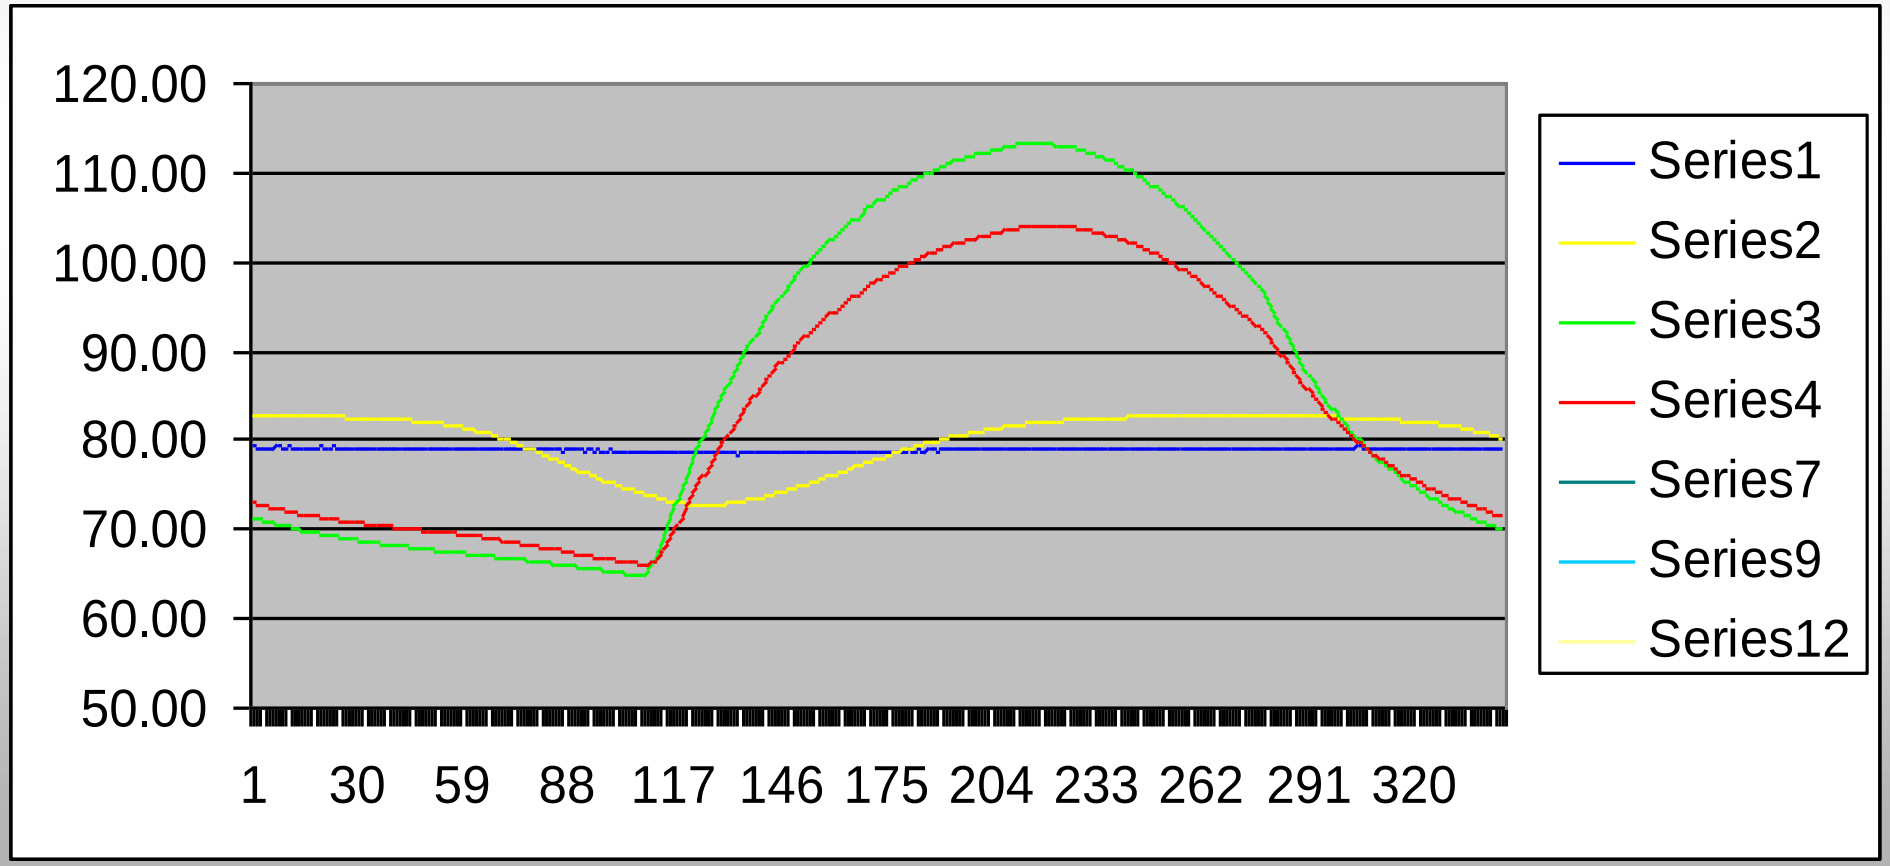

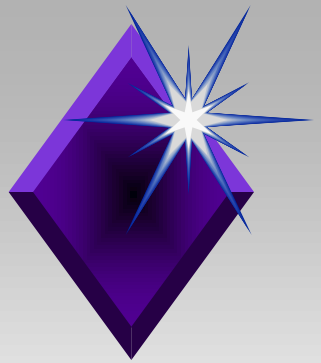

Some Power Companies Charge More for Energy at Peak Times.

Consumers can benefit by using PCM Enhanced Insulation. Delaying and spreading their energy demand over time saves them money.

Power companies benefit from reduced peak loads.

Peak Load on Power Grid is Shifted

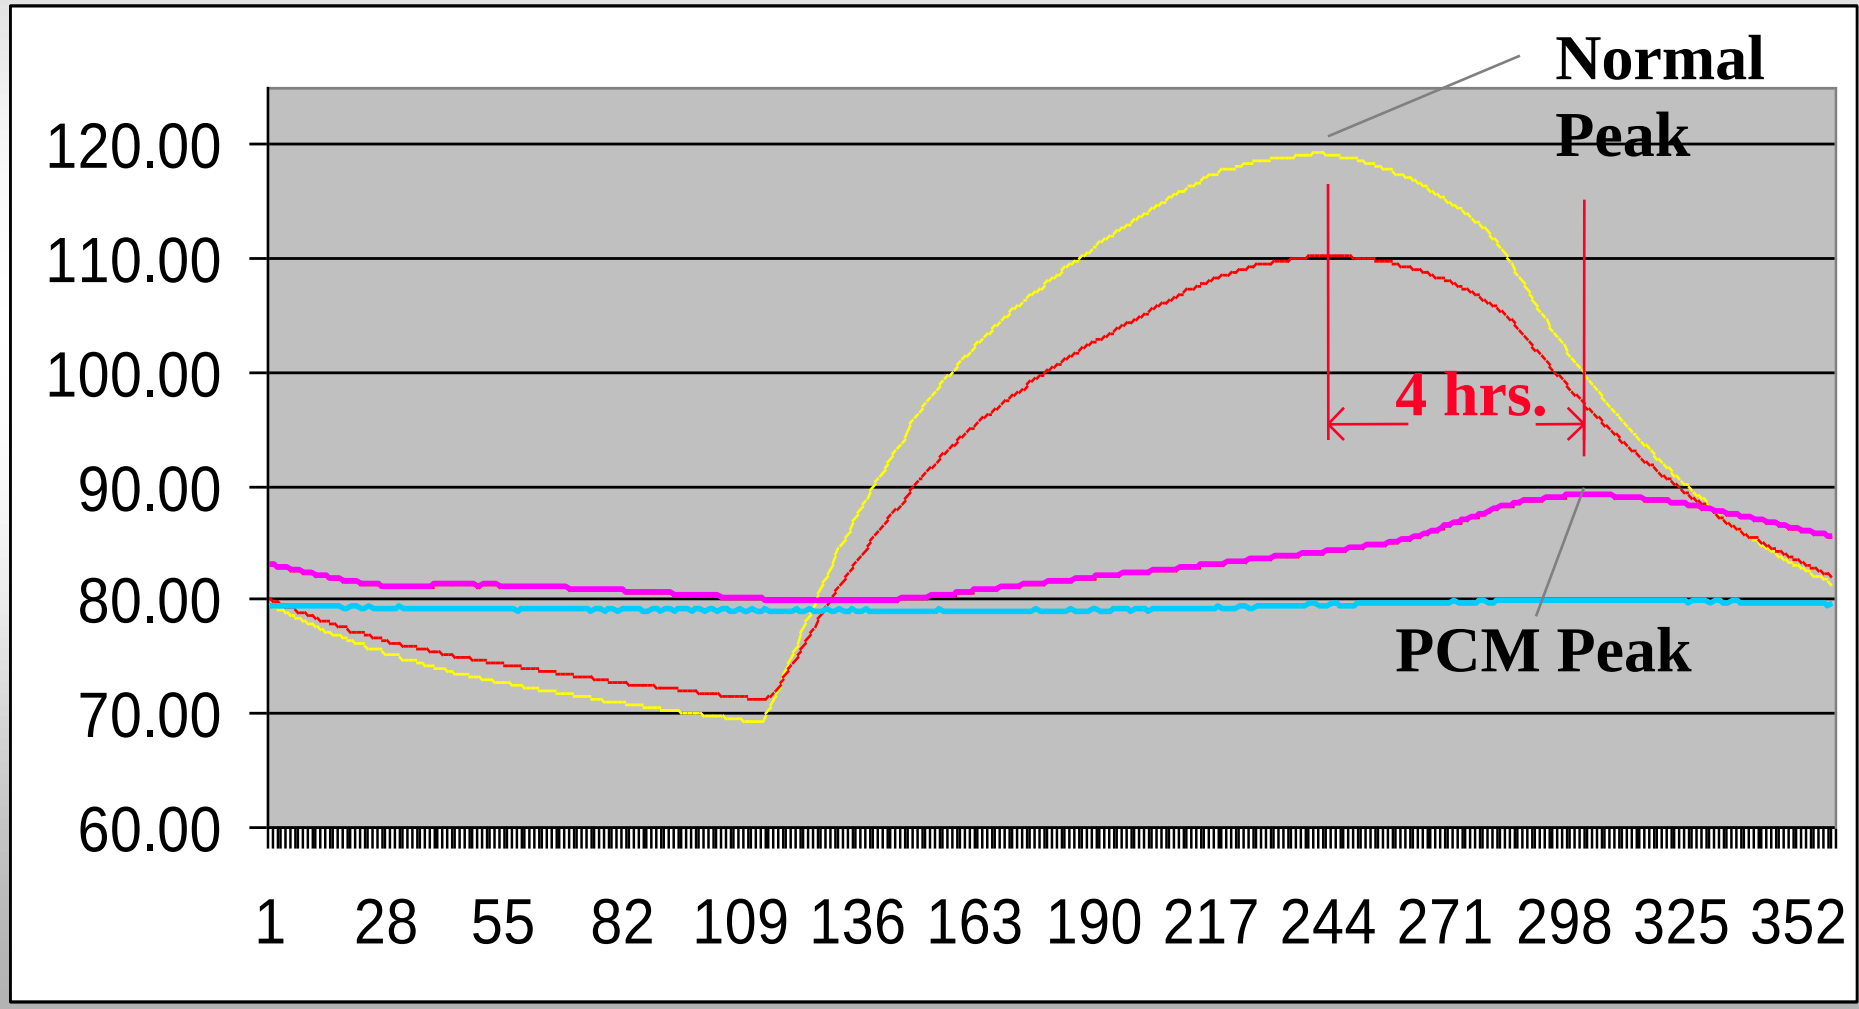

Low Space Requirements

- A 0.125 in. thick layer of PCM (0.5 lb) with thermal resistance on both sides can last for a complete diurnal cycle.

Summary

PCM panels are in production.

Laboratory data demonstrates savings potential.

Hot-box type data shows savings for complete cycles or extended time periods.

Specific applications are being studied.