


# CO<sub>2</sub> Component Description

## Pressure vs. Temperature for Carbon Dioxide Cylinders



A UTC Fire & Security Company

Effective: February 2007  
K-81-1031

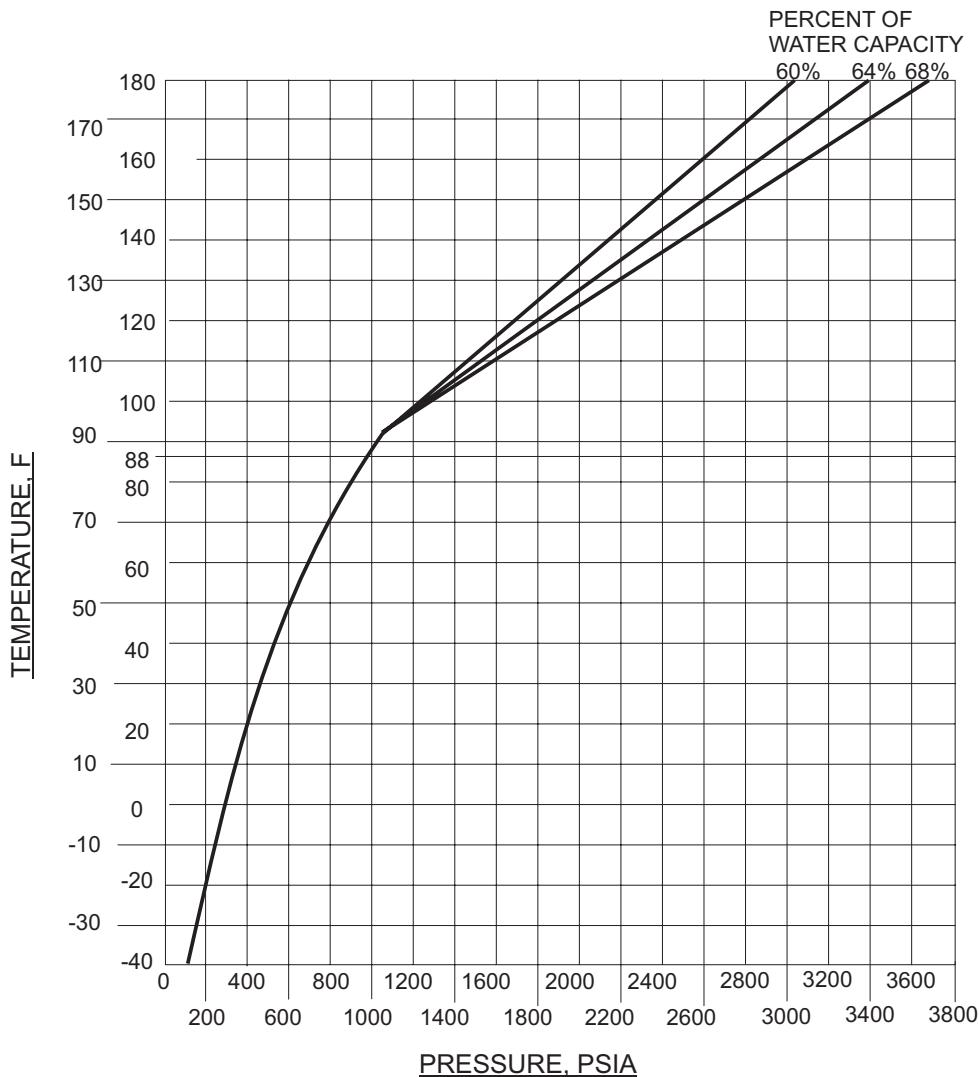

Percent of Water Capacity =

$$\frac{\text{Rated CO}_2 \text{ Capacity of Cyl. in Lb.}}{\text{Water Capacity of Cyl. in Lb. at } 60^\circ\text{F}} \times 100$$

Critical Temperature of CO<sub>2</sub> = 88°F

RATED CO <sub>2</sub> CAPACITY OF CYL. IN KG	PERCENT WATER CAPACITY
25	67
35	64
50	60
75,100	68

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.  
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)