

FM-200[®] Component Description



A UTC Fire & Security Company


Warning Nameplate (FM-200)

Effective: April 2007
K-90-9030

FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems
- See Kidde[®] Manual 90-FM200M-021 for USCG Approval

P/N: 06-231865-739

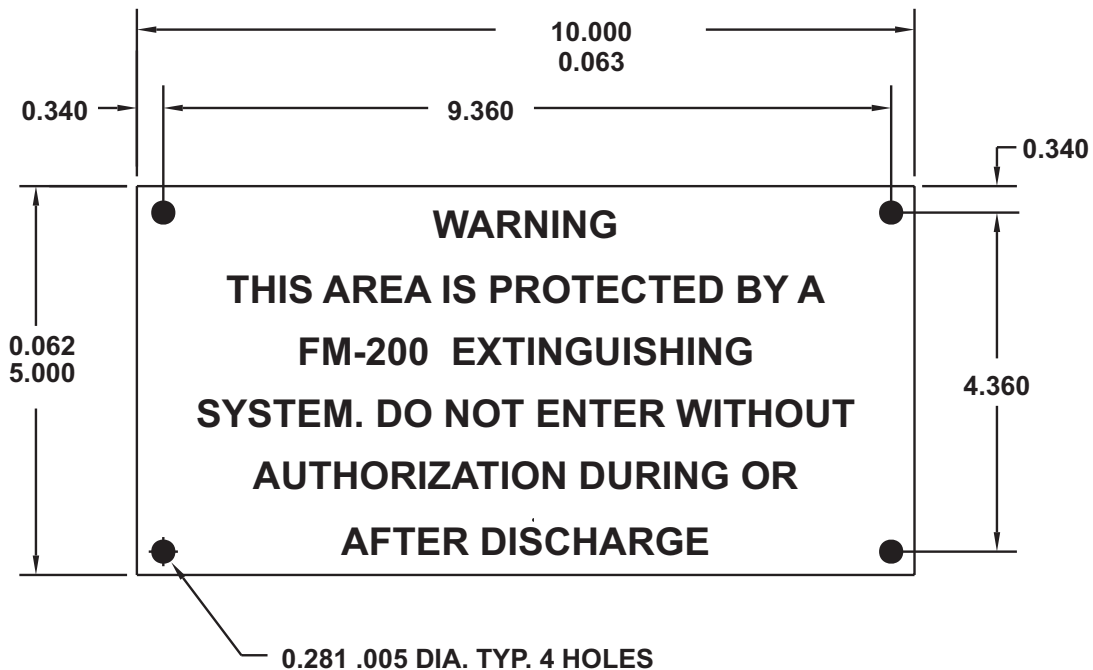

MATERIALS

- Aluminum Type 1100-H14, 0.032 ± 0.003 Thick. All Letters to be 48 pt., Alternate Gothic #2, Etched 0.003 to 0.005 and Filled in With Red Chip Proof Enamel Color No. 21105 per Fed. Stc. 595
- Finish: One Coat Clear Lacquer Both Sides

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com