PTI INTEGRATED SYSTEMS PROPRIETARY
THIS DOCUMENT AND THE INFORMATION DISCLOSED HEREIN ARE PROPRIETARY DATA OF PTI INTEGRATED SYSTEMS. NEITHER THIS DOCUMENT NOR THE INFORMATION CONTAINED HEREIN SHALL BE REPRODUCED, USED OR DISCLOSED TO OTHERS WITHOUT THE WRITTEN AUTHORIZATION OF PTI INTEGRATED SYSTEMS.

PT REV	DESCRIPTION	BY	DATE
–	RELEASED.		

PTI KEYPAD MOUNTED DIRECTLY ABOVE ELEVATOR CONTROL PANEL

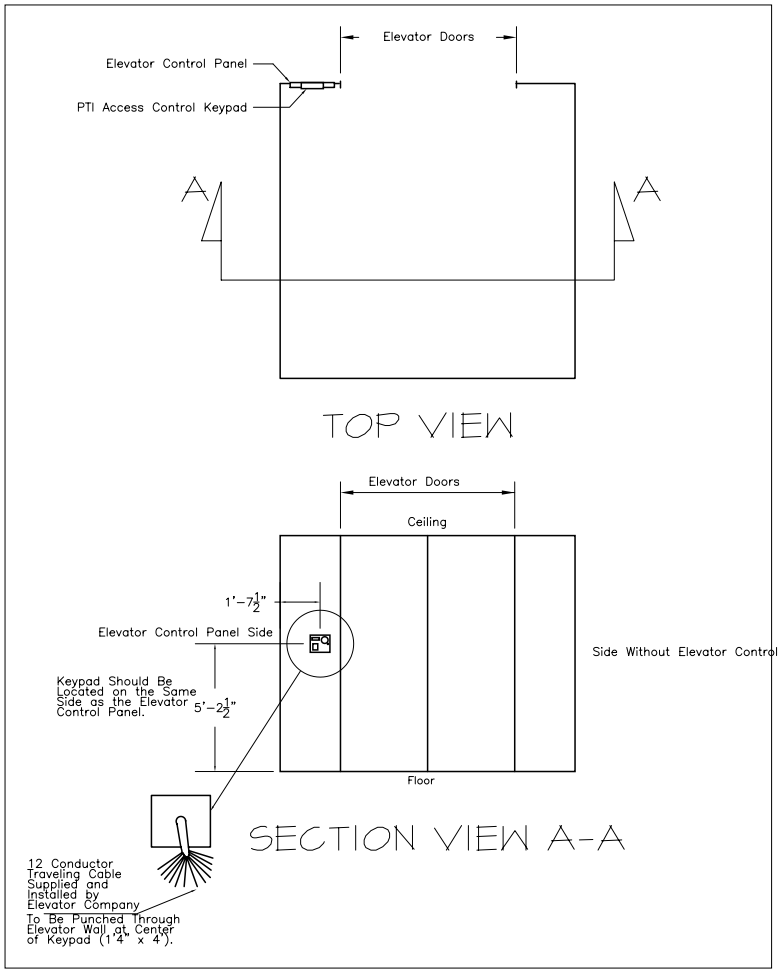

PREFERRED INSTALLATION CONFIGURATION (RECOMMENDED)

PTI KEYPAD MOUNTED ADJACENT TO ELEVATOR CONTROL PANEL

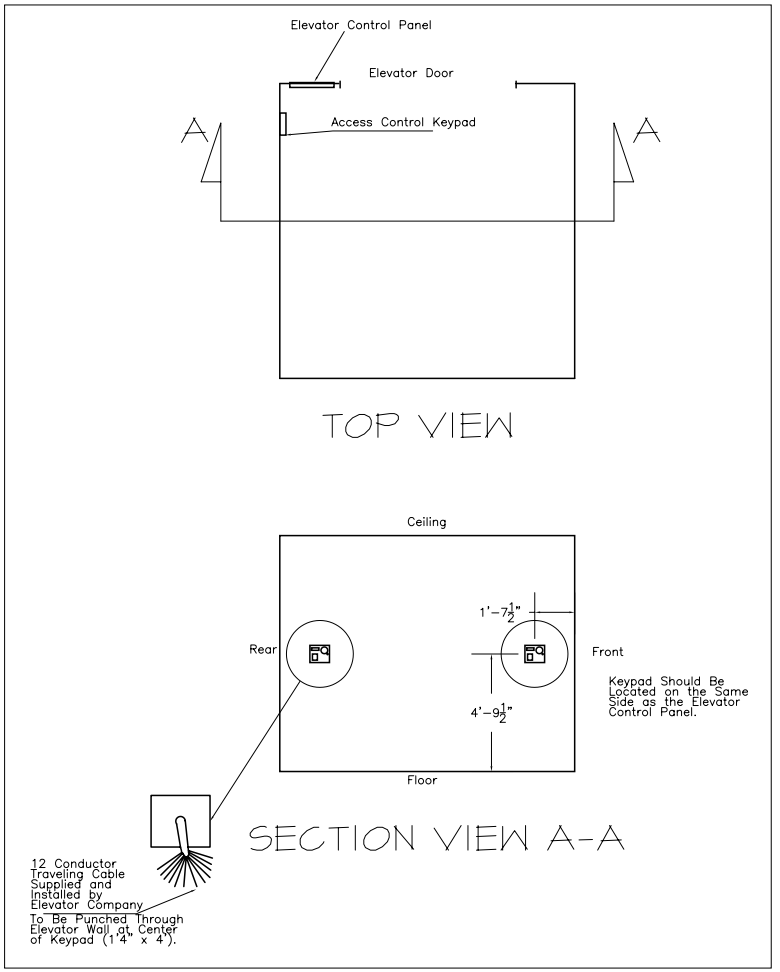

IF PREFERRED CONFIGURATION IS NOT FEASIBLE, ADJACENT MOUNTING CONFIGURATION IS ALSO ACCEPTABLE

THIRD ANGLE PROJECTION

UNLESS OTHERWISE SPECIFIED
ALL DIMENSIONS IN INCHES.
TOLERENCE: ±
ANGLE TOLERENCE (DEG): ±
REMOVE BURRS & SHARP EDGES.

PTI INTEGRATED SYSTEMS
8271 E. Gelding Drive
Scottsdale, AZ 85260
Phone 480.991.1259
FAX 480.991.1395

DRAWING DESCRIPTION: ELEVATOR CONTROLS

SIZE	SCALE	DWG NO.	DWG REV
C	1:1		–.00

ORIG. DATE | DRAWN BY | SHEET 1 OF 1