



FLOOR GRADE REINFORCED CONCRETE WITH REBARS BY INSTALLER

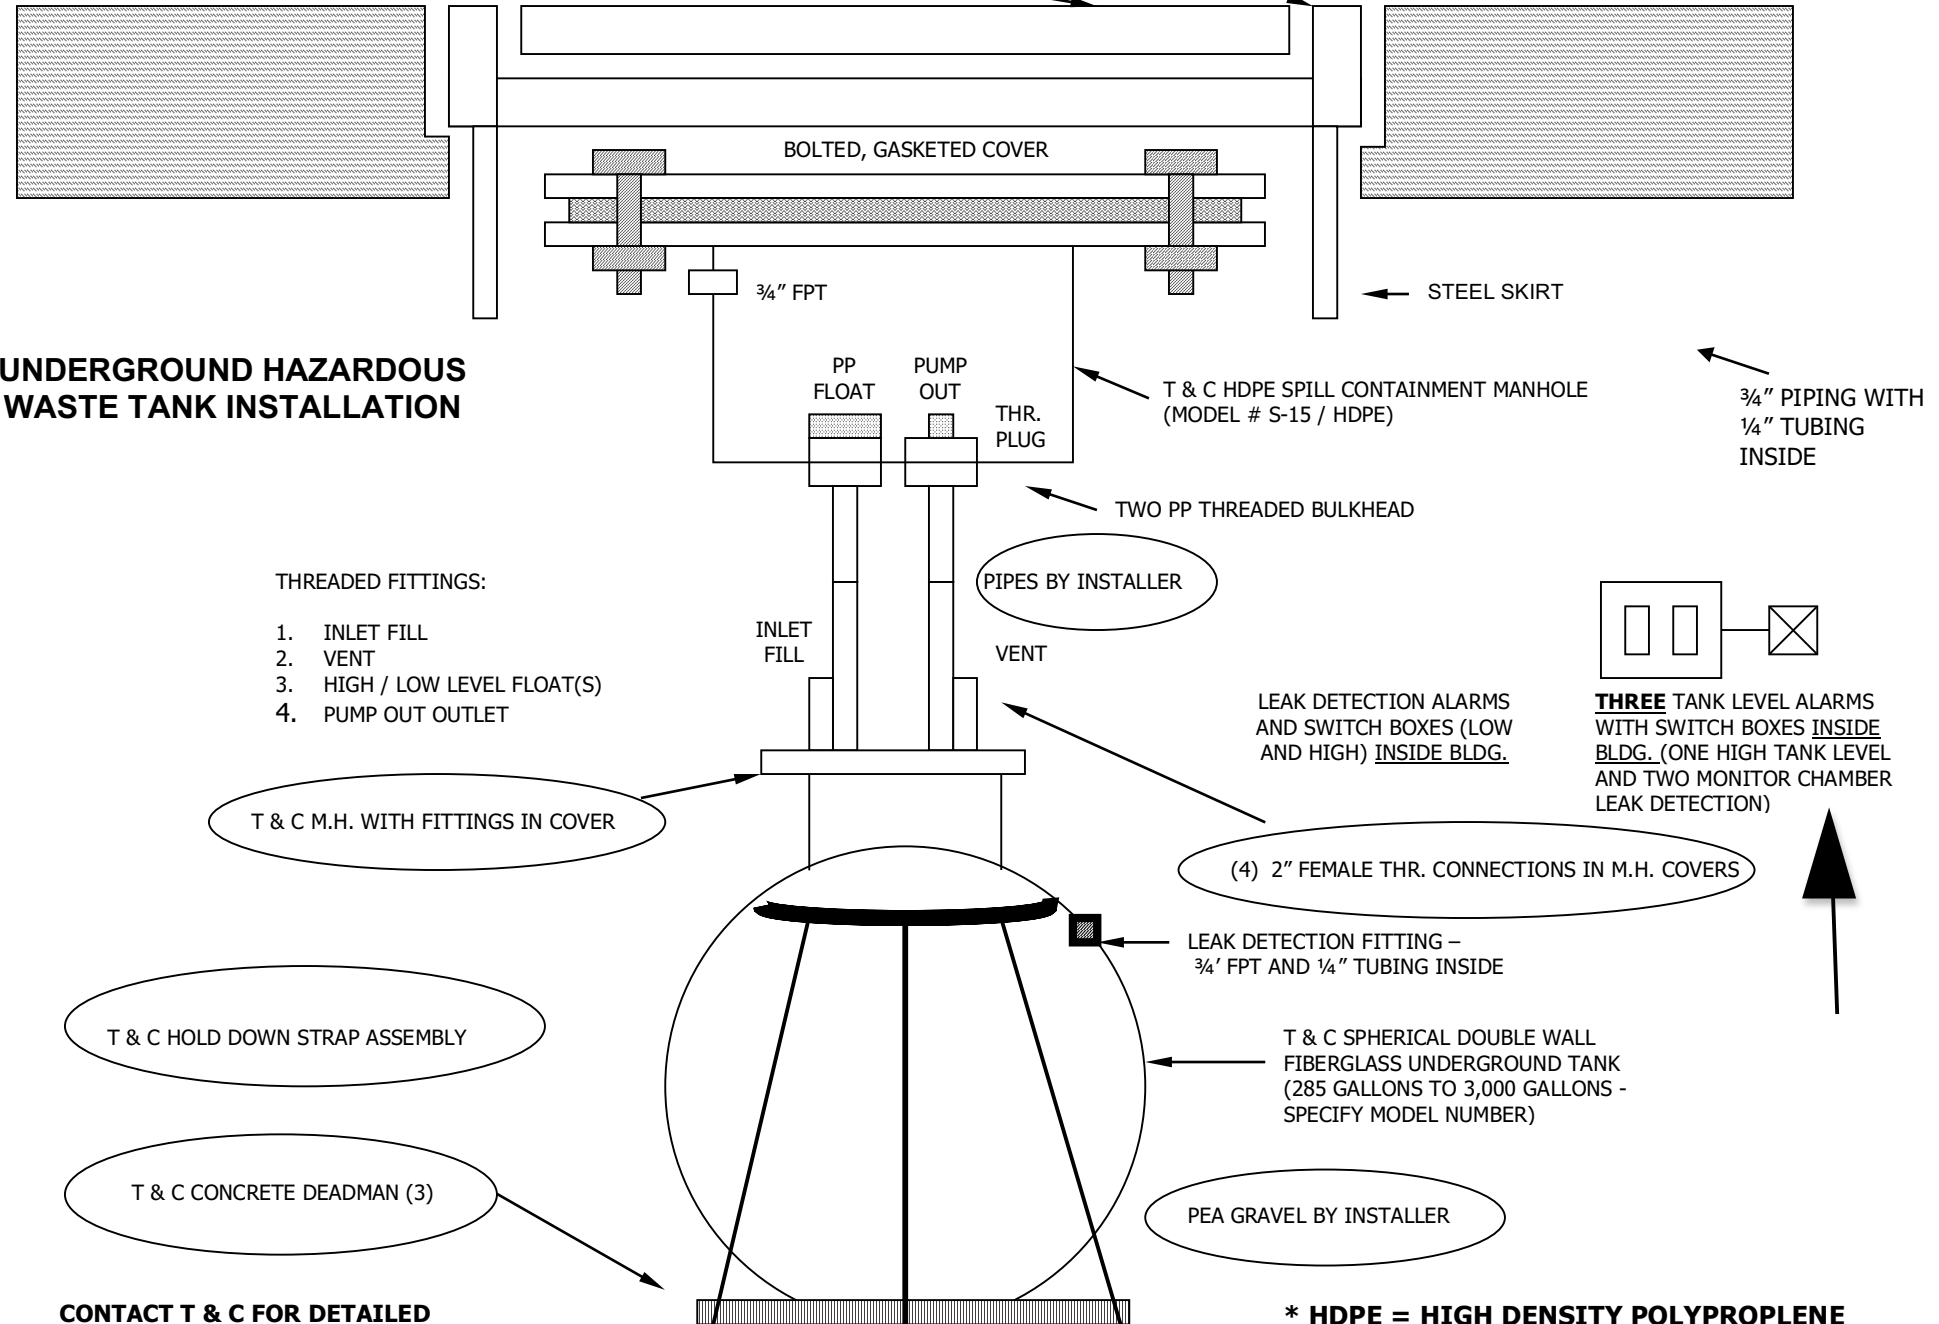

UNDERGROUND HAZARDOUS WASTE TANK INSTALLATION

THREADED FITTINGS:

1. INLET FILL
2. VENT
3. HIGH / LOW LEVEL FLOAT(S)
4. PUMP OUT OUTLET



THREE TANK LEVEL ALARMS WITH SWITCH BOXES INSIDE BLDG. (ONE HIGH TANK LEVEL AND TWO MONITOR CHAMBER LEAK DETECTION)

* HDPE = HIGH DENSITY POLYPROPLENE
* PP = POLYPROPLENE

CONTACT T & C FOR DETAILED INSTALLATION INSTRUCTION SHEETS!

SIDE VIEW