



December 11, 2014

Odorox Hydroxyl Group
Mr. Roger Sheppard
16525 Southpark Drive
Westfield, IN 46074

Dear Mr. Sheppard:

Thank you for choosing UL Environment and its ISO 17025 accredited testing laboratories for your analytical needs. Attached is the draft report, which presents the test protocols and resulting data.

We appreciate this opportunity to assist you. If you have any questions or wish to discuss your results, please feel free to contact us at (888) 485-4733.

Sincerely,

A handwritten signature in black ink, appearing to read 'W. Elliott Horner'.

W. Elliott Horner, PhD, LEED®AP
Lead Scientist

Attachment: Report: 18000-15



PROJECT SUMMARY

UL Environment is pleased to present the test results for the air cleaner identified as “Oasis + (2 Optics)” as submitted by Odorox Hydroxyl Group.

UL Environment did not select the samples, determine whether the samples were representative of production samples, witness the production of the test samples, nor were we provided with information relative to the formulation or identification of component materials used in the test samples. The test results apply only to the actual samples tested.

The Ozone sensor device used was the Thermo Electron Corporation, 49i model with the tubing inlet for the monitor at breathing height and located at least two feet from the test unit discharge.

Ozone emissions measured do not account for possible interference by other compounds. The presence of other specific compounds that have absorption peaks very close to that of ozone could contribute to the instrument signal under some circumstances. Studies with the specific compounds would be needed to confirm this.

The issuance of this report in no way implies Listing, Classification or Recognition by UL LLC and does not authorize the use of UL Listing, Classification or Recognition Marks or any other reference to UL LLC on the product or system. UL Environment authorizes the above named company to reproduce this Report provided it is reproduced in its entirety. The name, Brand or Marks of UL LLC cannot be used in any packaging, advertising, promotion or marketing relating to the data in this report, without UL's prior written permission.

UL Environment, its employees, and agents shall not be responsible to anyone for the use or nonuse of the information contained in this report, and shall not incur any obligation or liability for damages, including consequential damages, arising out of or in connection with the use of, or inability to use, the information contained in this report.

In no event shall UL be responsible to anyone for whatever use or nonuse that is made of the information contained in this report and in no event shall UL, its employees or its agents, incur any obligation or liability for damages, including, but not limited to, consequential damages arising out of or in connection with the use, or inability to use, of the information contained in this report.

Delivery of this report will confirm that all tests on the subject product have been completed. This concludes all work associated with Project 18000 and we are therefore closing this project.

FIELD TEST REPORT FOR OZONE EMISSIONS TESTING

Ozone Concentration		(ppm)	Trend
Average	Background	0.005	Declining
	Hour Four	0.029	Steady
Maximum		0.031	

Customer: Odorox Hydroxyl Group

Sample Identification: 18000-150AA (8A)

Product Description: AIR CLEANER; Odorox Hydroxyl Generator - ODHG000977

Test Conditions:

Model:	Oasis + (2 Optics)
Fan speed:	Low
Room:	Bathroom, open
HVAC:	Off
Temperature:	23° C ± 2° C / 73° F ± 2° F
Humidity:	50% RH ± 5% RH


Test Period: 10/30/14

Test Description: The product was shipped by the customer to the Field Test Site. The product was positioned in the test room(s) under the specified test conditions and operated for a four hour test period. Ozone concentration was monitored throughout the test period.

Results: The measured ozone concentration did not reach 0.075 ppm and reached equilibrium at 0.031 ppm. The concentration through the test period is plotted in Figure 1. A photograph of the test configuration is in Appendix 1.

Ozone analysis conducted using a TEI Model 49i UV-absorbance based analyzer with a detection limit of 0.5 ppb (0.0005 ppm).

Figure 1

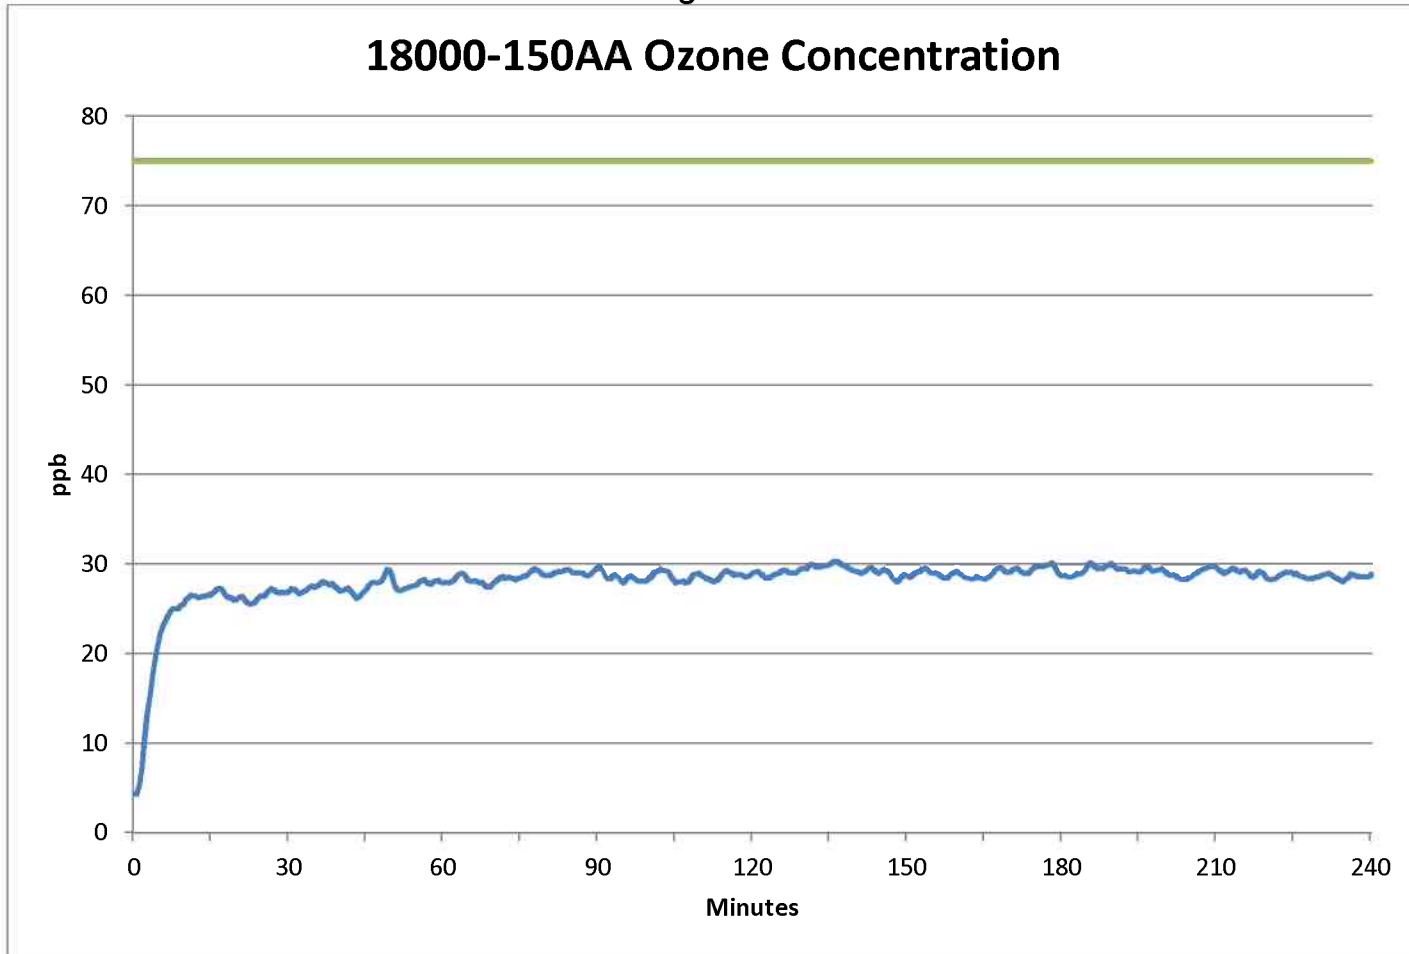

The blue line plots the ozone concentration through the test period.
The horizontal green line is placed at 75 ppb for reference purposes.

APPENDIX 1

