

# Fenwal Engineered Fire Suppression System

Effective March 2005

F-44-9044

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid

## 900 lb. Cylinder Component Sheet

# FENWAL®

P/N: 44-100900-001 and 44-100901-001

### FEATURES

- Large Capacity Novec™ 1230 Cylinder
- 3-Inch Discharge Valve
- Optional Liquid Level Indicator
- Optional Low-Pressure Switch (P/N 06-118263-001)
- FM Approved
- UL Listed
- TC Approved

### DESCRIPTION

Fenwal Engineered Fire Suppression System 900 lb. cylinders store 3M™ Novec™ 1230 Fire Protection Fluid super-pressurized with dry nitrogen to 360 PSIG at 70°F (2.48 Mpa at 21°C). The cylinders are painted red and are equipped with a 3-inch pressure differential valve, pressure gauge, optional liquid level indicator and optional low-pressure switch assembly. The pressure relief device is also located on the cylinder head.

### OPERATION

The agent storage container discharges when the actuation assembly operates, causing the pressure differential valve to open. All of the Fenwal actuators may be used to actuate the 900 lb. cylinder. The only exception is the 48650001, which is not compatible with this cylinder valve.

### INSTALLATION

The container is installed in a vertical position with the valve assembly pointing up. Interconnection to discharge piping is 3-inch NPT. Interconnection can be via a 3-inch hose (P/N 06-118225-001) or via a suitably pressure rated groove style fitting.

The container is secured in place by a mounting bracket (P/N 236125), which must be fixed to a solid wall or strut assembly. After the container is securely mounted it is connected to discharge piping per the directions in the design manual.

An optional cylinder supervisory pressure switch (P/N 06-118263-001) can be installed on the cylinder valve in the field if required. This cylinder supervisory pressure switch has a 1/8" NPT connection, which is used on the 3-inch valve only.

### ORDERING INFORMATION

The part number for ordering the Fenwal Engineered System 900 lb. cylinder without liquid level indicator is 44-100900-001. The part number for ordering the Fenwal Engineered System 900 lb. cylinder with liquid level indicator is 44-100901-001.



### MAINTENANCE

According to NFPA standards the following inspection and/or maintenance procedure must be scheduled as listed below and performed upon the occurrence of any event which might affect the reliability of the system.

#### QUARTERLY INSPECTION

1. Check the pressure gauges of each agent storage container. If the pressure gauge indicates a loss in pressure of 10% or more, then it shall be recharged or replaced. Pressure varies with temperature, and this must be taken into account when checking the pressure gauge.
2. Check all components, including supporting hardware, and tighten, repair or replace as required.
3. Replace any component if at all in doubt of its ability to perform properly.

## SEMI-ANNUAL INSPECTION

Qualified personnel should determine the amount of agent in all containers. The optional liquid level indicator may be used to measure agent supply and compare it to the original net weight which is marked on the container label. If the measured net weight is less than 95% of the original charged weight the container should be recharged or replaced.

Inspect all piping, fittings and nozzles for looseness, dirt or other damage. All outlet piping must be clean and free of dirt, chips, fillings and other foreign material that may cause the system to become inoperative or ineffective at the time of discharge.


## SPECIFICATIONS

Fill range	390-900 lb.	178-408 kg
Height	70 in.	1789 mm
Diameter	24 in.	610 mm
Internal Volume	13.0 cu. ft.	0.368 cu. m
Empty Weight	505 lb.	229 kg
Temperature Range	0°F to 130°F	-17.7°C to 54°C
Safety Relief Burst Range	800 to 975 PSIG	5.5 to 6.7 Mpa
Construction Specification	DOT 4BW-500	DOT 4BW-500

## ACCESSORIES

Part Number	Description
06-118225-001	3-inch stainless steel flexible hose
06-118058-001	3-inch swing check valve
236125	Cylinder bracket
06-118263-001	Cylinder supervisory pressure switch

## DIMENSIONS

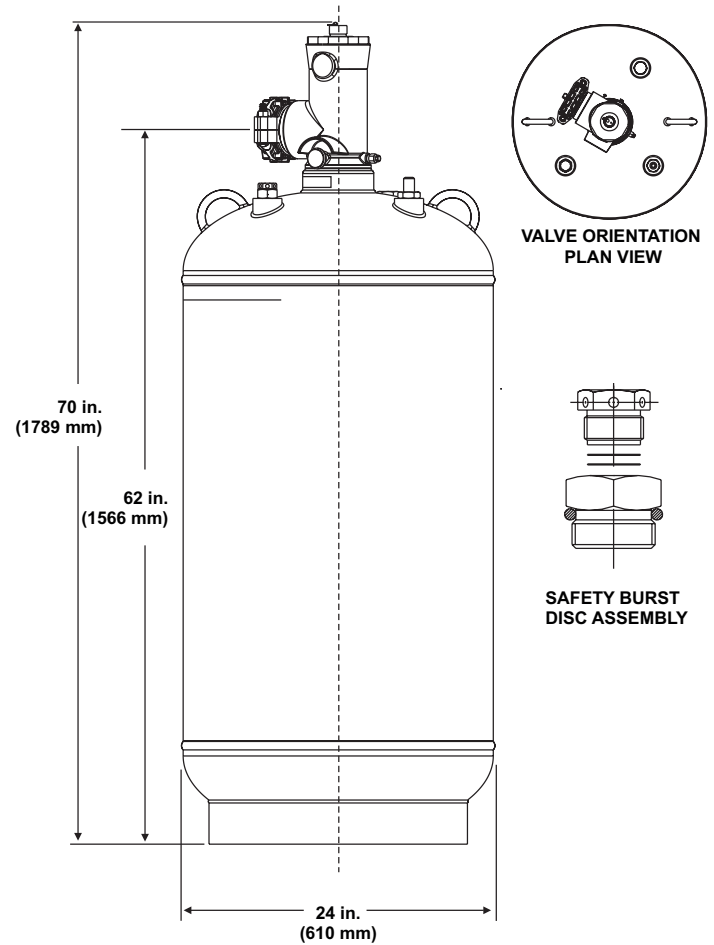

Fenwal is a registered trademark of Kidde-Fenwal, Inc.  
 3M and Novec are trademarks of 3M.  
 All other trademarks are property of their respective owners.



**FENWAL**<sup>®</sup>  
**Protection Systems**

KIDDE-FENWAL, INC.  
 400 MAIN STREET, ASHLAND, MA 01721  
 TEL: (508)881-2000 FAX: (508) 881-8920  
 www.fenwalfire.com

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to perform as described herein.  
 If you need more information on this product, or if you have a question, contact KIDDE-FENWAL, INC., Ashland, MA 01721; Telephone (508) 881-2000