

# FM-200 COMPONENT DESCRIPTION




A UTC Fire &amp; Security Company

## Flexible Discharge Hoses

**F-93-2120**

### FEATURES

- For Use with UL Listed, ULC Listed & FMRC Approved Systems

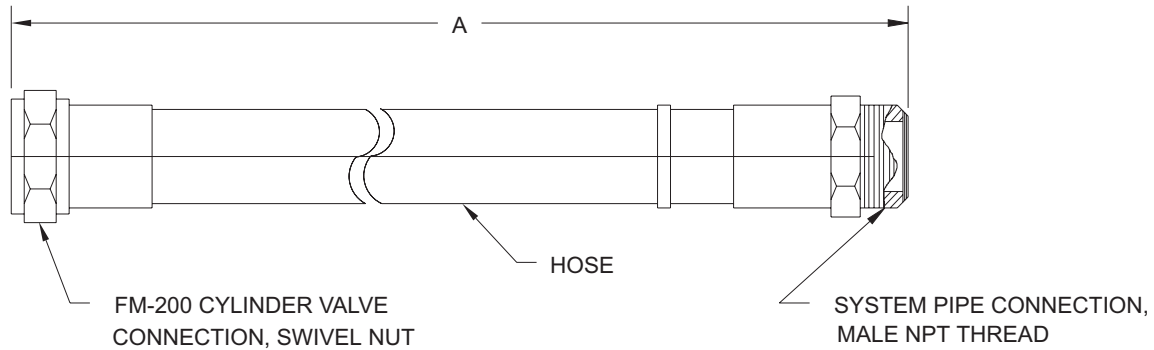

### ORDERING INFORMATION

PART NO.	MALE NPT	A	MIN. BED RADIUS
283898	1-1/2	24	10.5
283899	2	31	13.5
283900	2-1/2	48	22.5

### MATERIALS

- Hose: Reinforced Rubber Hose
- Fitting: Brass

**Minimum Bursting Pressure: 2000 PSI****Working Pressure: 500 PSI****Proof Pressure: 1000 PSI**

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Fenwal Protection Systems  
 A UTC Fire & Security Company  
 400 Main Street  
 Ashland, MA 01721  
 Ph: 508.881.2000  
 Fax: 508.881.8920  
[www.fenwalfire.com](http://www.fenwalfire.com)