


# CO<sub>2</sub> Component Description

## Cable Housing for Cable Operated Control Heads

Effective: February 2007  
**K-81-6030**

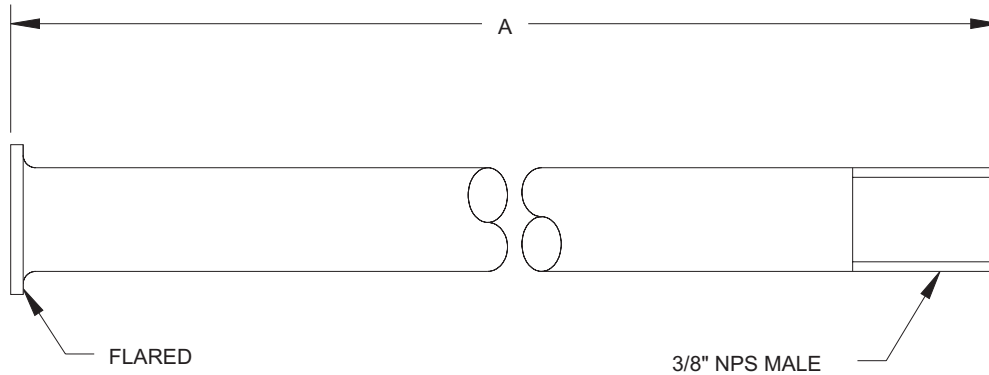

PART NUMBER	CYLINDERS USED WITH		CYLINDER CENTERS		"A" DIMENSION	
	LBS	KG	IN	mm	IN	mm
<b>INDUSTRIAL CO<sub>2</sub></b>						
202355	50-70	22.6-34.0	10.0	254	5.62	143
200822	100	45.3	11.625	295	7.12	181
<b>MARINE CO<sub>2</sub></b>						
33157	50	22.6	9.5	241	5.12	130
202355	75	34.0	10.0	254	5.62	143
200822	100	45.3	11.0	292	7.12	181
<b>FM-200</b>						
260702	125-200	56.7-90.7	15.0	381	10.6	270
260951	350	158.7	18.0	457	13.6	346
263602	600	272.1	24.0	610	19.6	498

**MATERIAL: BRASS, 625 INCHES (16 MM) O.D. x .049 INCHES (1.28 MM) WALL**

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)