

# Explosion Proof Manual Stations Model B-9



A UTC Fire & Security Company

Effective: April 2007  
K-84-09

## FEATURES

- **Class I Groups B, C, and D**
- **Class II Groups E, F, and G**
- **Class III**
- **Outdoor Rating of 4X**
- **Responsive and Reliable**
- **Strong, Functional Design**
- **Dual Action Operation**
- **Keylock for Test or Reset**
- **UL Listed**
- **Surface Mounting**

## DESCRIPTION

The Kidde® B9 series manual fire alarm station is constructed of high strength metal die-cast alloy. These stations are designed for quick, efficient response to fire emergency situations in almost all classified hazardous areas. The pull handle bar mechanism is easily operated, yet the lift and pull cover prevents accidental activation. The keylock allows the unit to be reset or tested easily. The B9 manual station provides a double pole double throw switch arrangement. The additional set of contacts are ideal for local annunciation or remote signaling. The B9 pull station may also use a glass rod as an indicator of activation.

The B9 unit is explosion and weather proof allowing the unit to offer unmatched placement flexibility. The unit is UL approved for use in Class I groups B, C, and D; Class II groups E, F, and G; Class III environments and has an outdoor rating of 4X.

## OPERATION

The dual action stations require that the lift and pull cover be opened to expose the pull handle mechanism. The pull handle is then pulled down to operate the switch contacts. The pull handle is now locked in the activated position. If a glass rod is present in the unit, it would now be broken. To reset the unit, a key must be inserted and turned 1/4 turn clockwise, opening the station. Once opened, the unit may be reset by returning the pull handle to the normal position. Replace glass rod (if applicable). Hold the unit closed and return the key to the normal position.

## HAZARDOUS AREA RATING

The B9 manual station has been approved for use in the following classified areas:

Class	Group
I	B, C, D
II	E, F, G
III	

Type 4X (Outdoor)



## LIFT AND PULL COVERS

The B9 station comes standard as a single action unit and is made into a dual action unit by incorporating a Lift and Pull cover. There are a total of five separate covers to choose from, which allow the user to tailor the manual station to the particular application. The choices are:

- **FIRE ALARM**
- **CO<sub>2</sub> RELEASE**
- **FM-200 RELEASE**
- **HALON RELEASE**
- **FIRE SYSTEM RELEASE**

The covers come complete with all necessary hardware for mounting to the base station.

## ORDERING INFORMATION


The B9 unit (P/N 84-100004-001) comes without a Lift and Pull cover, allowing the selection of the appropriately labeled cover for each application.

Part Number	Description
84-100004-001	B9 Station (without Lift and Pull cover)
84-100000-001	Lift and Pull Cover (CO <sub>2</sub> RELEASE)
84-100000-002	Lift and Pull Cover (FIRE ALARM)
84-100000-003	Lift and Pull Cover (FIRE SYSTEM RELEASE)
84-100000-004	Lift and Pull Cover (FM-200 RELEASE)
84-100000-005	Lift and Pull Cover (HALON RELEASE)
84-100005-001	Pkg. of (10) Break Glass Rods

## SPECIFICATIONS

Contact:	Double Pole, Double Throw (DPDT)
Contact rating:	10 Amp @ 125/250 Vac
Wire AWG:	12 to 22 AWG
Wiring:	Terminal block connections - (6-32 with sem plate)
Weight:	3 lb. 6 oz. (1.5 kg)

## DIMENSIONS

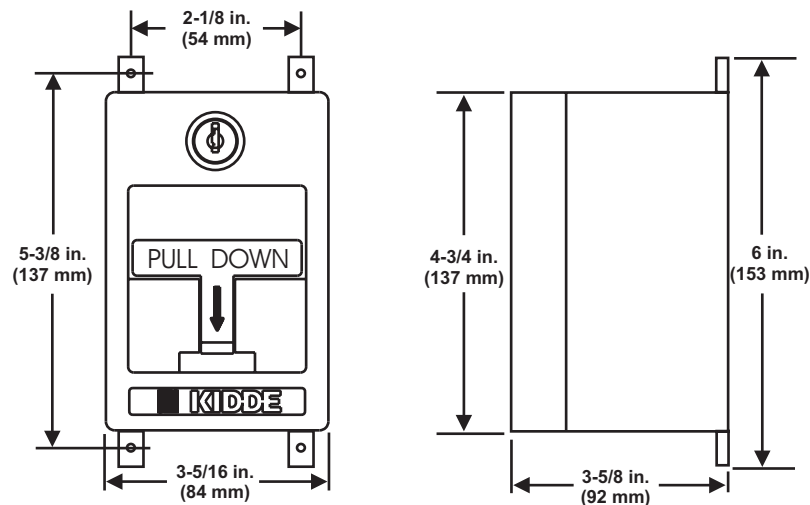

Kidde is a registered trademark of Kidde-Fenwal, Inc.  
FM-200 is a registered trademark of the Great Lakes Chemical Corporation.  
3M and Novec are trademarks of 3M.  
FE-13 is a trademark of DuPont.  
Lexan is a registered trademark of the General Electric Company.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.



A UTC Fire & Security Company

400 Main Street  
Ashland, MA 01721

Ph: 508.881.2000

Fax: 508.881.8920

[www.kiddefiresystems.com](http://www.kiddefiresystems.com)