


# CO<sub>2</sub> Component Description



## Pressure vs. Temperature for Carbon Dioxide Cylinders

Effective: April 2002

K-81-1031

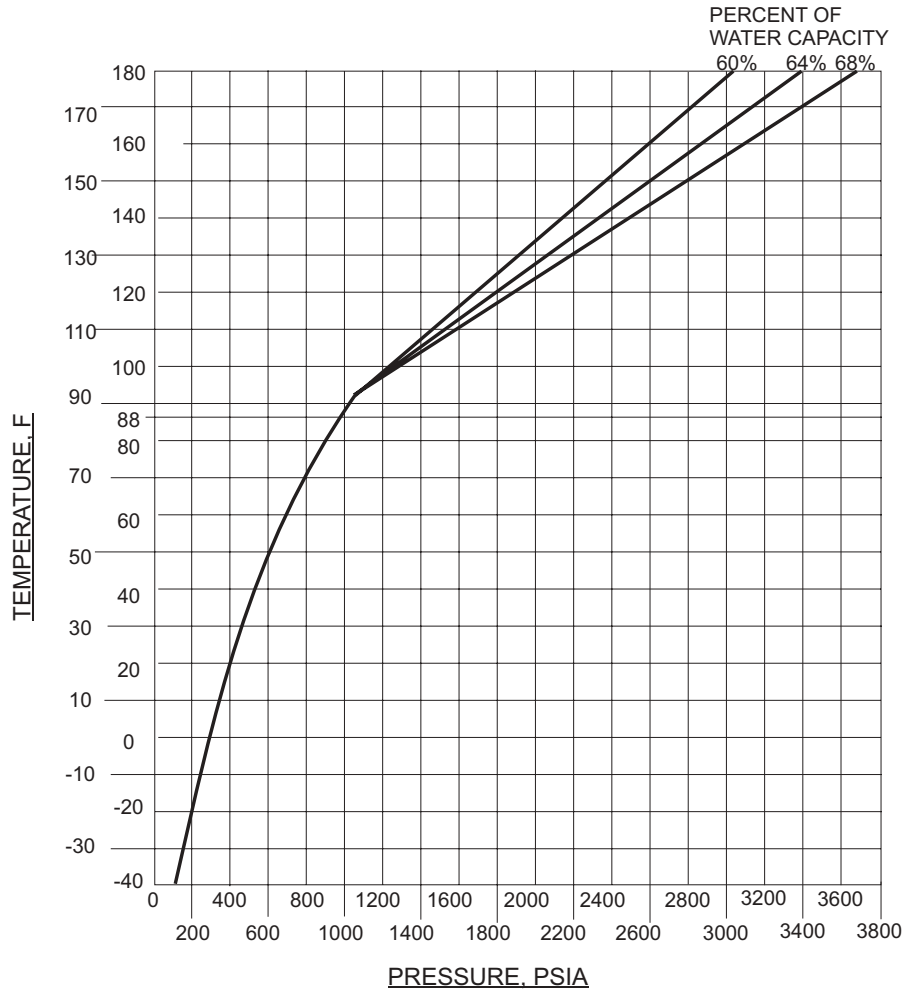

$$\text{Percent of Water Capacity} = \frac{\text{Rated CO}_2 \text{ Capacity of Cyl. in Lb.}}{\text{Water Capacity of Cyl. in Lb. at 60}^\circ\text{F}} \times 100$$

Critical Temperature of CO<sub>2</sub> = 88°F

RATED CO <sub>2</sub> CAPACITY OF CYL. IN KG.	PERCENT WATER CAPACITY
25	67
35	64
50	60
75,100	68

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL INC., Ashland, MA 01721. Telephone: (508) 881-2000

Kidde Fire Systems  
 400 Main Street  
 Ashland, MA 01721 USA  
 Tel: (508) 881-2000  
 Fax: (508) 881-8920  
<http://www.kiddefiresystems.com>