

Kidde Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid



A UTC Fire & Security Company

Effective: March 2007


K-45-2130

Manifold EI-Check Data Sheet

FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems

P/N: 877690 and 878743

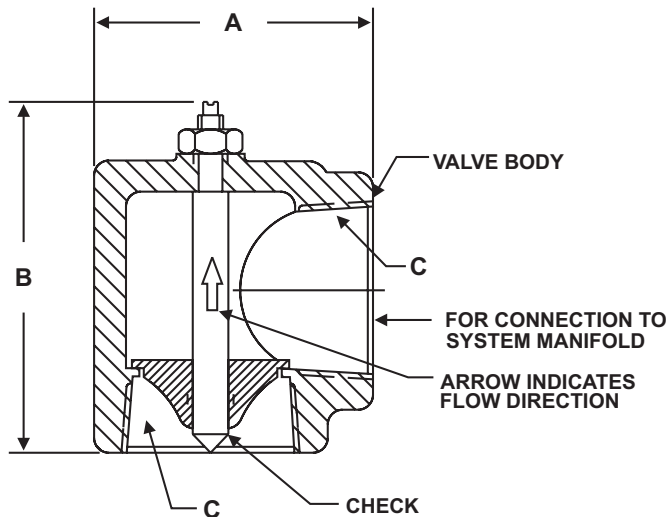

MATERIALS

- Valve Body: Zinc Plated Steel
- Check: Stainless Steel
- Seat: Nitrile Rubber

ORDERING INFORMATION

Part Number	Size	A	B	C
877690	2 in. (51 mm)	3-15/16 in. (100 mm)	4-7/8 in. (124 mm)	2 in. (51 mm) 11-1/2 in. NPT
878743	2-1/2 in. (64 mm)	4-11/16 in. (119 mm)	5-3/4 in. (146 mm)	2-1/2 in. (64 mm) 8 in. NPT

Note: EI-Checks are to be installed at system manifold in vertical direction as shown.

Do not use as a main/reserve check valve with more than one main/reserve cylinder.

Kidde is a registered trademark of Kidde-Fenwal, Inc.
3M and Novec are trademarks of 3M.
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com