

# Kidde Engineered Fire Suppression System

Designed for use with 3M™ Novec™ 1230 Fire Protection Fluid



A UTC Fire & Security Company

Effective: March 2007


**K-45-5100**

## 3/8 in. Check Valve Data Sheet

### FEATURES

- For Use with UL, ULC and FM Approved Systems

P/N: 261193

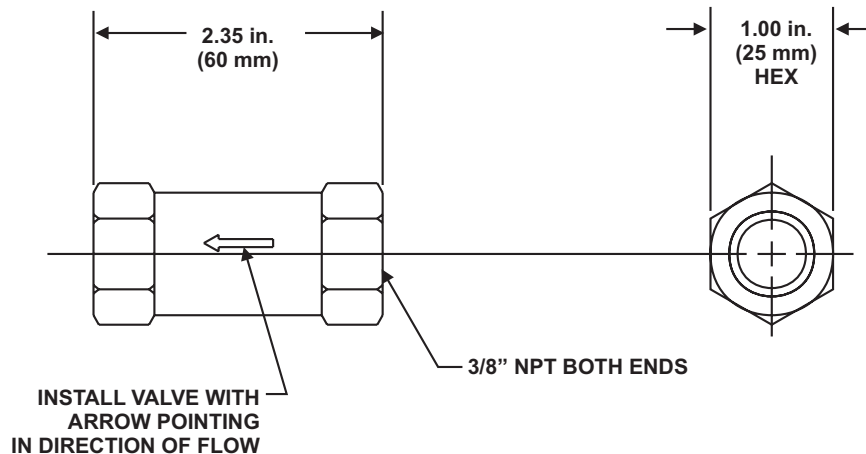

### TECHNICAL DATA

- Working Pressure: 0 to 5000 PSI (0 to 345 bar)
- Proof Pressure: 10000 PSI (690 bar)
- Cracking Pressure: 2 to 4 PSI (0.14 to 0.28 bar)
- Operating Temperature: -40°F to 250°F (-40°C to 121°C)

### MATERIALS

- Body: Brass
- Seal: BUNA-N

Kidde is a registered trademark of Kidde-Fenwal, Inc.  
3M and Novec are trademarks of 3M.  
All other trademarks are property of their respective owners.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.  
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)