


CO₂ Component Description

Pressure vs. Temperature for Carbon Dioxide Cylinders (Metric)



Effective: February 2007
K-81-1032

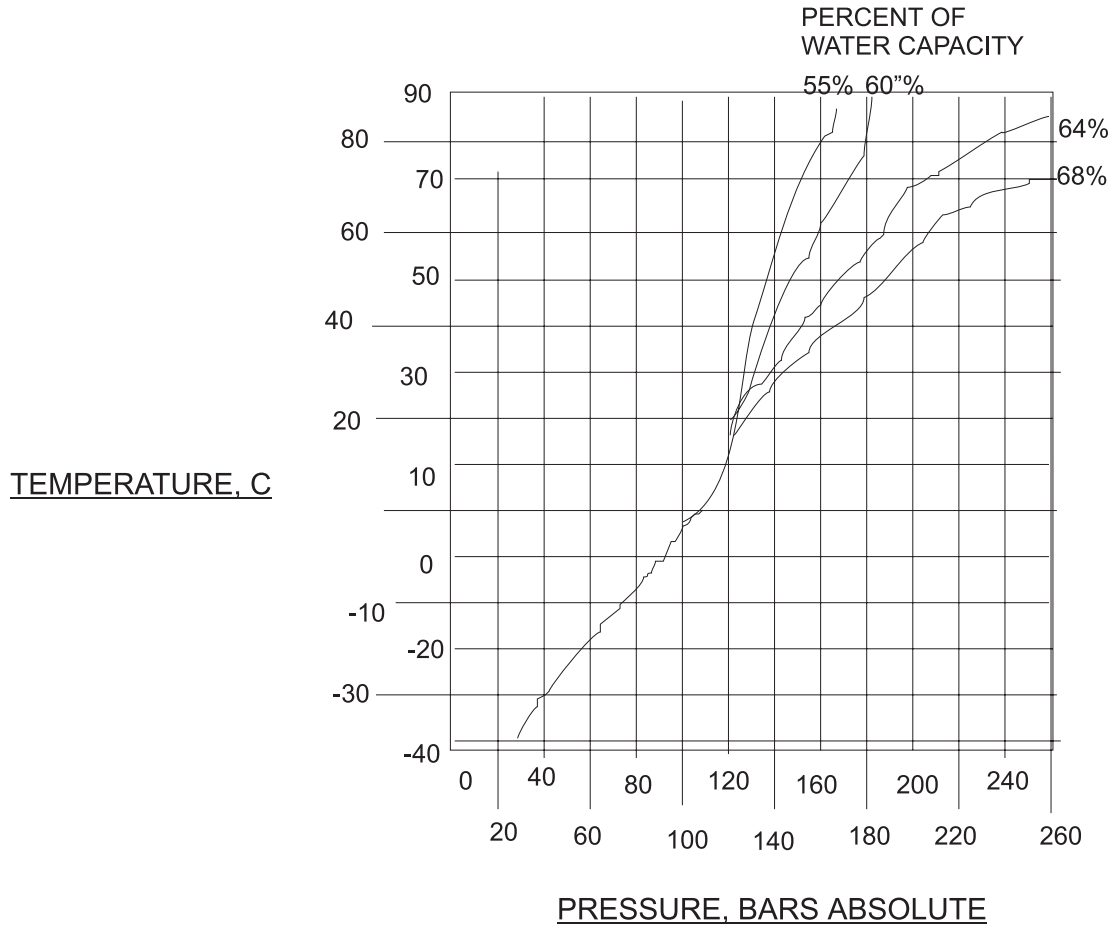

Percent of Water Capacity =

$$\frac{\text{Rated CO}_2 \text{ Capacity of Cyl. in Kg}}{\text{Water Capacity of Cyl. in Kg at 16}^\circ\text{C}} \times 100$$

Critical Temperature of CO₂ = 31°C

RATED CO ₂ CAPACITY OF CYL. IN KG	PERCENT OF WATER CAPACITY
4.5	55
6.8, 9.0, 11.3, 15.8	60
22.6	64
34.0, 45.3	68

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com