


# CO<sub>2</sub> Component Description

## Hose Assembly

Effective: February 2007  
K-81-1200

| PART NUMBER | HOSE SIZE | LENGTH |      |
|-------------|-----------|--------|------|
|             |           | FT     | M    |
| 907757      | 1/2 in.   | 25     | 7.6  |
| 961966      | 1/2 in.   | 50     | 15.2 |
| 918990      | 3/4 in.   | 25     | 7.6  |
| 918435      | 3/4 in.   | 50     | 15.2 |

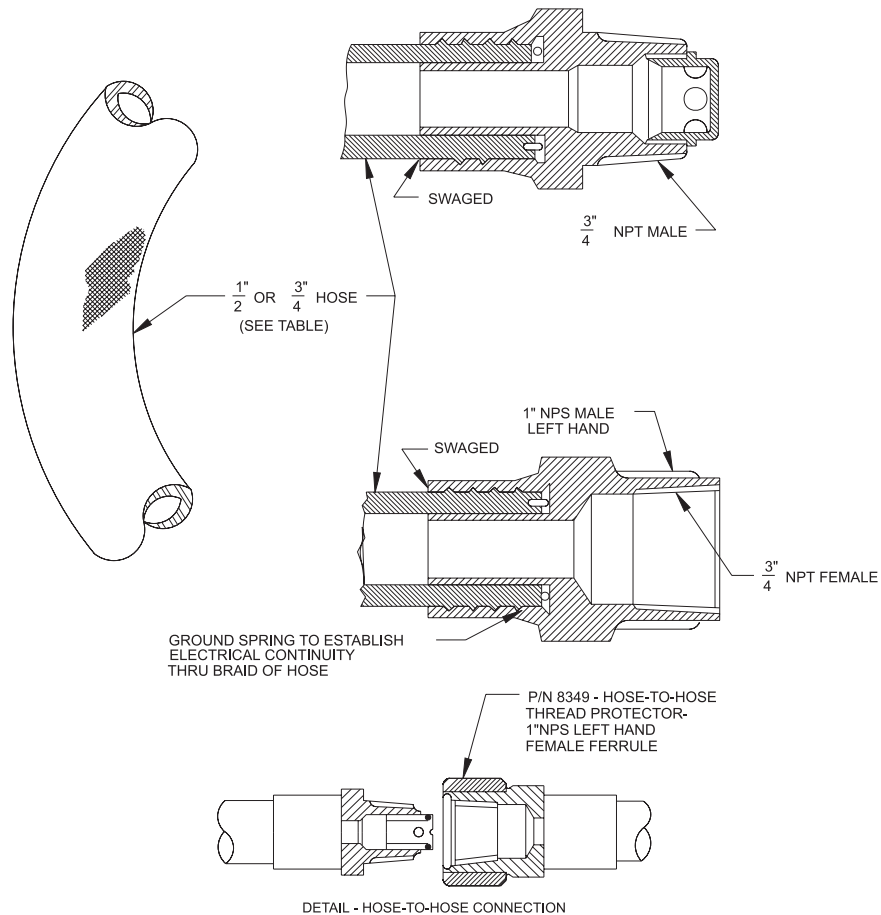

### MATERIALS

**HOSE: SYNTHETIC RUBBER WITH BRAIDED STEEL REINFORCEMENT TESTED TO 6000 PSI (414 BARS)**  
**COUPLING BRASS**

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)