

# CO<sub>2</sub> Component Description




A UTC Fire & Security Company

## 1/4 inch Flexible Actuation Hoses

Effective: February 2007  
**K-81-5070**

PART NO.	A*
264986	30
264987	22

\* DIMENSIONS ARE IN INCHES

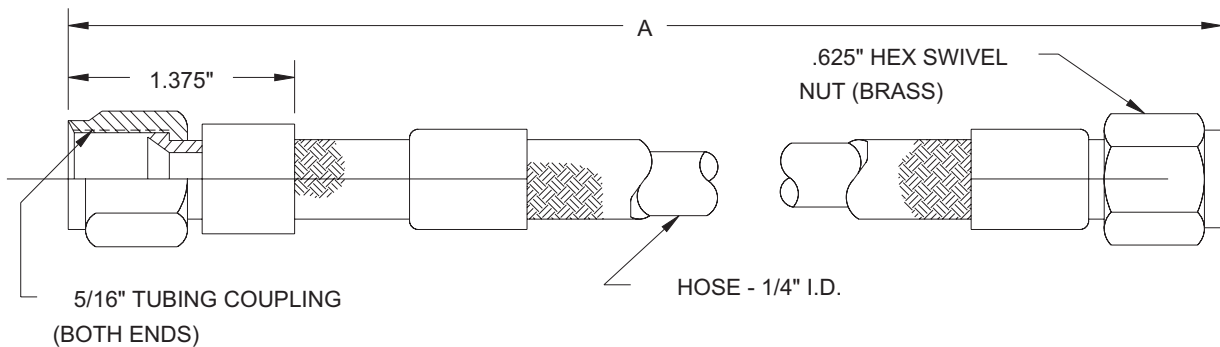

### MATERIALS

**HOSE: WIRE BRAIDED, TEFLON LINING (CRES T304)**

**COUPLINGS: BRASS**

**MINIMUM BURST PRESSURE: 12,000 PSIG**

**OPERATING PRESSURE: 3000 PSIG**

**TEST PRESSURE: 4500 PSIG**

**MINIMUM BEND RADIUS 2.5 in.**

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly.  
If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)