

CO₂ Component Description




A UTC Fire & Security Company

1/4 inch Check Valve

Effective: February 2007
K-81-5090

P/N: 264985

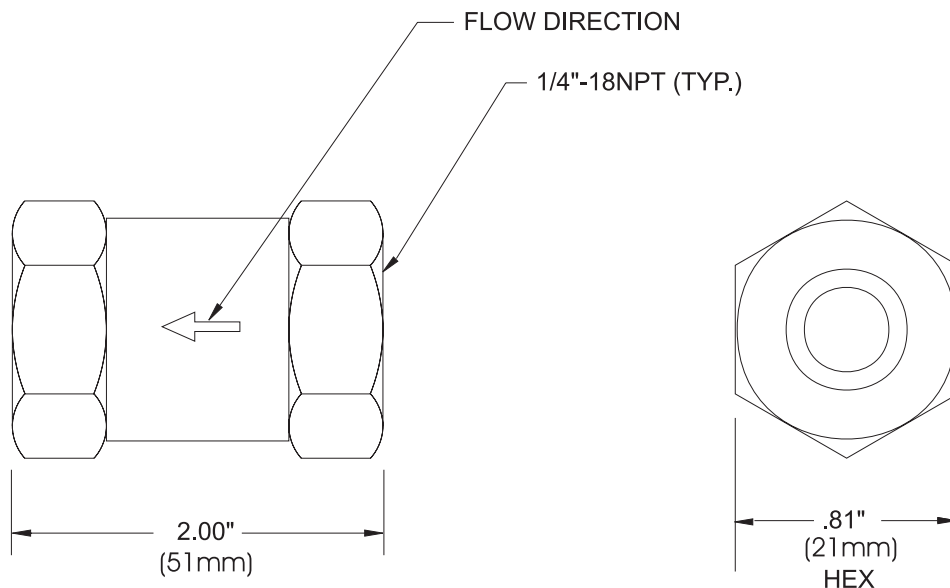

MATERIAL: BRASS

WORKING PRESSURE: 0-1800 PSI (0-124 BAR) MINIMUM

BURSTING PRESSURE: 5000 PSI (345 BAR)

Note: Install valve with arrow pointing in direction of flow.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.