

# FM-200<sup>®</sup> Component Description

Cylinder and Valve Assembly,  
200 lb. (90.7 kg) Capacity




A UTC Fire & Security Company


Effective: April 2007  
**K-90-2040**

## FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems
- See Kidde<sup>®</sup> Manual 90-FM200M-021 for USCG Approval



PLAN VIEW

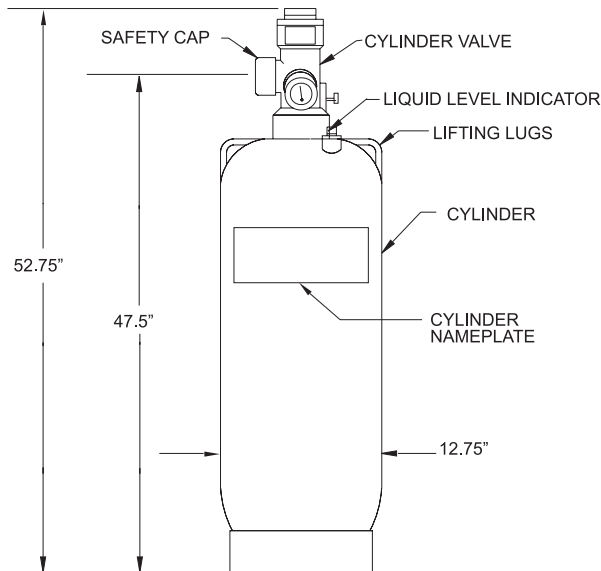

## ORDERING INFORMATION

Part Number	Description
90-100200-101	STD
90-100201-101	w/LLI

## MATERIALS

- Valve Body: Brass
- Cylinder: Steel, Painted Red

## Notes:

1. The safety cap must be installed on the valve outlet at all times, except when the cylinders are connected to the system piping, or being filled. The safety cap must not be removed from its chain.
2. See K-90-2070 for additional information.

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.