

# FM-200<sup>®</sup> Component Description



A UTC Fire & Security Company

## Pressure Operated Switch


Effective: September 2010

K-90-5180

### FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems
- See Kidde<sup>®</sup> Manual 90-FM200M-021 for USCG Approval

P/N: 81-486536-000

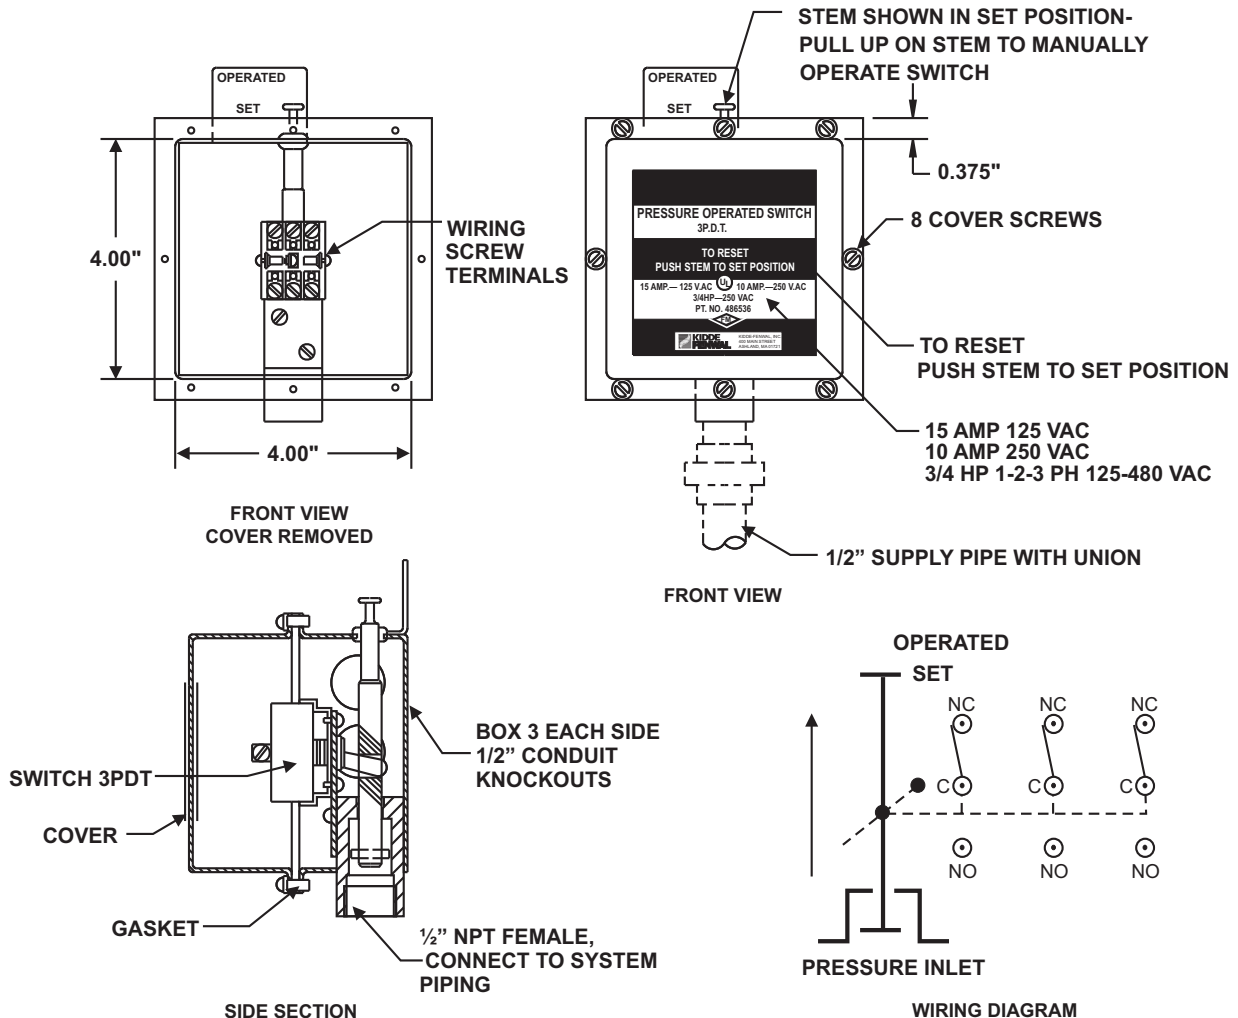

### NOTES:

- The switch may be mounted in any position; however, the preferred installation is upright, as shown.
- Any load connection to the switch must not exceed the switch rating, and shall utilize a suitable protection device (i.e., circuit breaker, fuse).
- Contact Ratings (3 PDT):
  - 15 Amp @ 125 Vac
  - 10 Amp @ 250 Vac
  - 3/4 HP @ 250 Vac
  - 1, 2 or 3 Phase

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
 A UTC Fire & Security Company  
 400 Main Street  
 Ashland, MA 01721  
 Ph: 508.881.2000  
 Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)