

# FM-200<sup>®</sup> Component Description

## Electric and Cable Operated Control Head




A UTC Fire & Security Company

Effective: April 2007  
K-90-8030

### FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems

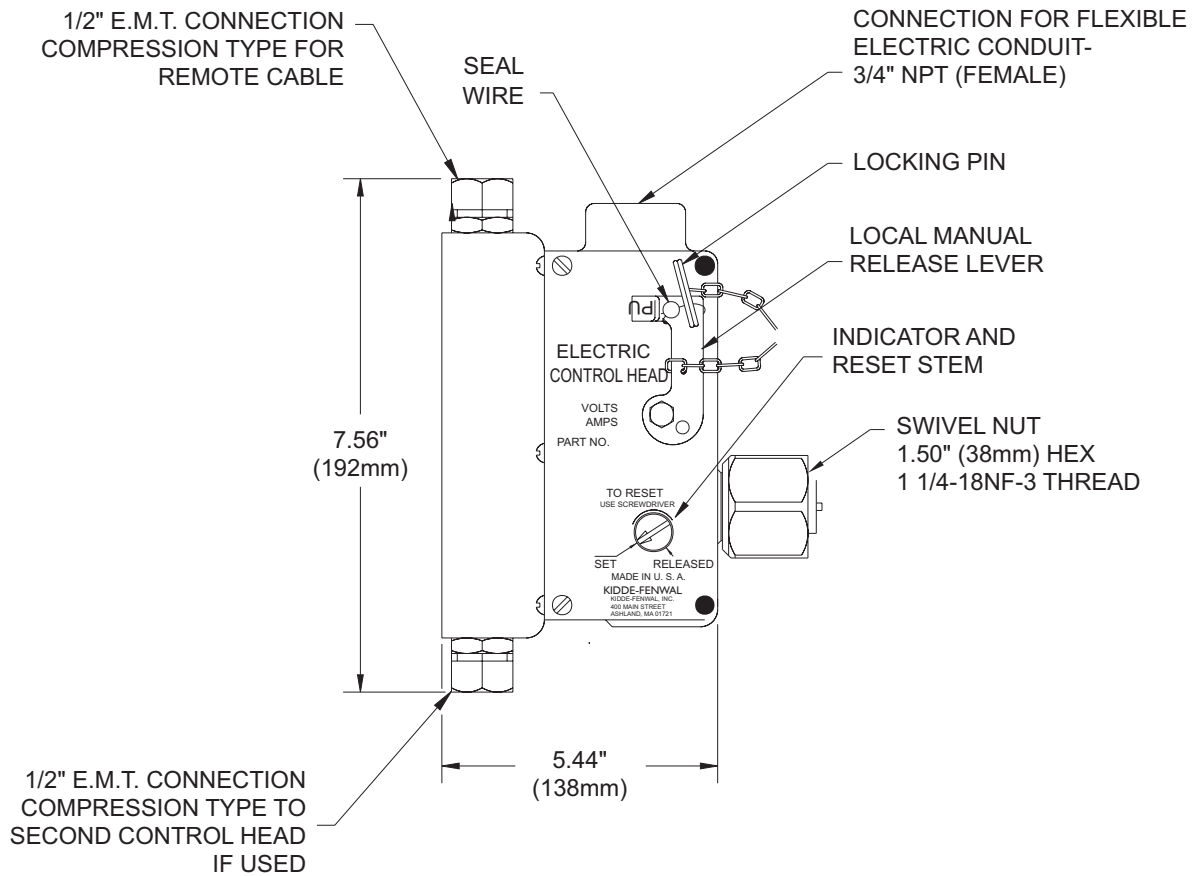

PART NO.	CONTROL HEAD	
	VOLTAGE	AMPS
895630	24 Vdc	2.0 Momentary
895628	125 Vdc	0.3 Momentary
895627	115 Vac	1.0 Momentary

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems  
A UTC Fire & Security Company  
400 Main Street  
Ashland, MA 01721  
Ph: 508.881.2000  
Fax: 508.881.8920  
[www.kiddefiresystems.com](http://www.kiddefiresystems.com)