

FM-200[®] Component Description

Cylinder Wall Brackets




A UTC Fire & Security Company

Effective: April 2007
K-90-8140

FEATURES

- For Use with UL Listed, ULC Listed and FM Approved Systems

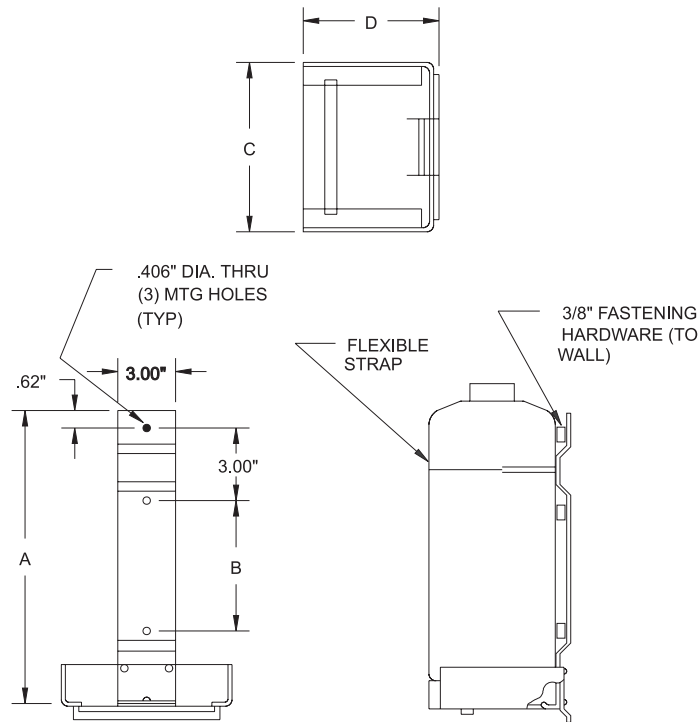

ORDERING INFORMATION

PART NO.	CYL. CAP	A*	B*	C*	D*
486485	10 LBS	8.62	1.56	7.68	5.75
486486	20 LBS	14.37	7.31	7.68	5.75
486487	40 LBS	13.12	5.94	9.75	6.75
486488	70 LBS	19.62	12.44	9.75	6.75

* DIMENSIONS ARE IN INCHES

MATERIALS

- Steel, Zinc Painted SAE 1010

FM-200 is a registered trademark of the Great Lakes Chemical Corporation.

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com