


FE-13 Component Description

Electric and Cable Operated Control Head



A UTC Fire & Security Company

Effective: April 2007
K-96-6020

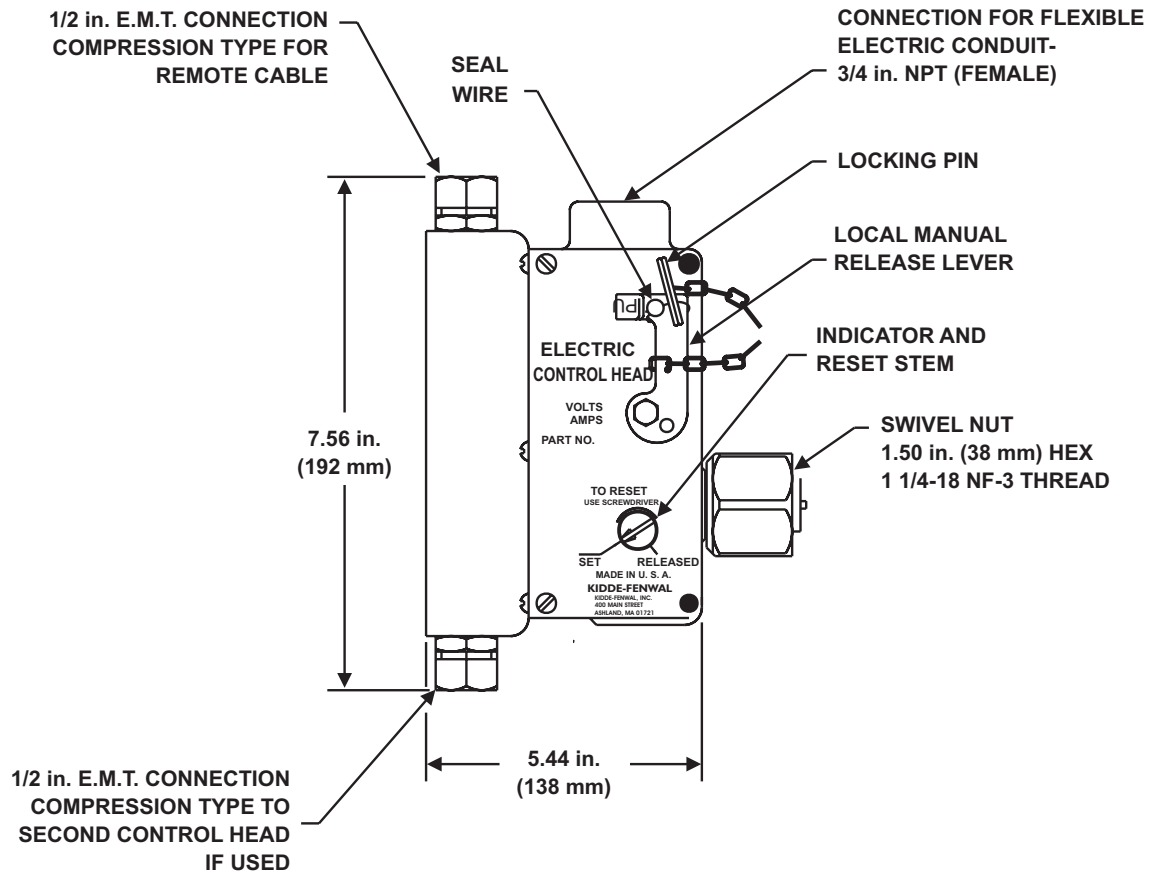

Part Number	Control Head	
	Voltage	Amps
895630	24 Vdc	2.0 Momentary
895628	125 Vdc	0.3 Momentary
895627	115 Vac	1.0 Momentary

This literature is provided for informational purposes only. KIDDE-FENWAL, INC. assumes no responsibility for the product's suitability for a particular application. The product must be properly applied to work correctly. If you need more information on this product, or if you have a particular problem or question, contact KIDDE-FENWAL, INC., Ashland, MA 01721. Telephone: (508) 881-2000.

Kidde Fire Systems
A UTC Fire & Security Company
400 Main Street
Ashland, MA 01721
Ph: 508.881.2000
Fax: 508.881.8920
www.kiddefiresystems.com