
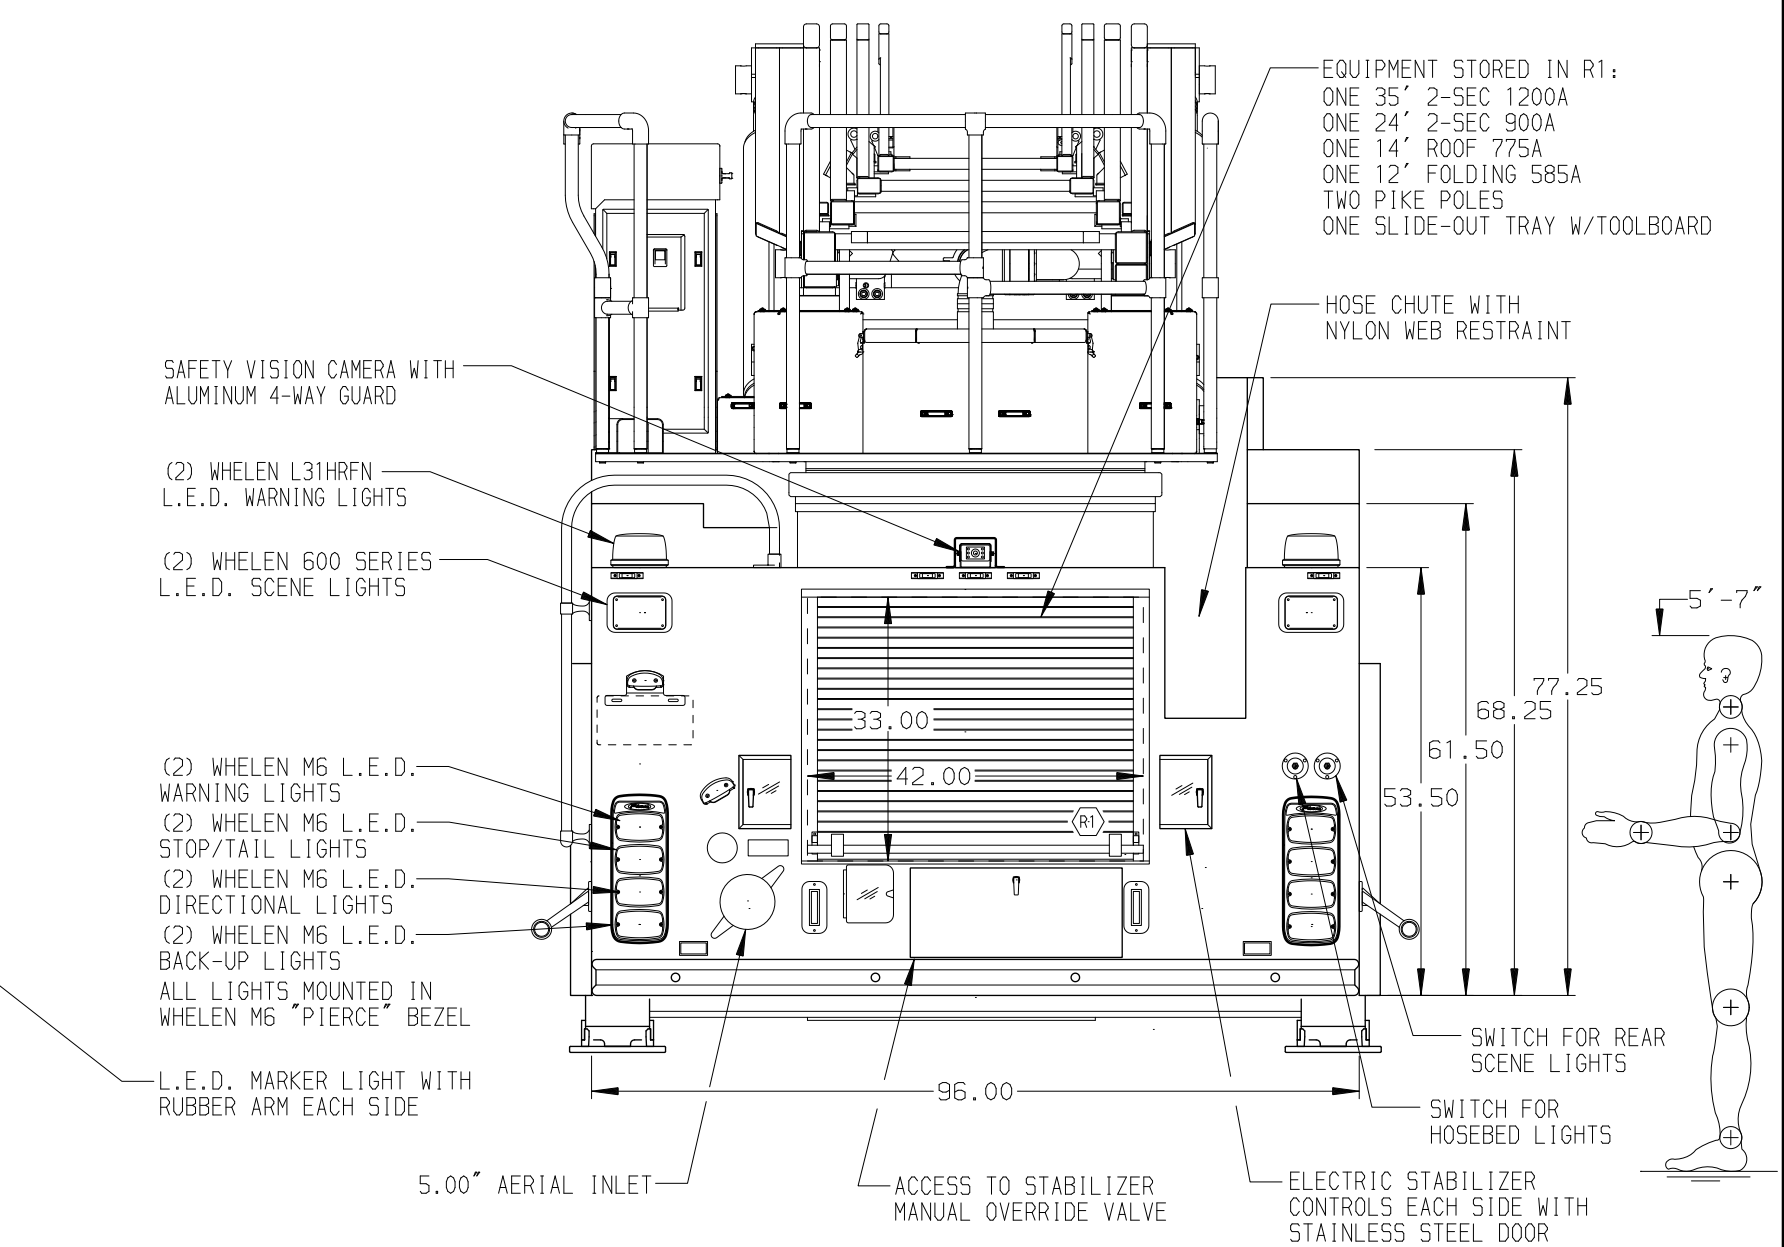


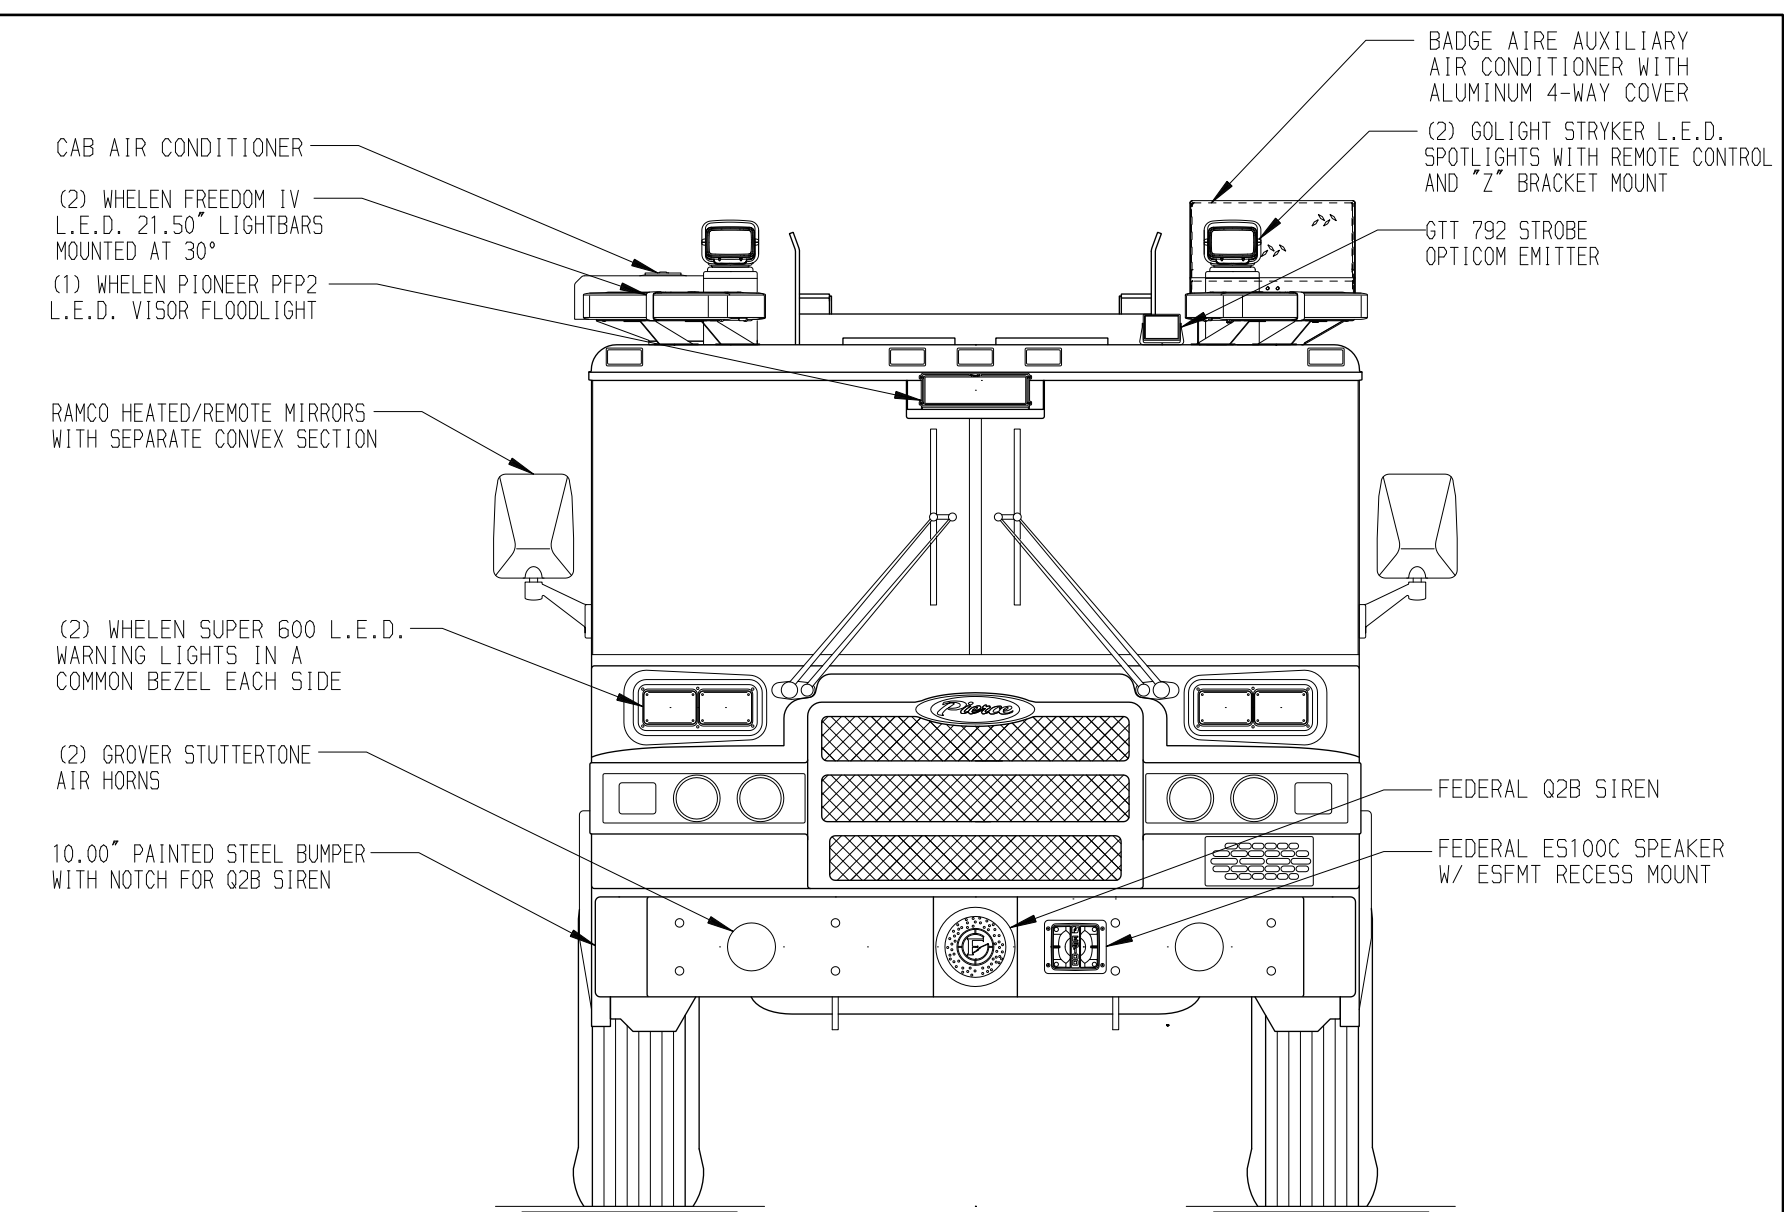

MAXIMUM O.A.H. 149.00"

11. STORAGE RACK FOR (9) AIR BOTTLES LOCATED IN COMPARTMENT D3
12. CIRCUIT BREAKER PANEL IN COMPARTMENT D4
13. REMOTE LADDER CONTROLS AT AERIAL TIP
14. 120V POWER TO AERIAL TIP
15. FIRE RESEARCH 3-WAY INTERCOM SYSTEM BETWEEN AERIAL TIP,PUMP PANEL & TURNTABLE
16. AERIAL PEDESTAL RAISED 8.5'
17. PEGBOARD WITH TOOL RACK LOCATED ON THE BACK WALL OF COMPARTMENT D1
18. PEGBOARD LOCATED ON THE FRONT, REAR AND BACK WALL OF COMPARTMENT P5
19. LIFTING EYE RESCUE ATTACHMENT AT AERIAL TIP

05OCT17	SHU	JJR	CHASSIS DATA	
30AUG17	SHU	JJR		
21AUG17	SHU	JJR	MAKE	
28JUL17	SHU	JJR	PIERCE MODEL	
14APR17	SHU	CRI		
REV	DATE	BY	CH	QUANTUM

 MANUFACTURING INC.		JOB NO.	30870	
		SCALE 1:24	DATE	
TITLE	105 AERIAL LADDER & BODY ASSEMBLY 475 GALLON TANK, 455 GAL WATER/20 GAL FOAM		DRAWN BY SHU	04APR17
FOR	CITY OF PALM SPRINGS FIRE DEPARTMENT PALM SPRINGS, CA		CHECKED BY GRM	04APR17
DWG NO.	30870AD		SHEET SIZE D	SHEET NO. 1 OF 1