

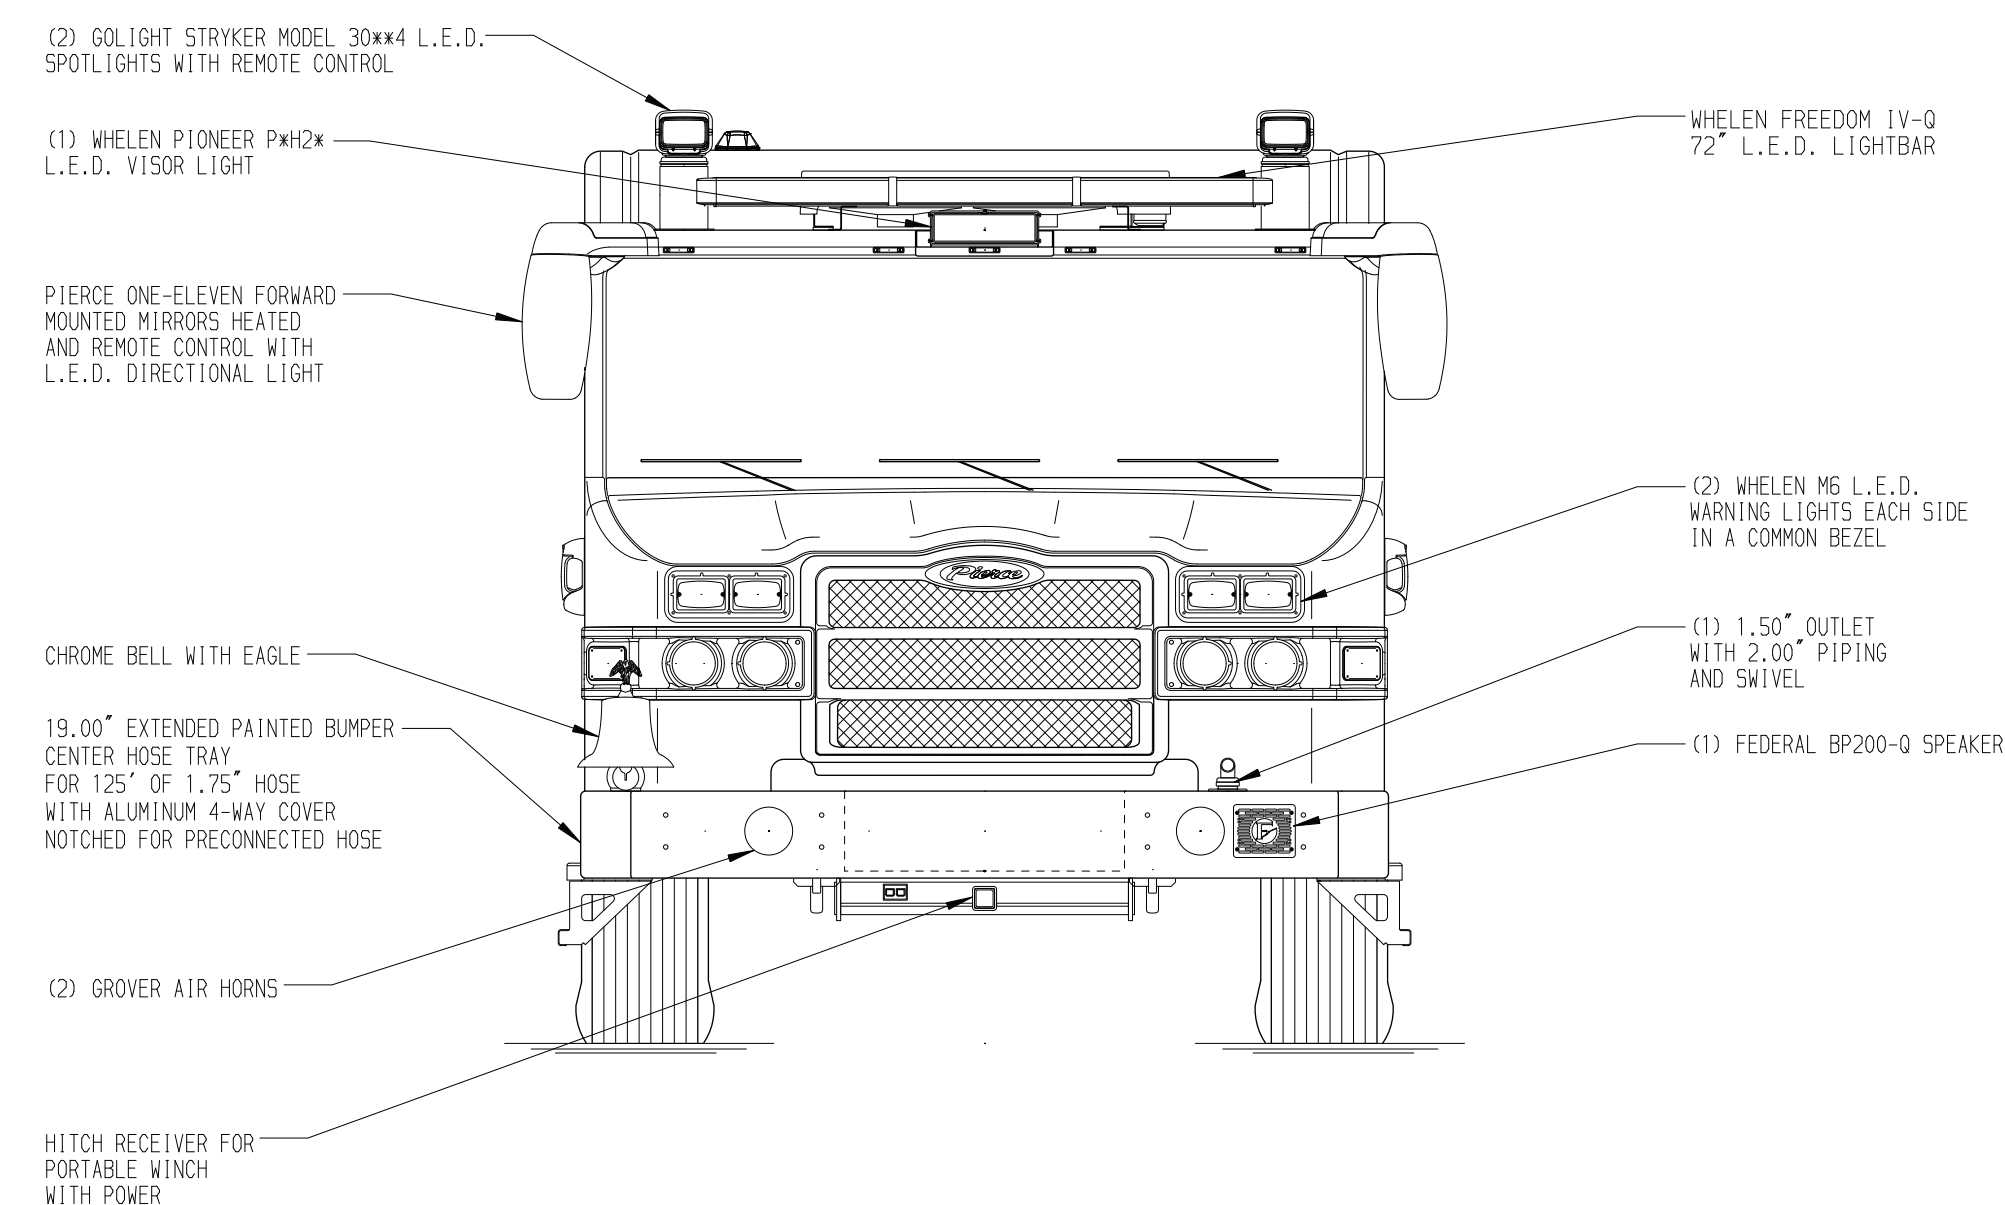


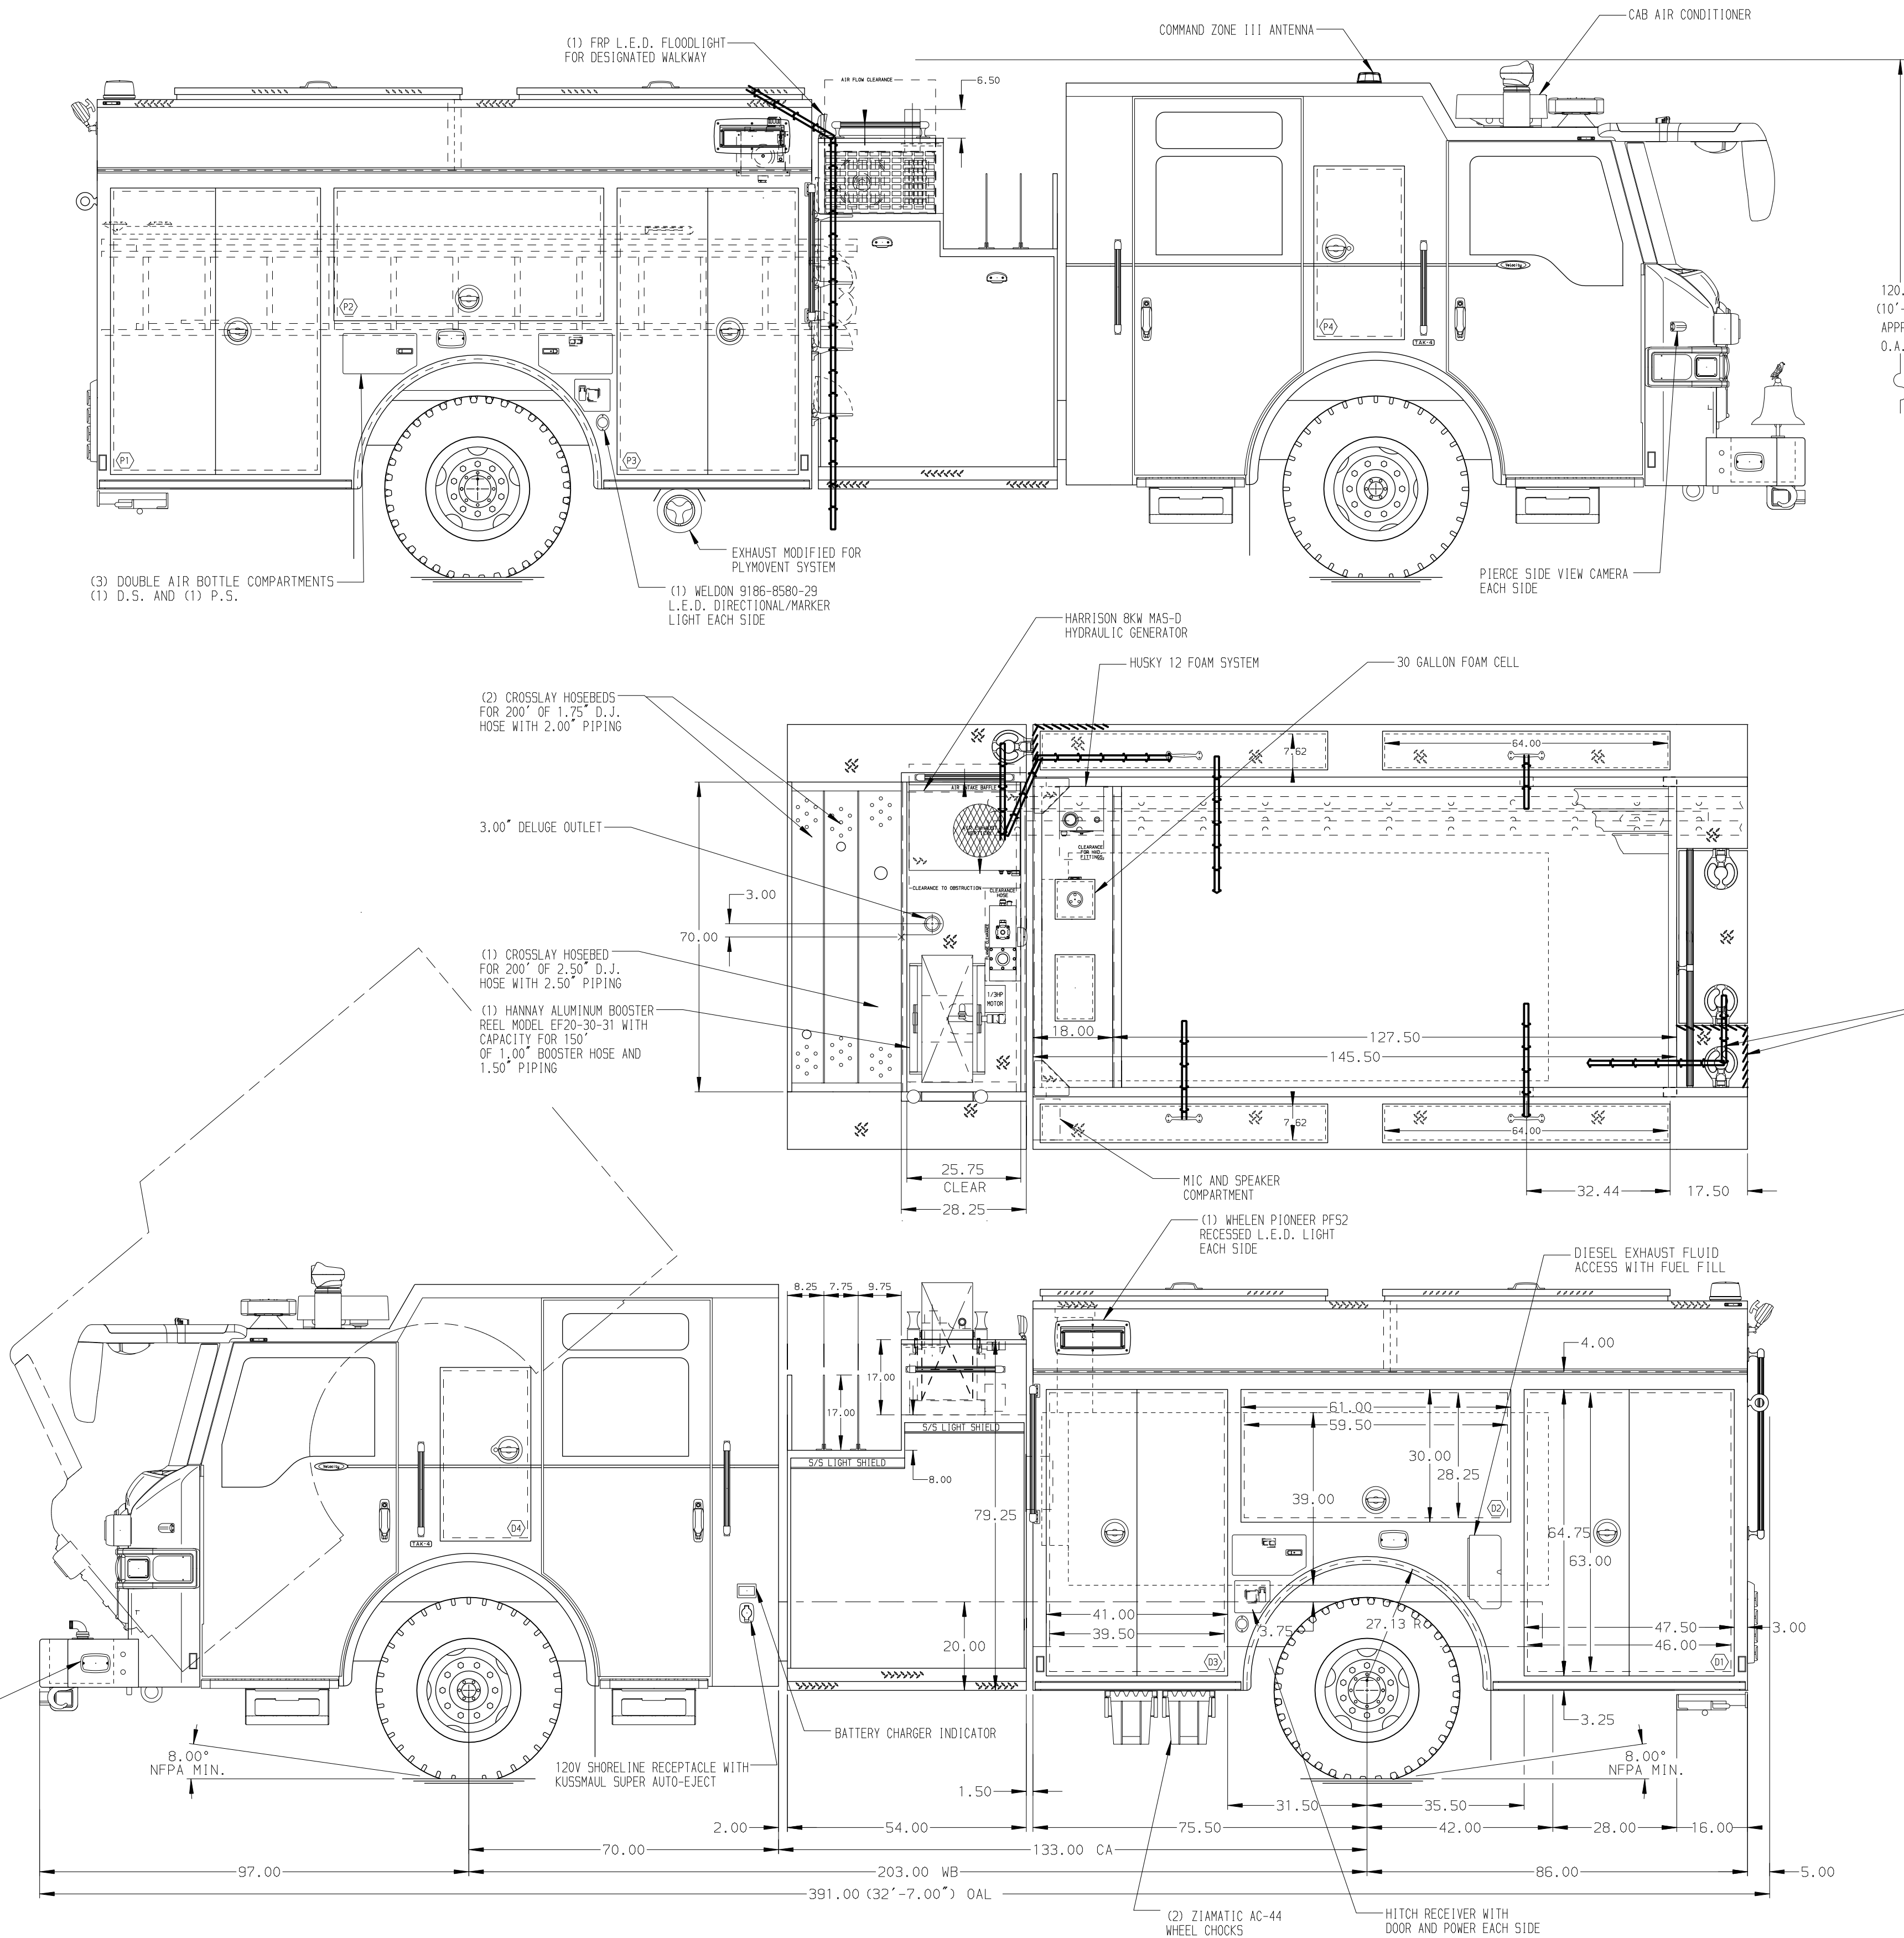

HOSEBED CAPACITIES	
①	500' OF 3.00" HOSE
②	1000' OF 5.00" HOSE
③	500' OF 3.00" HOSE

SURFACE DESIGNATION AND PATHWAY MARKINGS

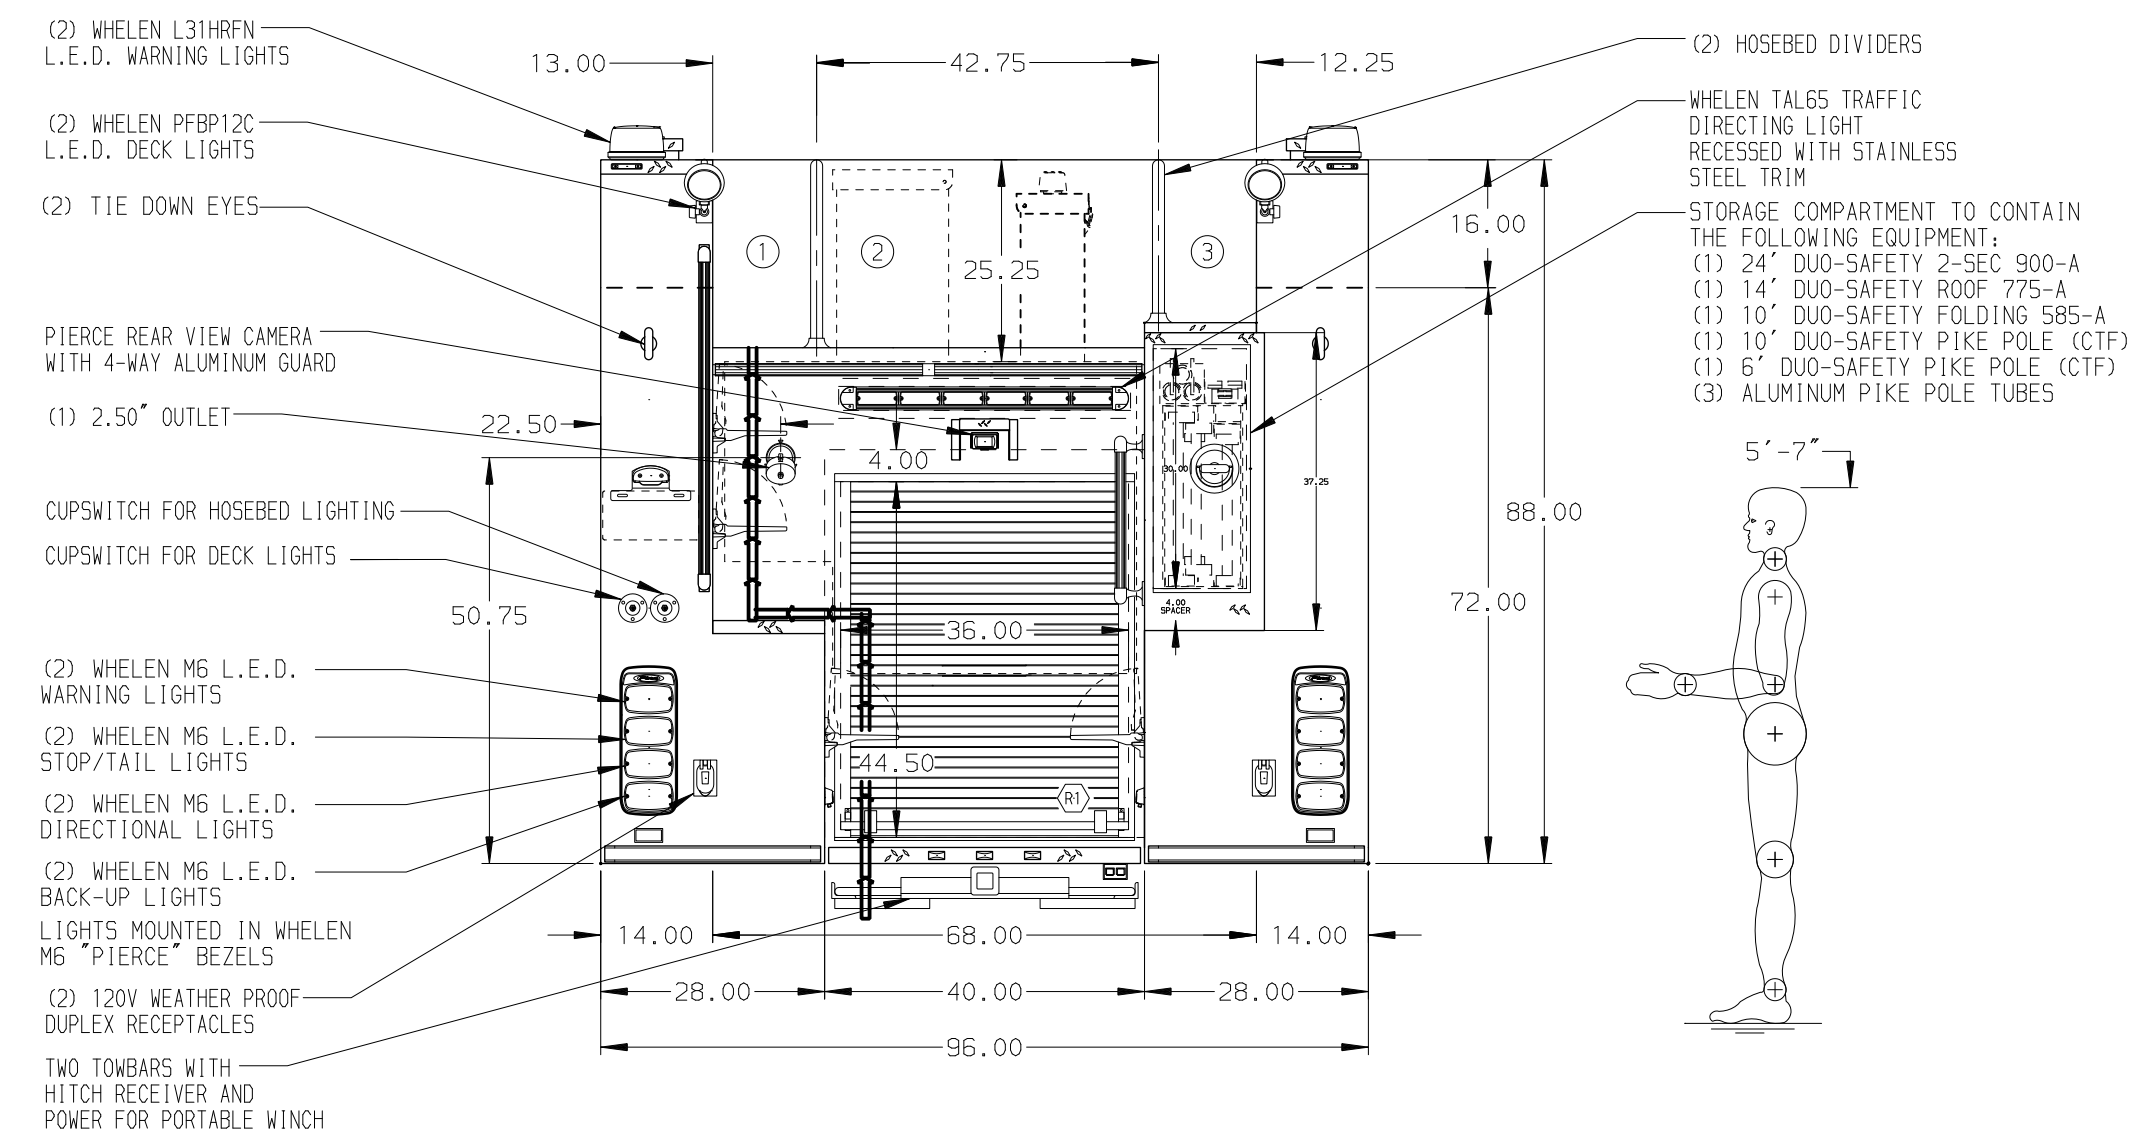

ALUMINUM BODY

NOTE

DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION. MINOR DETAILS NOT SHOWN.

1. INSTA-CHAIN AUTOMATIC TIRE CHAINS TO BE PROVIDED AT REAR
2. AIR INLET WITH DISCONNECT COUPLING ON THE D.S. STEP WELL
3. BATTERY CHARGER LOCATED IN D3
4. PULL STRAPS ON DOOR IN D2 AND P2
5. ADJUSTABLE FULL WIDTH/ DEPTH SHELVES TWO IN D3 AND P3 AND ONE IN D1, R1, AND P1
6. CIRCUIT BREAKER PANEL IN D3
7. ONE 120V 4 PLACE DUPLEX RECEPTACLE ON THE FRONT BULKHEAD WALL
8. TWO 120V NEMA DUPLEX RECEPTACLES IN D3
9. ONE 120 V WEATHERPROOF DUPLEX RECEPTACLE ON THE D.S. AND P.S. BULKHEAD WALL



JOB NO. 31931

SCALE 1:24 DATE

DRAWN BY LST 29NOV17

CHECKED BY CCA 30NOV17

SHEET SIZE D SHEET NO. 1 OF 1

REV	DATE	BY	CH	VELOCITY
1	07FEB18	LST	LAB	

TITLE	1250-D-750P, 720 GAL OF WATER W/ 30 GAL OF FOAM 161" FH FDLER, (3) X-LAYS, LDERS BTWN. TANK & S. SHEET
FOR	NORMAN FIRE DEPARTMENT NORMAN, OKLAHOMA
DWG NO.	31931AD