


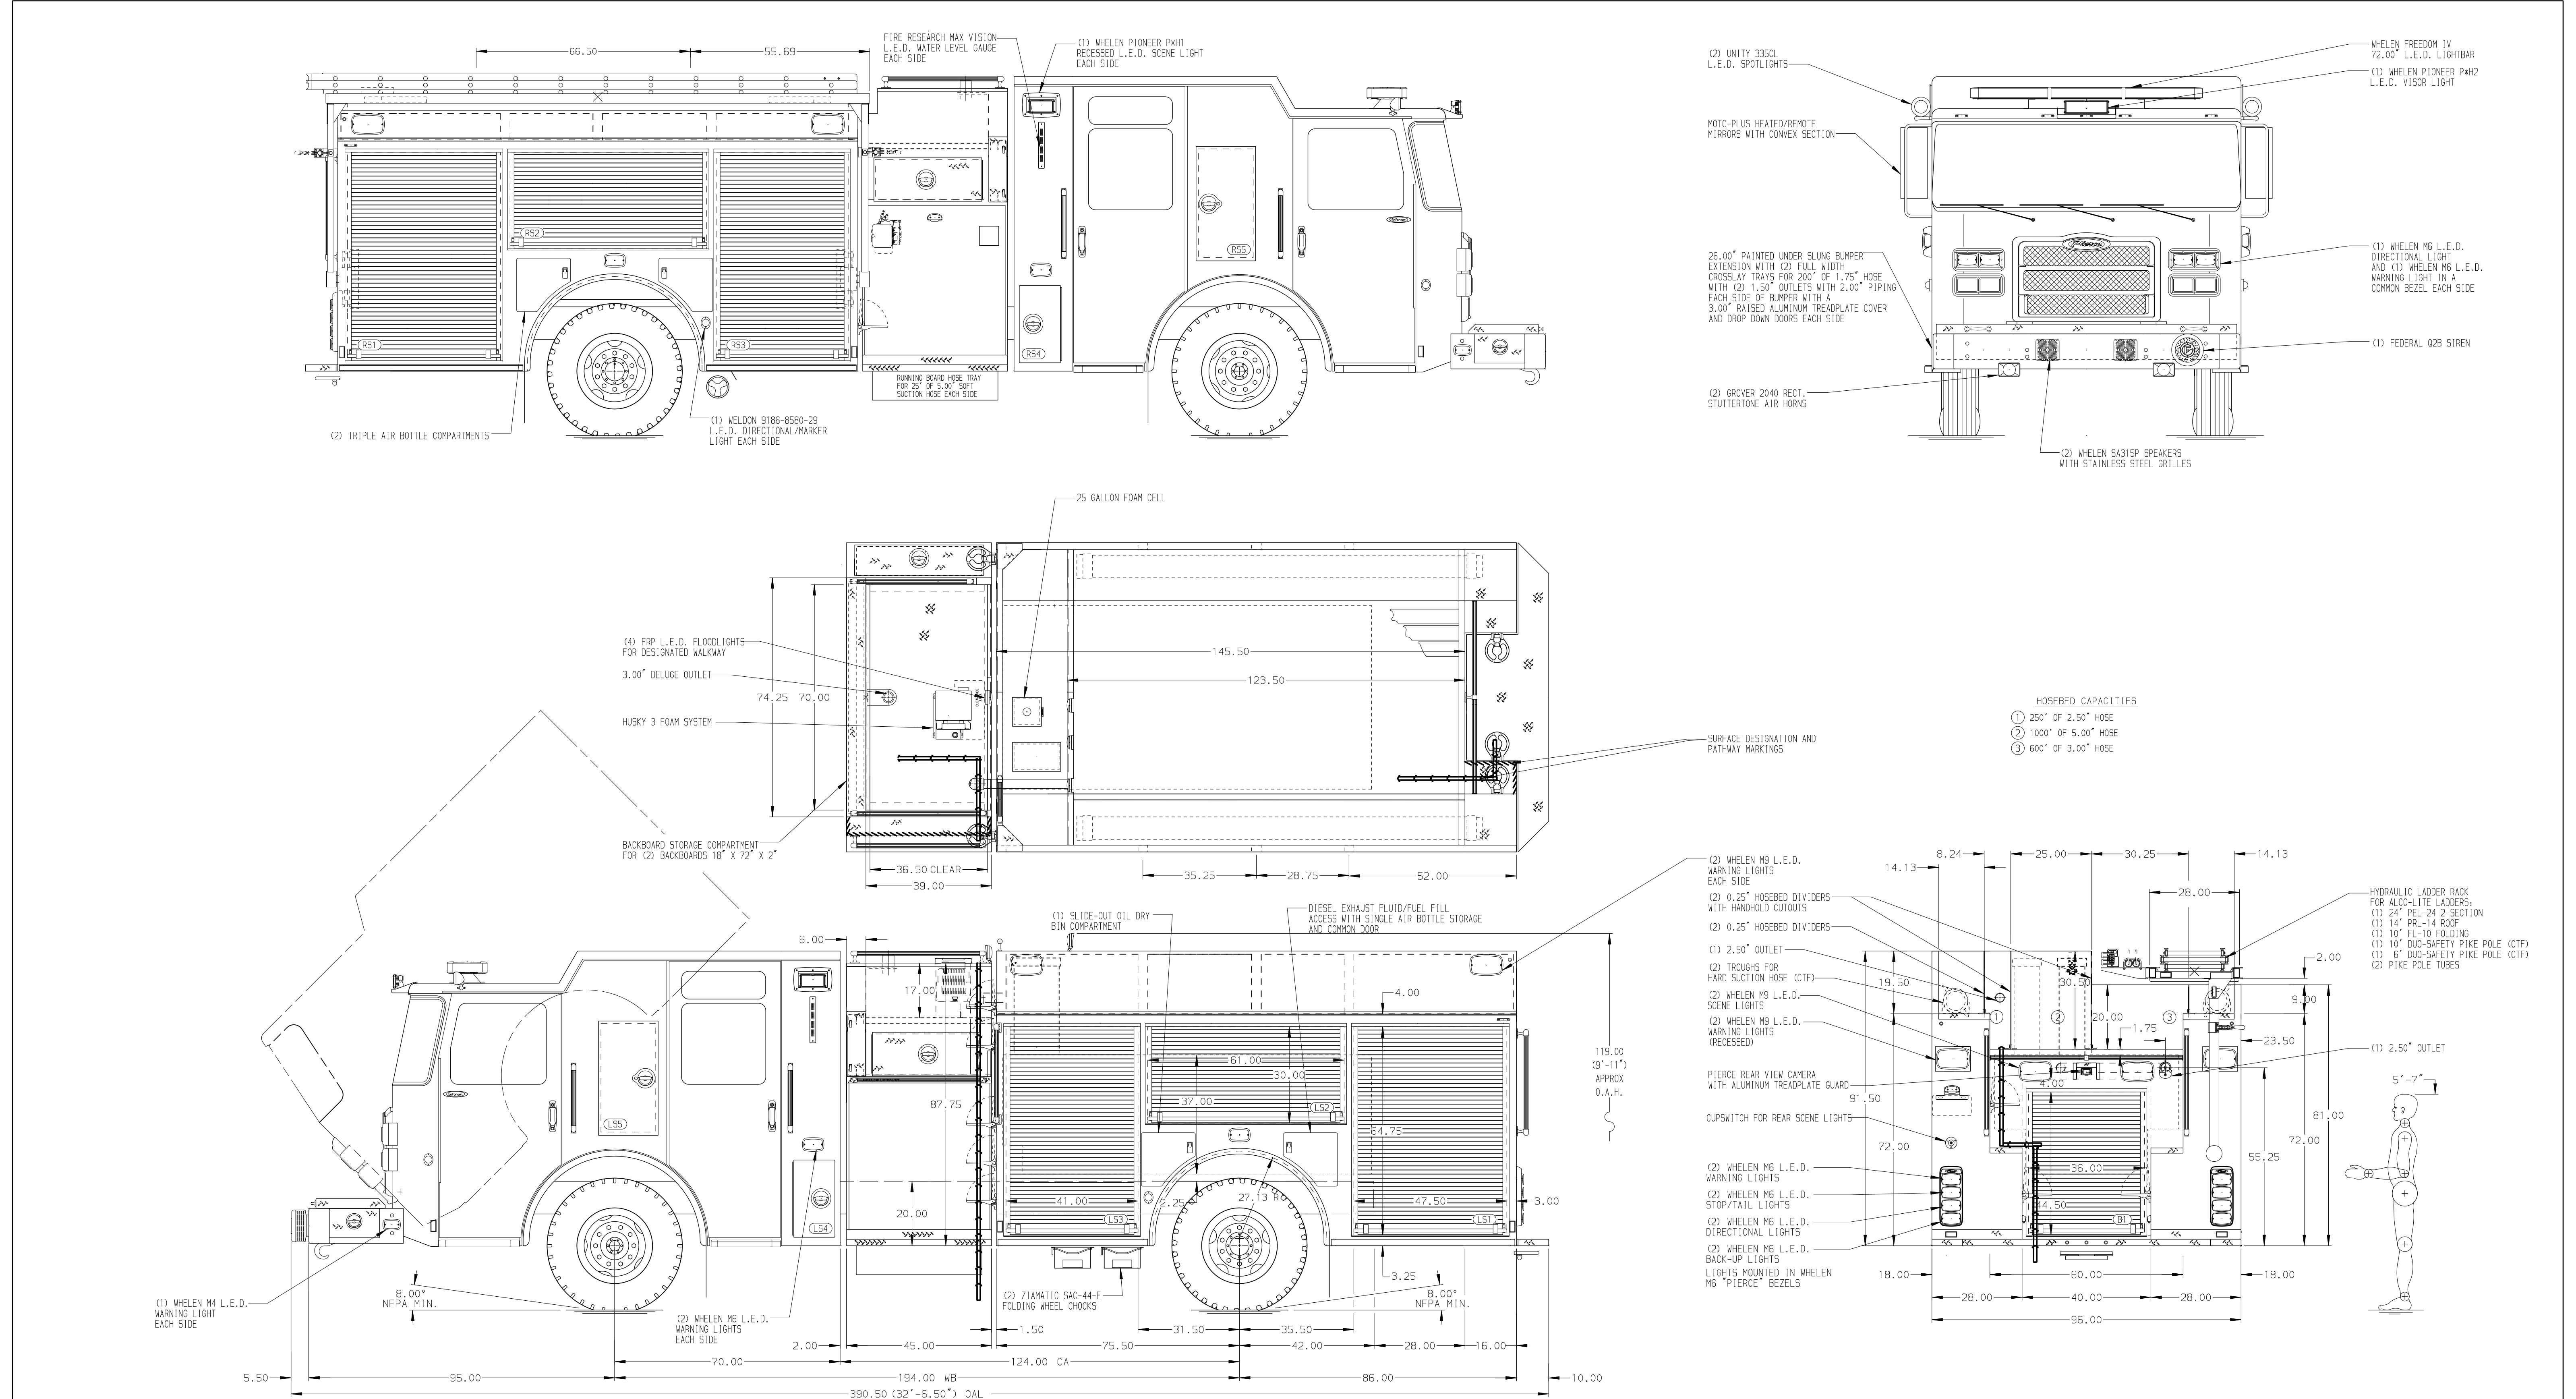

- HOSEBED CAPACITIES
- ① 250' OF 2.50" HOSE
 - ② 1000' OF 5.00" HOSE
 - ③ 600' OF 3.00" HOSE

ALUMINUM BODY

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION.
MINOR DETAILS NOT SHOWN.

1. AIR INLET WITH DISCONNECT COUPLING ON D.S. STEP WELL
2. 120V SHORELINE RECEPTACLE WITH KUSSMAUL SUPER AUTO-EJECT ON D.S. PUMP PANEL
3. DRIP PAN GUARD FOR ROLL-UP DOOR IN LS1, LS2, LS3, B1, RS1, RS2, AND RS3
4. KEYS FOR ROLL UP DOOR IN RS3
5. FULL WIDTH/DEPTH ADJUSTABLE SHELVES TWO IN LS1 AND RS3 AND ONE IN LS3, B1, RS1, AND RS2
6. ONE FLOOR MOUNTED SLIDE-OUT TRAY IN LS1, B1, AND RS1
7. ONE ALUMINUM SLIDE-OUT TOOLBOARD WITH PEGBOARD IN B1
8. ONE VERTICAL PARTITION IN B1
9. VANNER LIFESTAR INVERTER/ BATTERY CHARGER BEHIND THE OFFICER'S SEAT
10. ALUMINUM SWING-OUT TOOLBOARD WITH PAC TRAC IN LS2

11. CTECH THREE DRAWER ASSEMBLY IN LS3
12. PAC TRAC ON THE REAR WALL OF LS2 AND LS3
13. PARTITION BETWEEN COMPARTMENTS LS1/B1 AND RS1/B1
14. ONE 120V NEMA DUPLEX RECEPTACLE IN LS1, RS1, AND RS3

REV	DATE	BY	CH	ENFORCER
1	12JUN19	KLE	KWI	CHASSIS DATA
2	20MAY19	LST	SHA	MAKE
3	07MAY19	LST	SHA	PIERCE
4	25APR19	LST	SHA	MODEL

 MANUFACTURING INC.		JOB NO.	33665
		SCALE	1:24
		DATE	
		DRAWN BY	LST
		CHECKED BY	SMA
		SHEET SIZE	D
		SHEET NO.	1 OF 1

TITLE 1250-D-775P, 750 GAL OF WATER W/ 25 GAL FOAM CELL
161" BODY, HYDRAULIC LADDER RACK, DELUGE
FOR VOLUSIA COUNTY FIRE RESCUE
DAYTONA BEACH, FLORIDA
DWG NO. 33665AD