


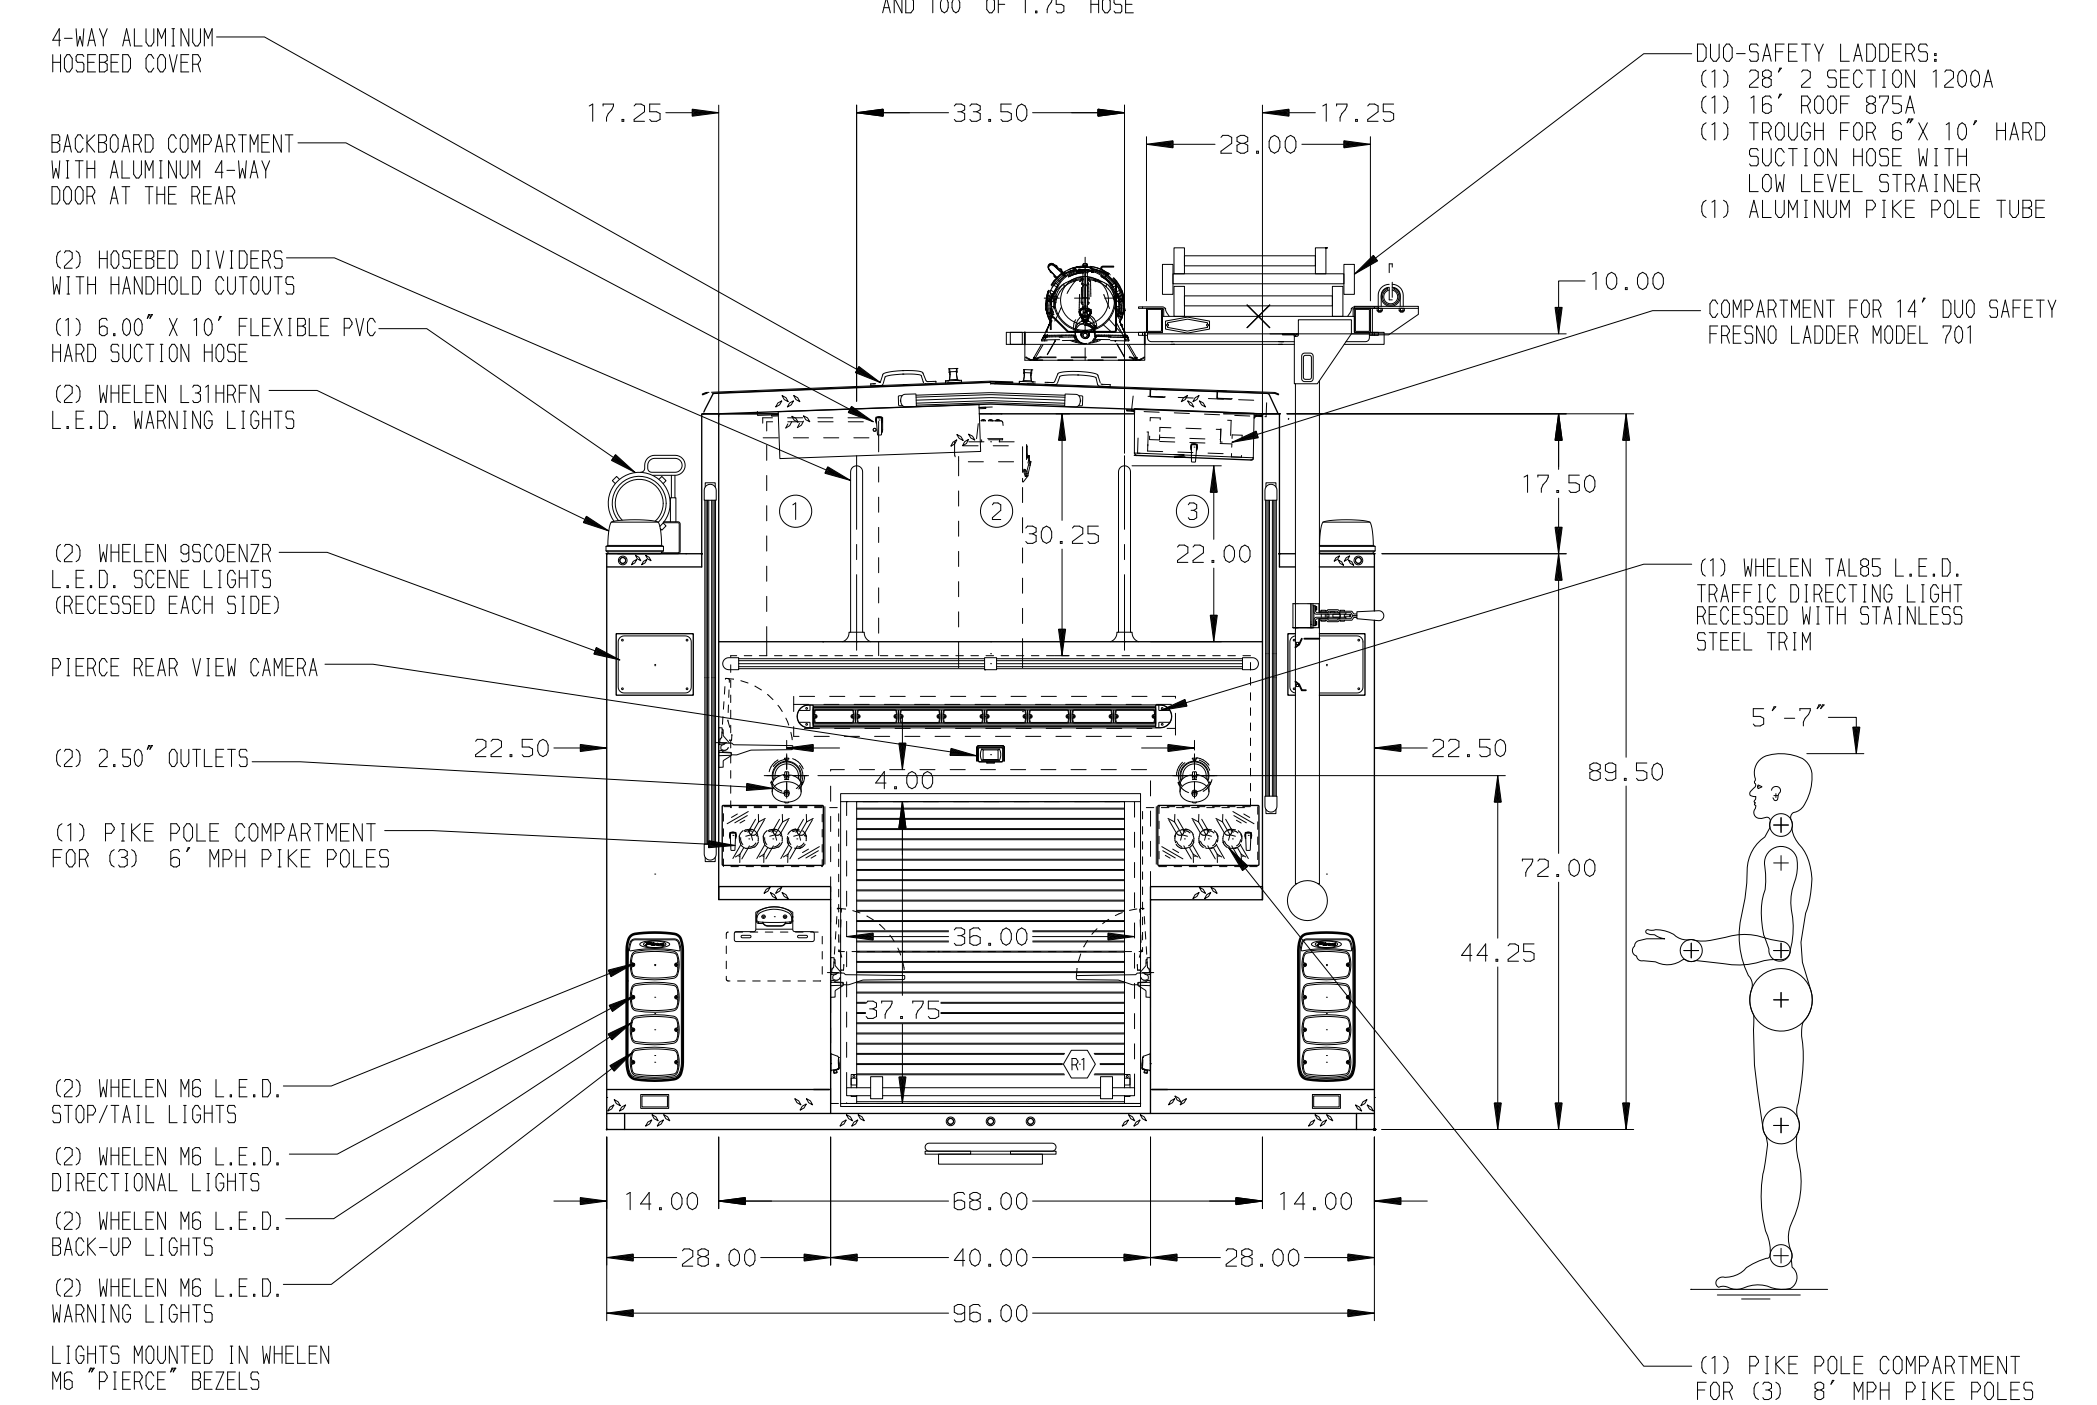

				CHASSIS DATA	TITLE	1500-D-790 750 GAL WATER W/40 GAL FOAM, 161' PUMPER FULL HGHT FRNT & REAR, FOLDER, HYDRAULIC LADDER RACK	DRAWN BY	27SEP16
				MAKE			LST	
	16JAN17	LST	TWH	PIERCE	FOR	MINOOKA FIRE PROTECTION DISTRICT MINOOKA, ILLINOIS	CHECKED BY	30SEP16
				MODEL	DWG		SHEET SIZE	SHEET NO.
REV	02DEC16	LST	TWH	ARROW XT	NO.	30600AD	D	1 OF 1
	DATE	BY	CH					