


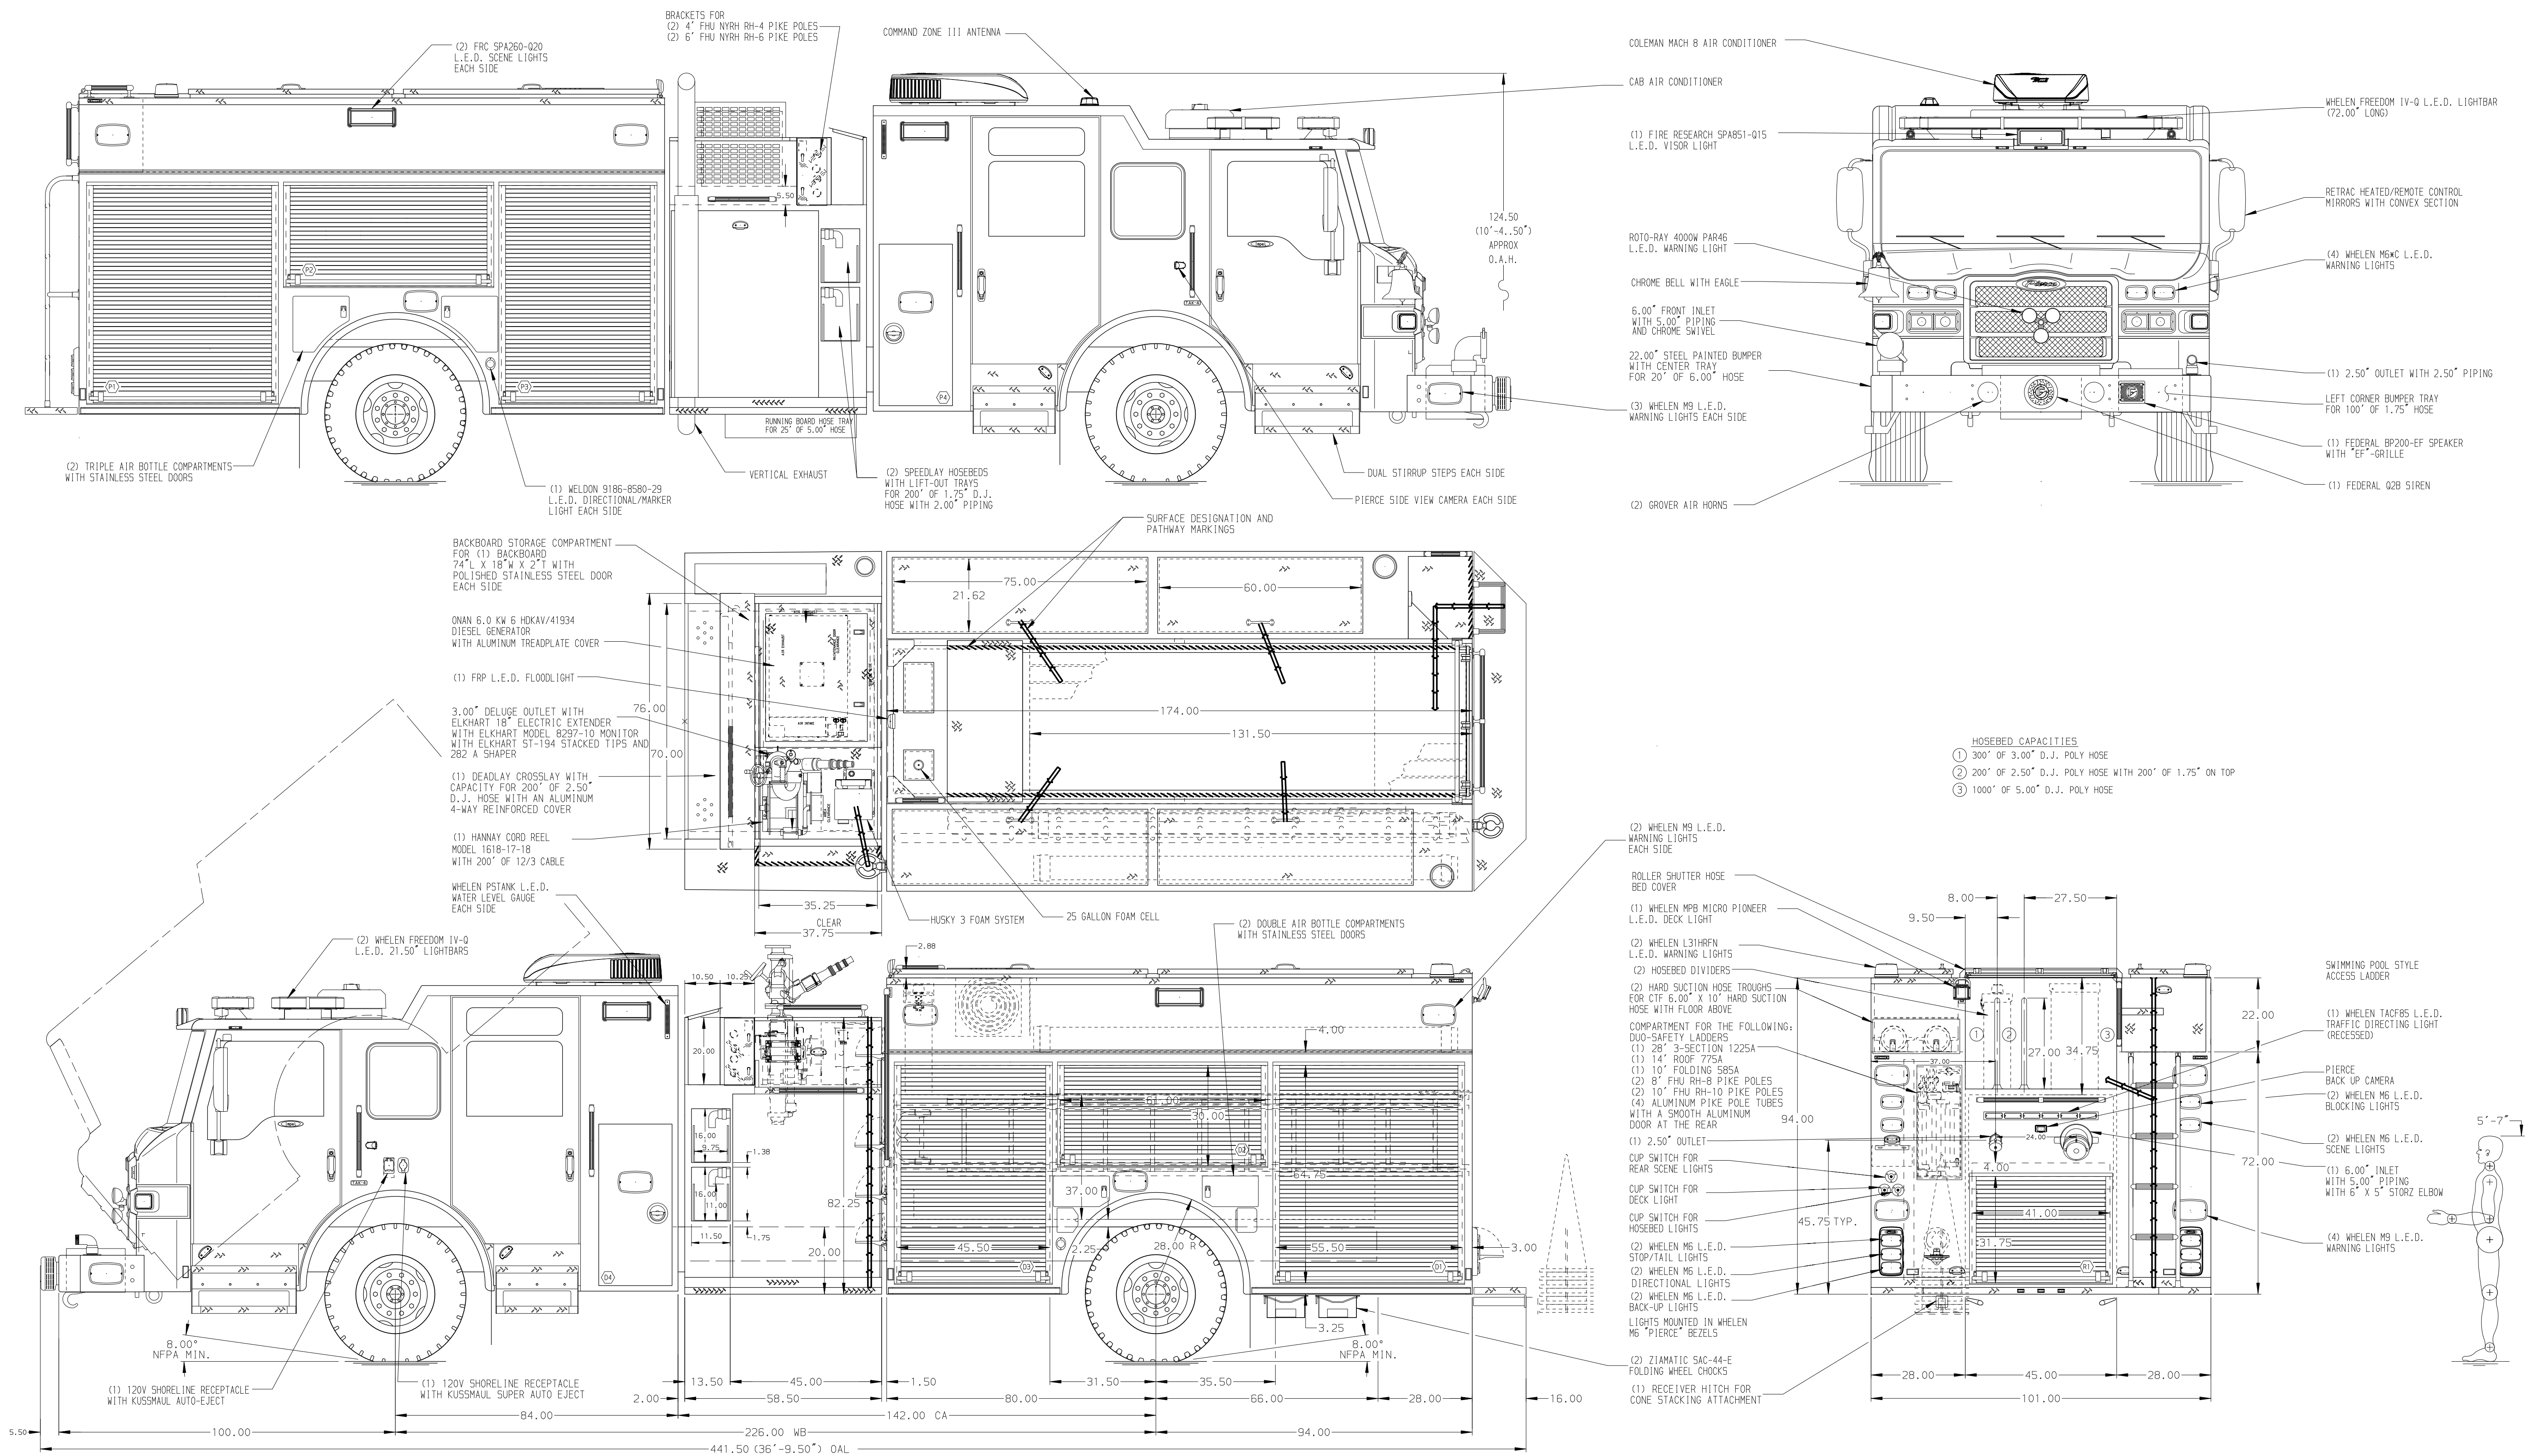

ALUMINUM BODY

FRONTAL IMPACT PROTECTION

NOTE
DIMENSIONS SHOWN ARE APPROXIMATE AND ARE SUBJECT TO MINOR DEVIATIONS AS MAY OCCUR OR BE NECESSARY IN CONSTRUCTION.
MINOR DETAILS NOT SHOWN.

- 1. BATTERY CHARGE INDICATOR LOCATED NEAR D.S. SEAT RISER WITH BRACKET
- 2. AIR INLET/OUTLET WITH DISCONNECT FITTING ON D.S. PUMP PANEL
- 3. ONE 120V NEMA DUPLEX RECEPTACLE IN EACH EMS CABINET

REV	DATE	BY	CH	IMPEL
29MAR18	LST	KWI		CHASSIS DATA
06NOV17	LST	MSA		MAKE
12OCT17	LST	MSA		PIERCE
02AUG17	LST	KBO		MODEL



TITLE	1500-D-750P W/25G FOAM,174",HDR PUMPER
FOR	(2) SPD-LAYS, (1) DEADLAY, DELUGE, GENERATOR, CORD REEL
FOR	PALM BEACH GARDENS FIRE DEPARTMENT
DWG NO.	31477AD-SH1

JOB NO.	31477 01-02
SCALE	1:24
DATE	
DRAWN BY	LST
CHECKED BY	KBO
SHEET NO.	1 OF 2