

# DIESEL GENERATOR SET

## MTU 20V4000 DS2500

2275 kWe / 60 Hz / Data Center Continuous Power  
380 - 13.8kV

Reference: MTU 20V4000 DS2500 (2500 kWe) for Standby Rating Technical Data  
MTU 20V4000 DS2500 (2250 kWe) for Prime Rating Technical Data



### SYSTEM RATINGS

#### Data Center Continuous Power

Voltage (L-L)	380V	480V*	600V	4160V	12470V	13200V	13800V
Phase	3	3	3	3	3	3	3
PF	0.8	0.8	0.8	0.8	0.8	0.8	0.8
Hz	60	60	60	60	60	60	60
kW	2275	2275	2275	2275	2275	2275	2275
kVA	2843	2843	2843	2843	2843	2843	2843
Amps	4320	3420	2736	394	131	124	119
skVA@30%							
Voltage Dip	3400	4625	5200	5800	4300	4750	5350
Generator							
Model	1020FDL1104	1020FDL1102	1020FDS1122	1020FDM1180	1020FDH1248	1020FDH1248	1020FDH1250
Temp Rise	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C	130 °C/40 °C
Connection	6 LEAD WYE	6 LEAD WYE	6 LEAD WYE	6 LEAD WYE	6 LEAD WYE	6 LEAD WYE	6 LEAD WYE

\* UL 2200 Offered

### CERTIFICATIONS AND STANDARDS

// **Emissions** – EPA Tier 2 Certified

// **Generator set is designed and manufactured in facilities certified to standards ISO 9001:2008 and ISO 14001:2004**

// **Seismic Certification – Optional**

- IBC Certification
- OSHPD Pre-Approval

// **UL 2200 Listed – Optional**

// **Performance Assurance Certification (PAC)**

- Generator Set Tested to ISO 8528-5 for Transient Response
- Verified product design, quality and performance integrity
- All engine systems are prototype and factory tested

// **Power Rating**

- Data Center Continuous Power (DCCP) rating is optimized for data center applications
- Uptime Institute compliant for Tier III and IV data centers
- No runtime limitation
- 100% Load Factor
- 10% Overload Available
- Accepts Load in One Step Per NFPA 110

## STANDARD FEATURES\*

- // MTU Onsite Energy is a single source supplier
  - // Global Product Support
  - // 2 Year Standard Warranty
  - // 20V4000 Diesel Engine
    - 95.4 Liter Displacement
    - Common Rail Fuel Injection
    - 4-Cycle
  - // Complete Range of Accessories
- // Generator
    - Brushless, Rotating Field Generator
    - 2/3 Pitch Windings
    - PMG (Permanent Magnet Generator) supply to regulator
    - 300% Short Circuit Capability
  - // Digital Control Panel(s)
    - UL Recognized, CSA Certified, NFPA 110
    - Complete System Metering
    - LCD Display
  - // Cooling System
    - Integral Set-Mounted
    - Engine-Driven Fan

## STANDARD EQUIPMENT\*

### // Engine

Air Cleaners  
 Oil Pump  
 Oil Drain Extension and S/O Valve  
 Centrifugal Oil Filtration  
 Closed Crankcase Ventilation  
 Jacket Water Pump  
 Inter Cooler Water Pump  
 Thermostats  
 Blower Fan and Fan Drive  
 Radiator - Unit Mounted  
 Electric Starting Motor - 24V  
 Governor - Electronic Isochronous  
 Base - Structural Steel  
 SAE Flywheel and Bell Housing  
 Charging Alternator - 24V  
 Battery Box and Cables  
 Flexible Fuel Connectors  
 Flexible Exhaust Connection  
 EPA Certified Engine

### // Generator

NEMA MG 1, IEEE and ANSI standards compliance for temperature rise and motor starting  
 Sustained short circuit current of up to 300% of the rated current for up to 10 seconds  
 Self-Ventilated and Drip-Proof  
 Superior Voltage Waveform  
 Digital, Solid State, Volts-per-Hertz Regulator

No Load to Full Load Regulation  
 Brushless Alternator with Brushless Pilot Exciter  
 4 Pole, Rotating Field  
 2 Bearings, Sealed  
 Flexible Coupling  
 Full Amortisseur Windings  
 125% Rotor Balancing  
 3-Phase Voltage Sensing  
 $\pm 0.25\%$  Voltage Regulation  
 100% of Rated Load - One Step  
 5% Max. Total Harmonic Distortion

### // Digital Control Panel(s)

Digital Metering  
 Engine Parameters  
 Generator Protection Functions  
 Engine Protection  
 CANBus ECU Communications  
 Windows®-Based Software  
 Multilingual Capability  
 Remote Communications to RDP-110 Remote Annunciator  
 Programmable Input and Output Contacts  
 UL Recognized, CSA Certified, CE Approved  
 Event Recording  
 IP 54 Front Panel Rating with Integrated Gasket  
 NFPA 110 Compatible

\* Represents standard product only. Consult Factory/MTU Onsite Energy Distributor for additional configurations.

## APPLICATION DATA

### // Engine

Manufacturer	MTU
Model	20V4000G43 6 ECT
Type	4-Cycle
Arrangement	20-V
Displacement: L (in <sup>3</sup> )	95.4 (5,822)
Bore: cm (in)	17 (6.69)
Stroke: cm (in)	21 (8.27)
Compression Ratio	16.4:1
Rated RPM	1,800
Engine Governor	Electronic Isochronous (ADEC)
Max. Power: kWm (bhp)	2,490 (3,339)
Speed Regulation	±0.25%
Air Cleaner	Dry

### // Liquid Capacity (Lubrication)

Total Oil System: L (gal)	390 (103)
Engine Jacket Water Capacity: L (gal)	205 (54.2)
After Cooler Water Capacity: L (gal)	30 (7.9)
System Coolant Capacity: L (gal)	814 (215)

### // Electrical

Electric Volts DC	24
Cold Cranking Amps Under -17.8 °C (0 °F)	4,200

### // Fuel System

Fuel Supply Connection Size	-16 JIC 37° Female 1" NPT Adapter Provided
Fuel Return Connection Size	-16 JIC 37° Female 1" NPT Adapter Provided
Max. Fuel Lift: m (ft)	1 (3)
Recommended Fuel	Diesel #2
Total Fuel Flow: L/hr (gal/hr)	1,620 (428)

### // Fuel Consumption

At 100% of Power Rating: L/hr (gal/hr)	587 (155)
At 75% of Power Rating: L/hr (gal/hr)	462 (122)
At 50% of Power Rating: L/hr (gal/hr)	337 (89)

### // Cooling - Radiator System

Ambient Capacity of Radiator: °C (°F)	54 (129)
Max. Restriction of Cooling Air: Intake and Discharge Side of Rad.: kPa (in. H <sub>2</sub> O)	0.12 (0.5)
Water Pump Capacity: L/min (gpm)	1,567 (414)
After Cooler Pump Capacity: L/min (gpm)	567 (150)
Heat Rejection to Coolant: kW (BTUM)	890 (50,613)
Heat Rejection to After Cooler: kW (BTUM)	580 (32,984)
Heat Radiated to Ambient: kW (BTUM)	203.6 (11,581)
Fan Power: kW (hp)	87.5 (117.3)

### // Air Requirements


Aspirating: *m <sup>3</sup> /min (SCFM)	228 (8,052)
Air Flow Required for Rad. Cooled Unit: *m <sup>3</sup> /min (SCFM)	2,895 (102,247)
Remote Cooled Applications; Air Flow Required for Dissipation of Radiated Generator Set Heat for a Max. of 25 °F Rise: *m <sup>3</sup> /min (SCFM)	744 (26,119)

\* Air density = 1.184 kg/m<sup>3</sup> (0.0739 lbm/ft<sup>3</sup>)

### // Exhaust System

Gas Temp. (Stack): °C (°F)	455 (851)
Gas Volume at Stack Temp: m <sup>3</sup> /min (CFM)	534 (18,858)
Max. Allowable Back Pressure: kPa (in. H <sub>2</sub> O)	8.5 (34.1)

## WEIGHTS AND DIMENSIONS

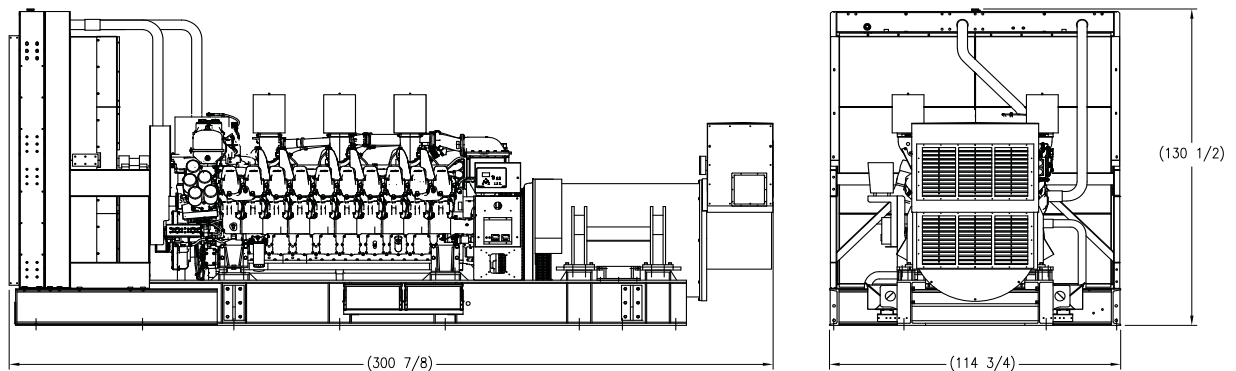

Drawing above for illustration purposes only, based on standard open power 480 volt generator set. Lengths may vary with other voltages. Do not use for installation design. See website for unit specific template drawings.

### System

Open Power Unit (OPU)

### Dimensions (L x W x H)

7,640 x 2,915 x 3,310 mm (300.88 x 114.75 x 130.5 in)

### Weight (less tank)

26,941 kg (59,394 lb)

Weights and dimensions are based on open power units and are estimates only. Consult the factory for accurate weights and dimensions for your specific generator set.

## SOUND DATA

### Unit Type

Level 0: Open Power Unit dB(A)

### DCCP Full Load

97.5

Sound data is provided at 7 m (23 ft). Generator set tested in accordance with ISO 8528-10 and with infinite exhaust.

## EMISSIONS DATA

### NO<sub>x</sub> + NMHC

6.12

### CO

0.37

### PM

0.04

**All units are in g/hp-hr and shown at 100% load (not comparable to EPA weighted cycle values).**

Emission levels of the engine may vary with ambient temperature, barometric pressure, humidity, fuel type and quality, installation parameters, measuring instrumentation, etc. The data was obtained in compliance with US EPA regulations. The weighted cycle value (not shown) from each engine is guaranteed to be within the US EPA Standards.

## RATING DEFINITIONS AND CONDITIONS

// Data Center Continuous Power (DCCP) ratings apply to data center installations where a utility power is available and comply with Uptime Institute Tier III and IV requirements. At constant or varying load, the number of generator set operating hours is unlimited. A 10% overload capacity is available for one hour in twelve. Ratings are in accordance with ISO 8528-1, ISO 3046-1, BS 5514, and AS 2789. Average load factor: ≤ 100%.

// Deration Factor:

**Altitude:** Consult your local MTU Onsite Energy Power Generation Distributor for altitude derations.

**Temperature:** Consult your local MTU Onsite Energy Power Generation Distributor for temperature derations.

C/F = Consult Factory/MTU Onsite Energy Distributor

N/A = Not Available

MTU Onsite Energy

A Rolls-Royce Power Systems Brand

[www.mtuonsiteenergy.com](http://www.mtuonsiteenergy.com)