


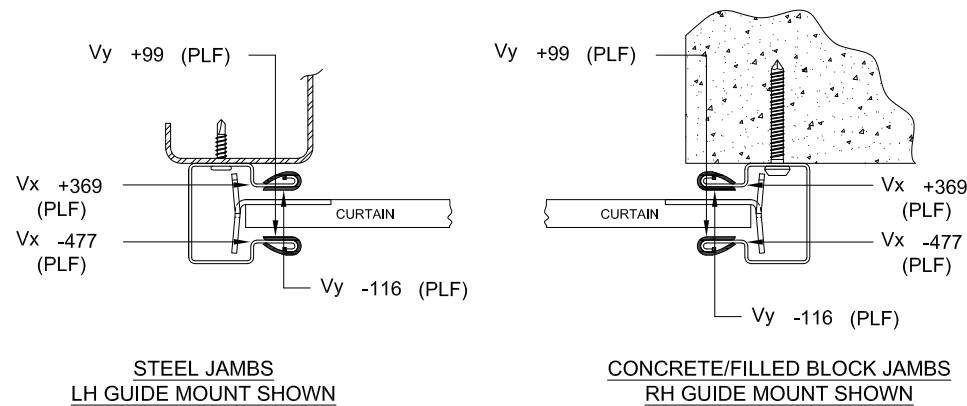


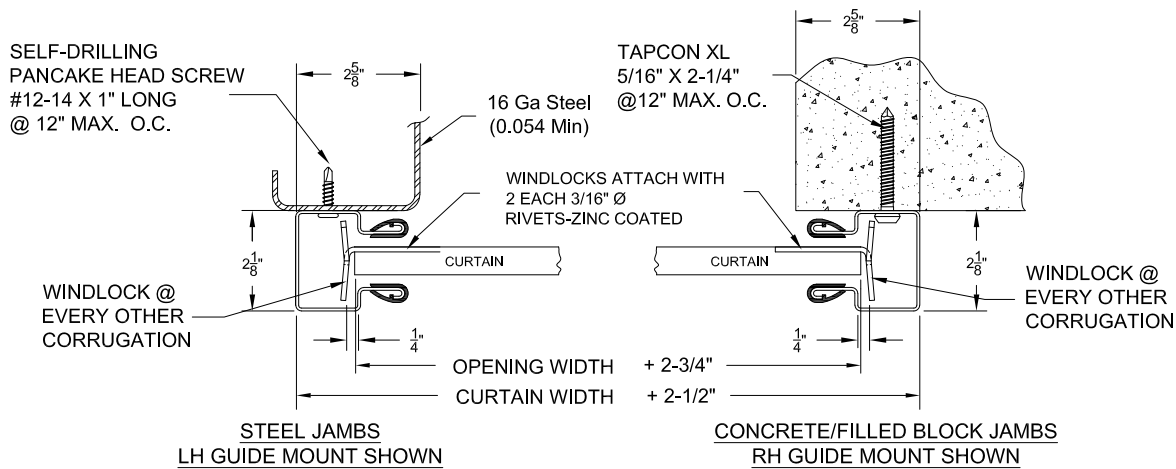

REVISIONS			
REV	DESCRIPTION	DATE	APPROVAL
	DRAWING RELEASE	5-30-07	DM
A	NOTE REVISIONS	6-17-09	CS
B	16 GA. STEEL JAMB/1.5X1.5X.072MIN BB	7-7-17	CS
C	Note: Alternate Concrete/Masonry Fasteners	9-25-17	CS

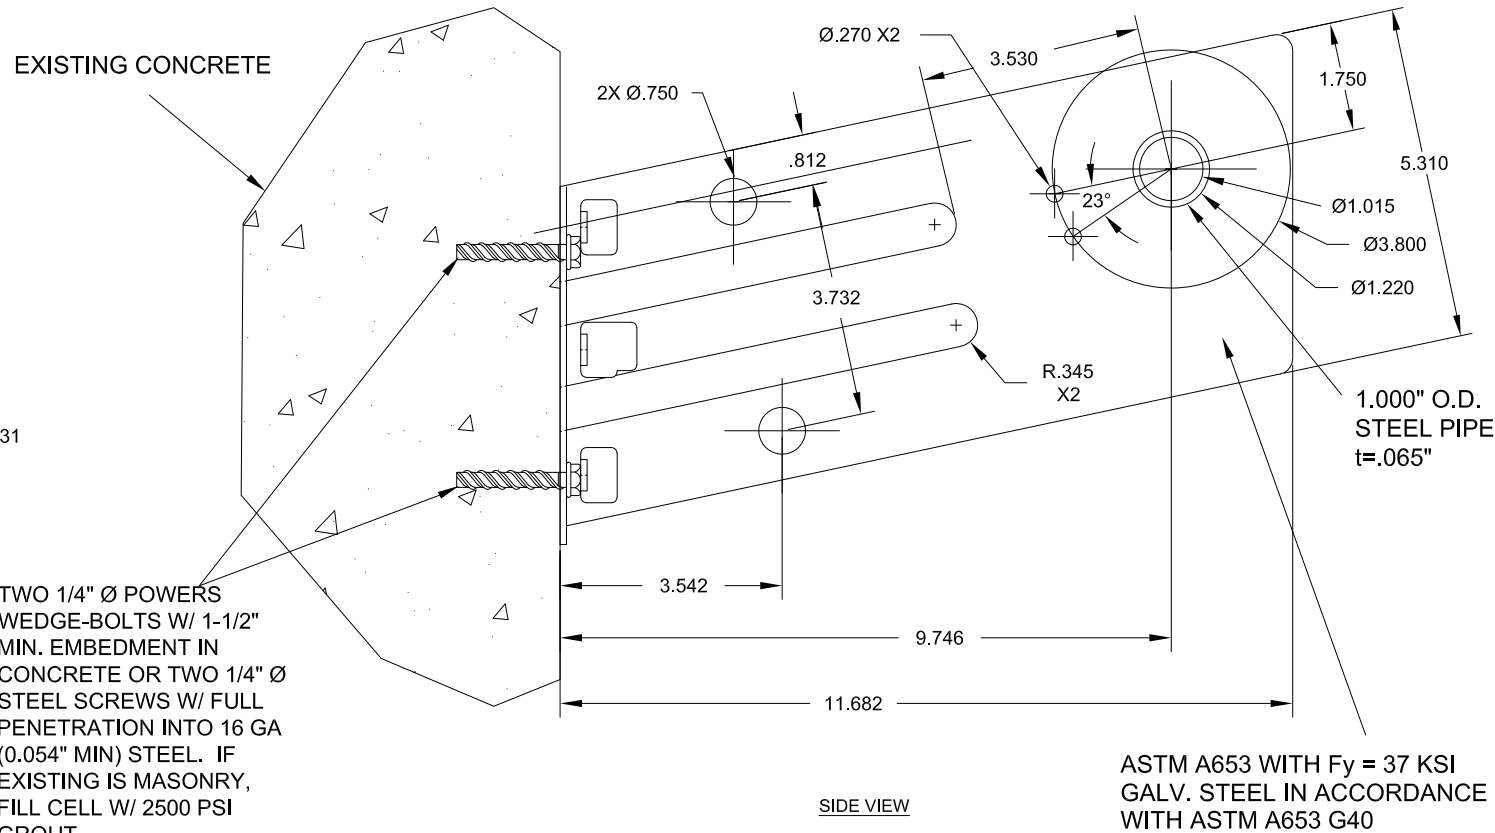

### SUPERIMPOSED LOAD DIAGRAM

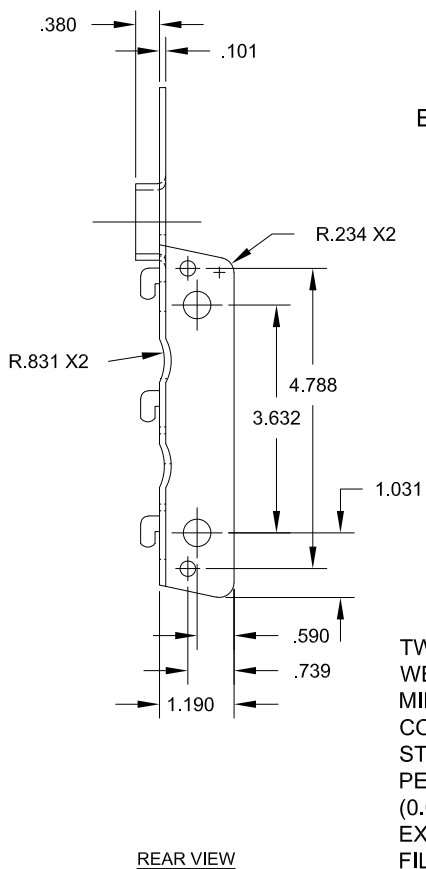

### DOOR MOUNTING BRACKET DETAIL

## GENERAL NOTES

1. THIS ROLL-UP DOOR SYSTEM IS DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE.
2. THIS ROLL-UP DOOR HAS BEEN TESTED IN ACCORDANCE WITH ASTM E-330 AND COMPLIES WITH ANSI/DASMA 108.

DESIGN LOAD = PSF  $\begin{matrix} +19.4 \\ -22.7 \end{matrix}$

3. WIND LOADS FOR BUILDING OPENINGS SHALL BE DETERMINED BY A PROFESSIONAL ENGINEER USING APPROPRIATE WIND SPEED AND DESIGN CRITERIA. THIS DOOR MAY BE USED WHERE THE DESIGN LOAD MEETS OR EXCEEDS THE DESIGN LOAD FOR THE BUILDING OPENING.
4. SUPERIMPOSED LOADS ON THE JAMBS FROM THIS DOOR ARE DESIGNED AS  $V_x$  AND  $V_y$  HEREIN. CONTRACTORS SHALL HAVE BUILDING ENGINEER VERIFY ADEQUACY OF BUILDING STRUCTURE TO RESIST SUPERIMPOSED LOADS  $V_x$ ,  $V_y$  AND BRACKET LOADS SHOWN.
5. ALL WELDING SHALL BE PERFORMED BY QUALIFIED WELDERS IN ACCORDANCE WITH A.W.S. SPECIFICATIONS, LATEST EDITION. ALL WELDING ELECTRODES SHALL CONFORM TO A.W.S. A5.1 GRADE E-70.
6. DOORS SHALL BE PROVIDED WITH LOCK MECHANISMS AT THE OPTION OF THE OWNER.
7. ALL BOLTS AND WASHERS SHALL BE GALVANIZED OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI.
8. DESIGN BASED ON UNDERWRITERS LABORATORIES TEST REPORT NO. SV30743-20161010-REPORT4

9. ANCHOR NOTES:
- A. EMBEDMENT LENGTH DOES NOT INCLUDE STUCCO FINISH.
  - B. FOR HOLLOW MASONRY, FILL ALL CELLS @ ANCHOR WITH 2500 PSI GROUT.
  - C. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS.
  - D. ALTERNATE FASTENERS: DEWALT SCREW BOLT+ AND SIMPSON TITEN HD.

10. DOOR OPERATION TYPE TO BE PUSH-UP, HAND CHAIN OR ELECTRIC.
11. GUIDE TO JAMB ATTACHMENT FASTENERS BEGIN 4" FROM FLOOR AND END 3-1/2" BELOW TOP OF WALL OPENING.
12. TEST DOOR WALL OPENING SIZE: 10'-0" x 8'-0".

THESE CONFIDENTIAL DOCUMENTS SUBMITTED BY JANUS CONTAIN INFORMATION OF A PROPRIETARY NATURE AND MAY NOT BE REPRODUCED OR USED TO MANUFACTURE ANYTHING IN PART OR IN WHOLE FOR ANY PURPOSE OTHER THAN THAT WHICH IS NECESSARY FOR PREPARATION OF BIDS OF ENGINEERING WITHOUT THE EXPRESS PERMISSION OF JANUS WHICH MAY RECALL DOCUMENTS AT ANY TIME.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES AND TOLERANCES ARE:

DECIMAL	FRACTIONS	ANGLES	HOLE DIAMETERS
.XX ±.03	± 1/16	± 0° 30'	UNDER 0.251 <sup>+.004</sup> <sub>-.003</sub>
.XXX ±.005			0.251 to 0.500 <sup>+.006</sup> <sub>-.003</sub>
			OVER 0.500 <sup>+.008</sup> <sub>-.003</sub>

PART NUMBER:		<b>JANUS INTERNATIONAL GROUP, LLC.</b>					
MATERIAL:		135 JANUS INTERNATIONAL BLVD.    TEMPLE, GA    30179-4435					
APPLIED FINISH:		770-562-2850/Fax 770-562-2264					
UNIT OF MEASURE:		©2017 Janus International Group, LLC. All Rights Reserved					
APPROVALS		DATE		<b>CERTIFIED WIND LOAD RATED</b> <b>26 GA SERIES 1100 DOOR ASSEMBLY</b> <b>MAX. SIZE 10'-0" X 14'-0"</b>			
DRAWN:							
BECKY NELSON	5-30-07						
CHECKED:		SIZE	DRAWING NUMBER:				REV:
DON MILLS	5-30-07	<b>B</b>	<b>T1013</b>				<b>C</b>
APPROVED:		SCALE:	NONE		SHEET:	2	OF: 2
DON MILLS	5-30-07						

John E. Scates, P.E.  
2560 King Arthur, STE 124-54  
Lewisville, TX 75056  
FL PE 51737\_TX PE 56308/F2203

Professional Engineer's seal provided only for verification of windload construction details.