


- ① Only two (2) 90 degree bends allowed between pull points
- ② Conduit must be continuous without pull boxes

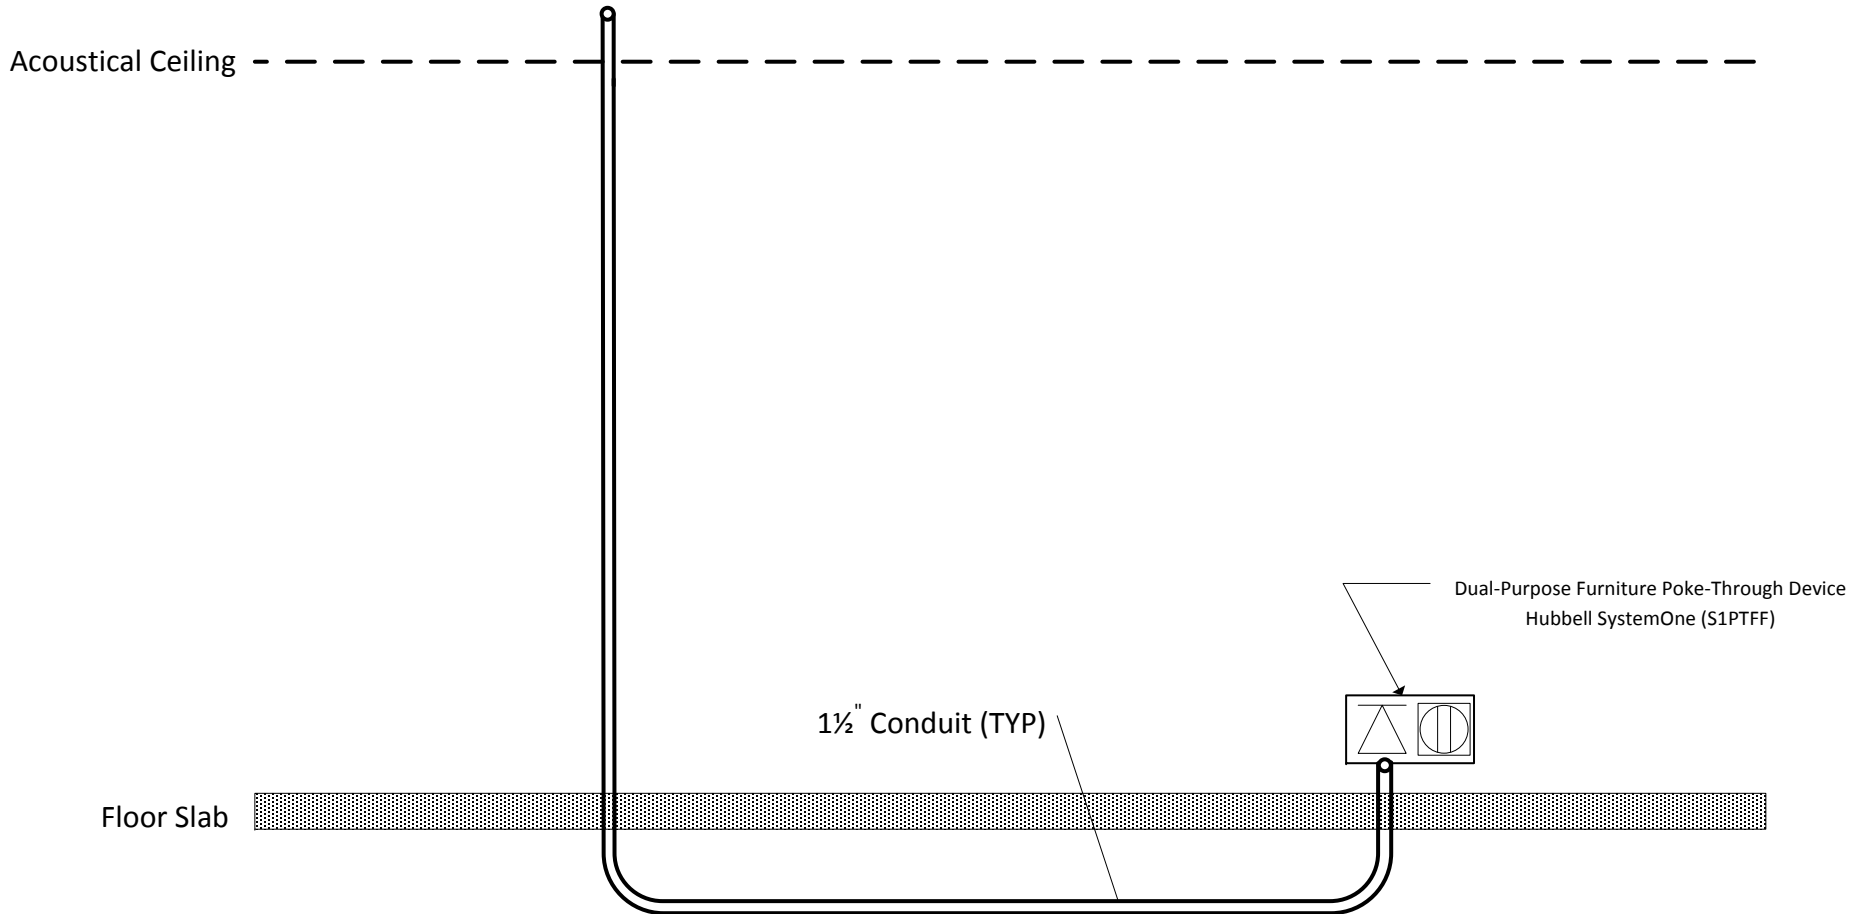

Furniture Poke-Through Conduit Configuration