


SINGLE DOOR with DC

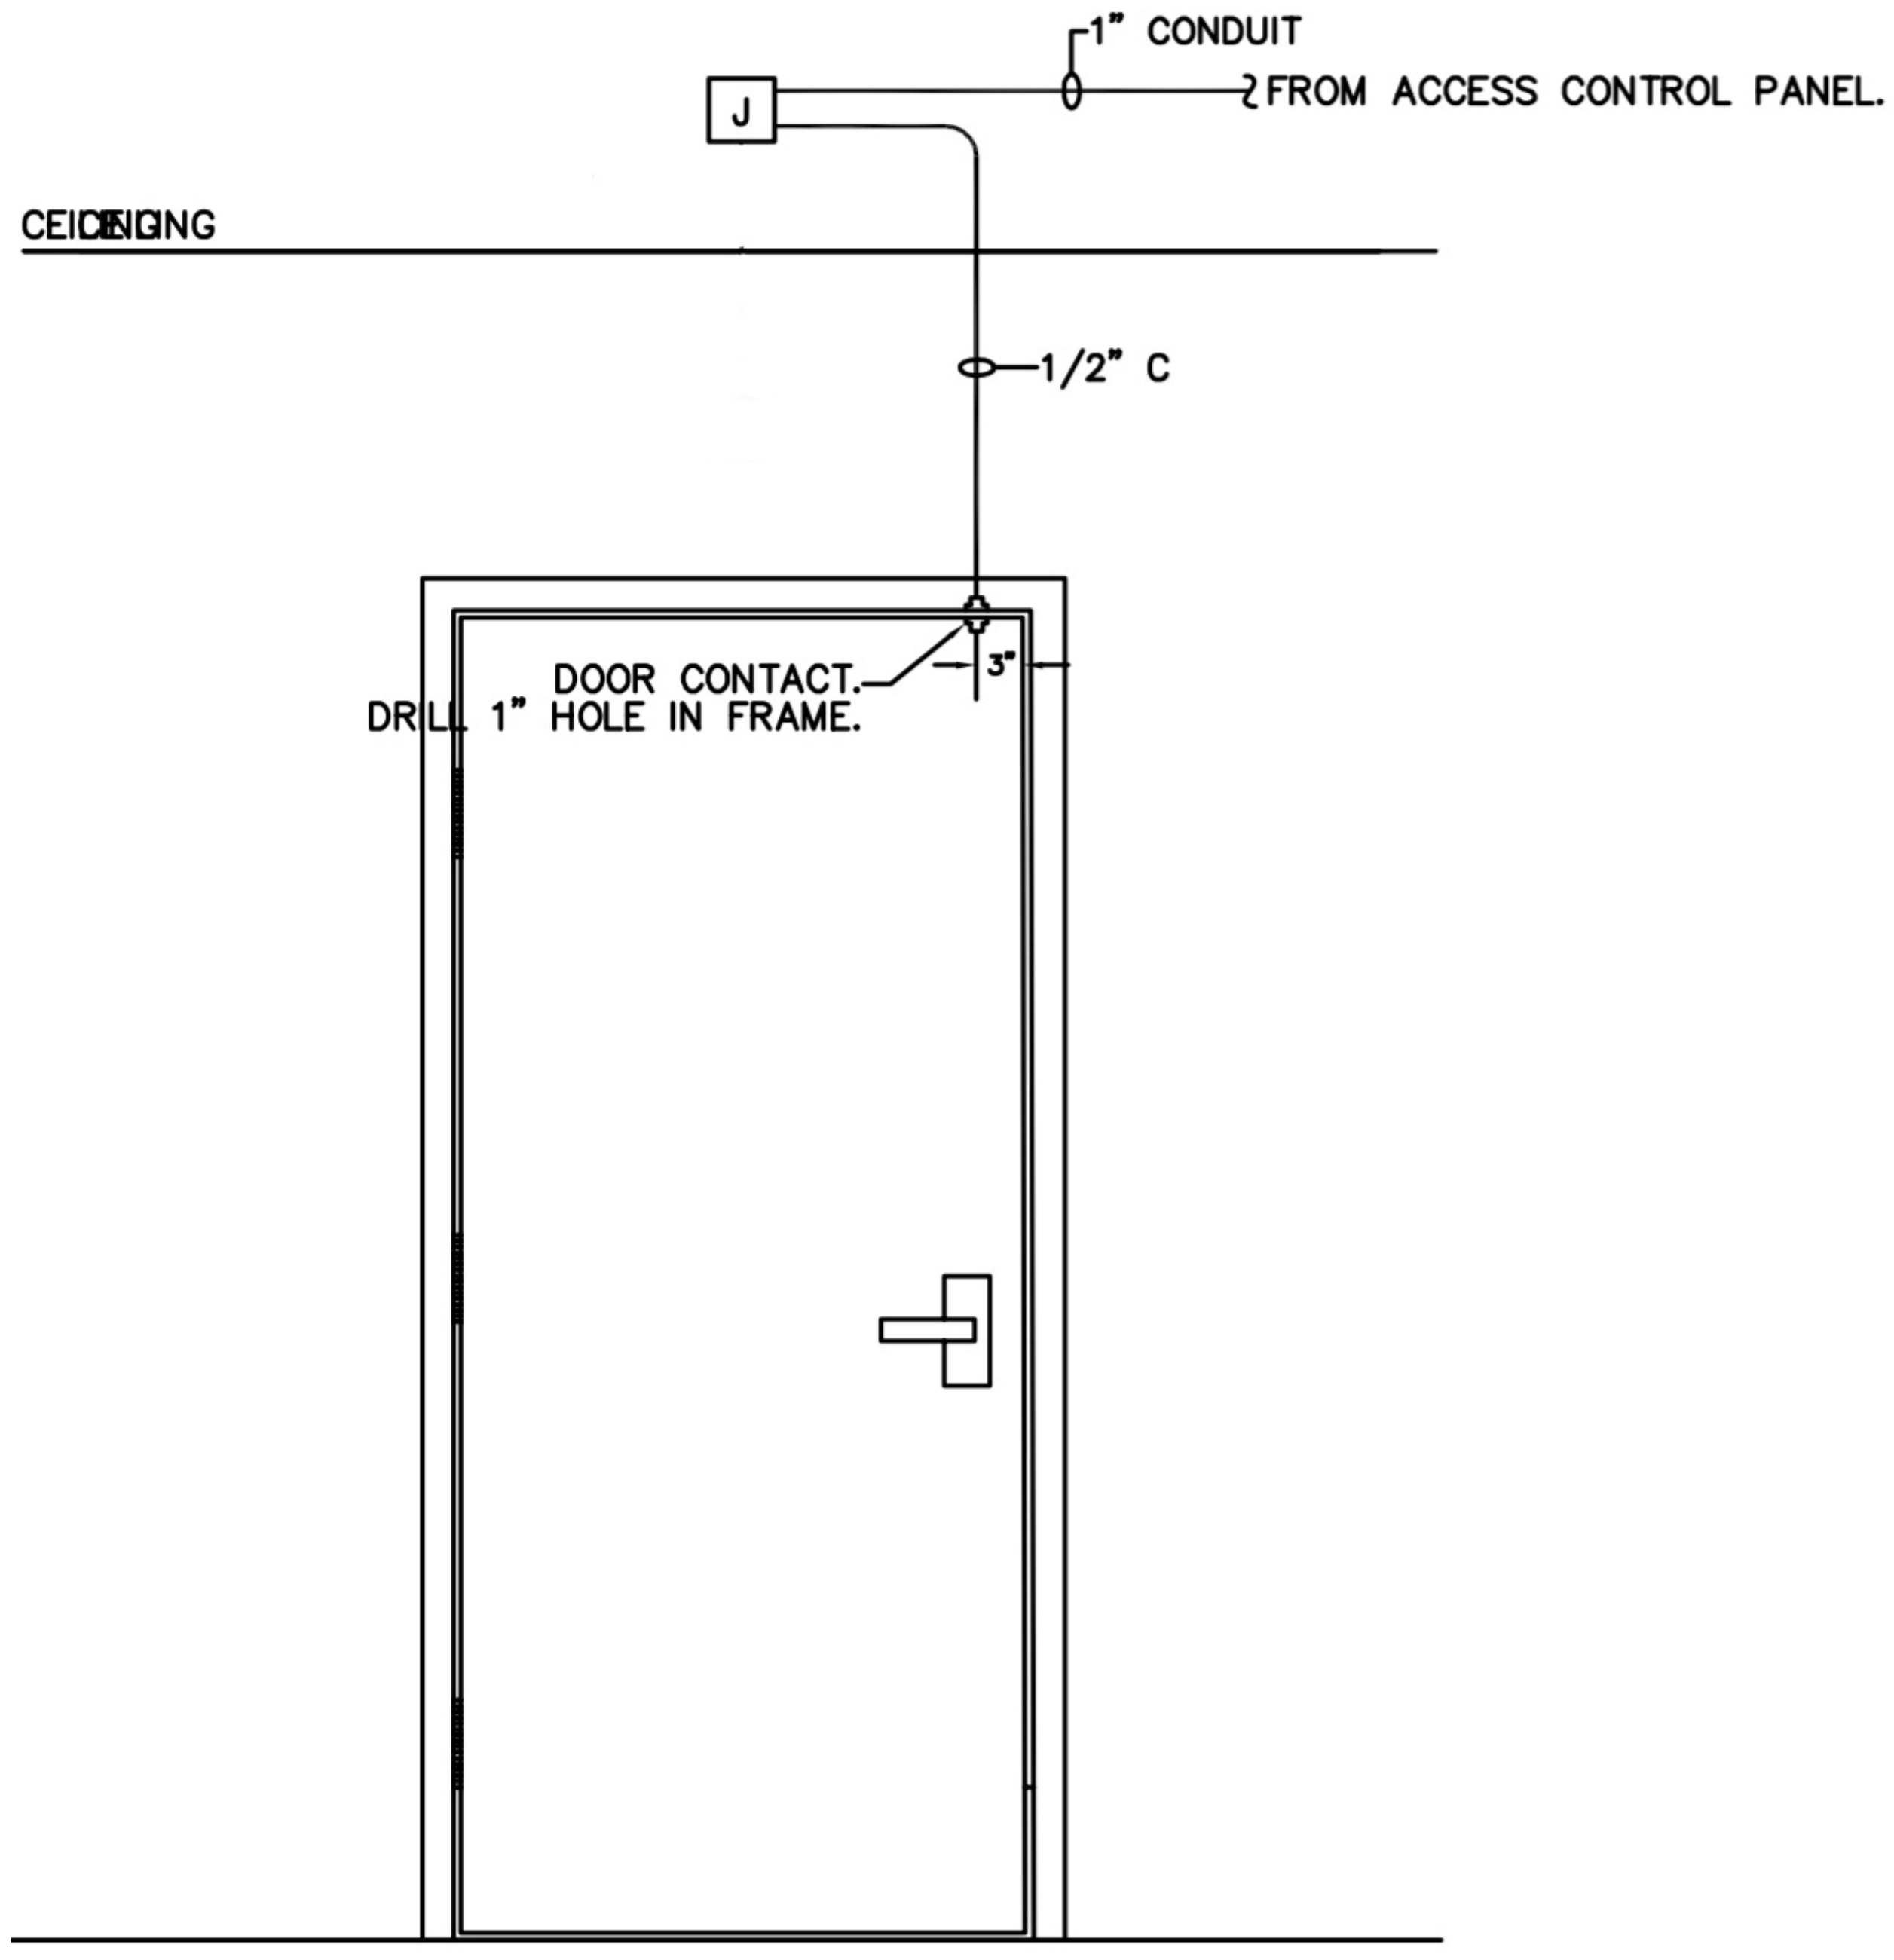

OPERATION

Door is always locked from outside. This door is always unlocked in the direction of egress. Activation of inside lock lever will allow free egress at all times.

INSTALLATION

- 1 Drill hole in top of door for door contact.
- 2 Stub flex conduit from junction box into door contact.

EQUIPMENT

(1) Recessed Door Contact

GENERAL NOTES

1. THE WIRE JUNCTION SHALL BE MOUNTED ABOVE THE DOOR OR ABOVE THE ACCESSIBLE CEILING, WHERE APPLICABLE, ON THE SECURE SIDE AS SHOWN.
2. THE IDENTIFIED CONDUIT IS NOT REQUIRED AFTER IT EXTENDS ABOVE THE WALL AND ENTERS INTO A PLENUM SPACE.
3. ALL CONDUIT SHALL BE 3/4" UNLESS SPECIFIED OTHERWISE. ALL CONDUIT SHALL BE INSTALLED INSIDE OF WALL. FLEXIBLE CONDUIT MAY BE USED IF NECESSARY. EACH CONDUIT RUN SHALL BE FURNISHED WITH A PULL STRING.

NFPA COMPLIANCE

NFPA 101: 7.2.1.5

DC

CUSTOMER:			
TITLE:	DRAWN BY:		
DRAWING NUMBER:	SCALE:		
QUOTE/ORDER No.	SHEET:	DATE:	REVISION LEVEL:
			0.00
REVISIONS			

PROJECT NAME
ADDRESS