


BACKFILL WITH
SAND OR
GRAVEL AND
COMPACT

OPENING
WIDTH
OVERLAP
4"

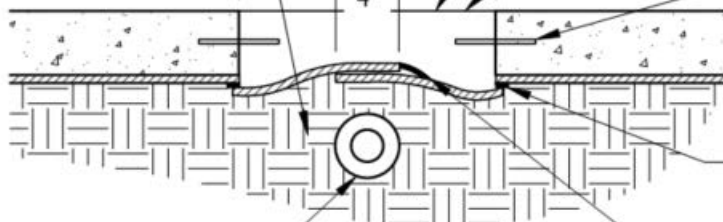

ELECTRICAL OR
PLUMBING LINE

G.C. TO PROVIDE MOISTURE
RESISTANT BARRIER (ARDEX MC
RAPID) AT POUR BACKS.
COORDINATE WITH FLOOR
FINISH MANUFACTURER.

G.C. TO ENSURE LEVEL POUR
BACK TO ALLOW FOR
INSTALLATION OF TENANT
FINISHES.

DRILL AND EPOXY GROUT INTO
EXISTING SLAB WITH #3 REBAR
AT 18" O.C. EACH SIDE WITH 3"
MINIMUM EMBED.

OVERLAP EXISTING AND NEW
VISQUEEN (10 MIL) AS MUCH AS
POSSIBLE

TAPE SEAM

1. NEW CONCRETE IN-FILL MUST BE LEVEL WITH EXISTING SLAB, SMOOTH AND READY TO ACCEPT TENANT FINISHES.

2. REFER TO SHEET CS3.0 FOR MOISTURE VENDOR CONTACT INFORMATION.

6

SLAB ON GRADE TRENCH DETAIL

SCALE

1"=1'-0"